




WINDSOR AUGHTRY
HOME2 ASHEVILLE
380 AIRPORT RD.
ASHEVILLE, NC 28704

SHEET ISSUE
07/30/18
FOR CONSTRUCTION

Revisions		
Number	Description	Date
A	Addendum 1: Food Prep Changes to Coord w/ Prototype	09/06/18

PRINCIPAL IN CHARGE
PROJECT ARCHITECT
DRAWN BY
SHEET TITLE
ENLARGED PUBLIC
SPACE OVERALL
PLAN - POWER

SHEET NO. E301
PROJ NO. 017378.90

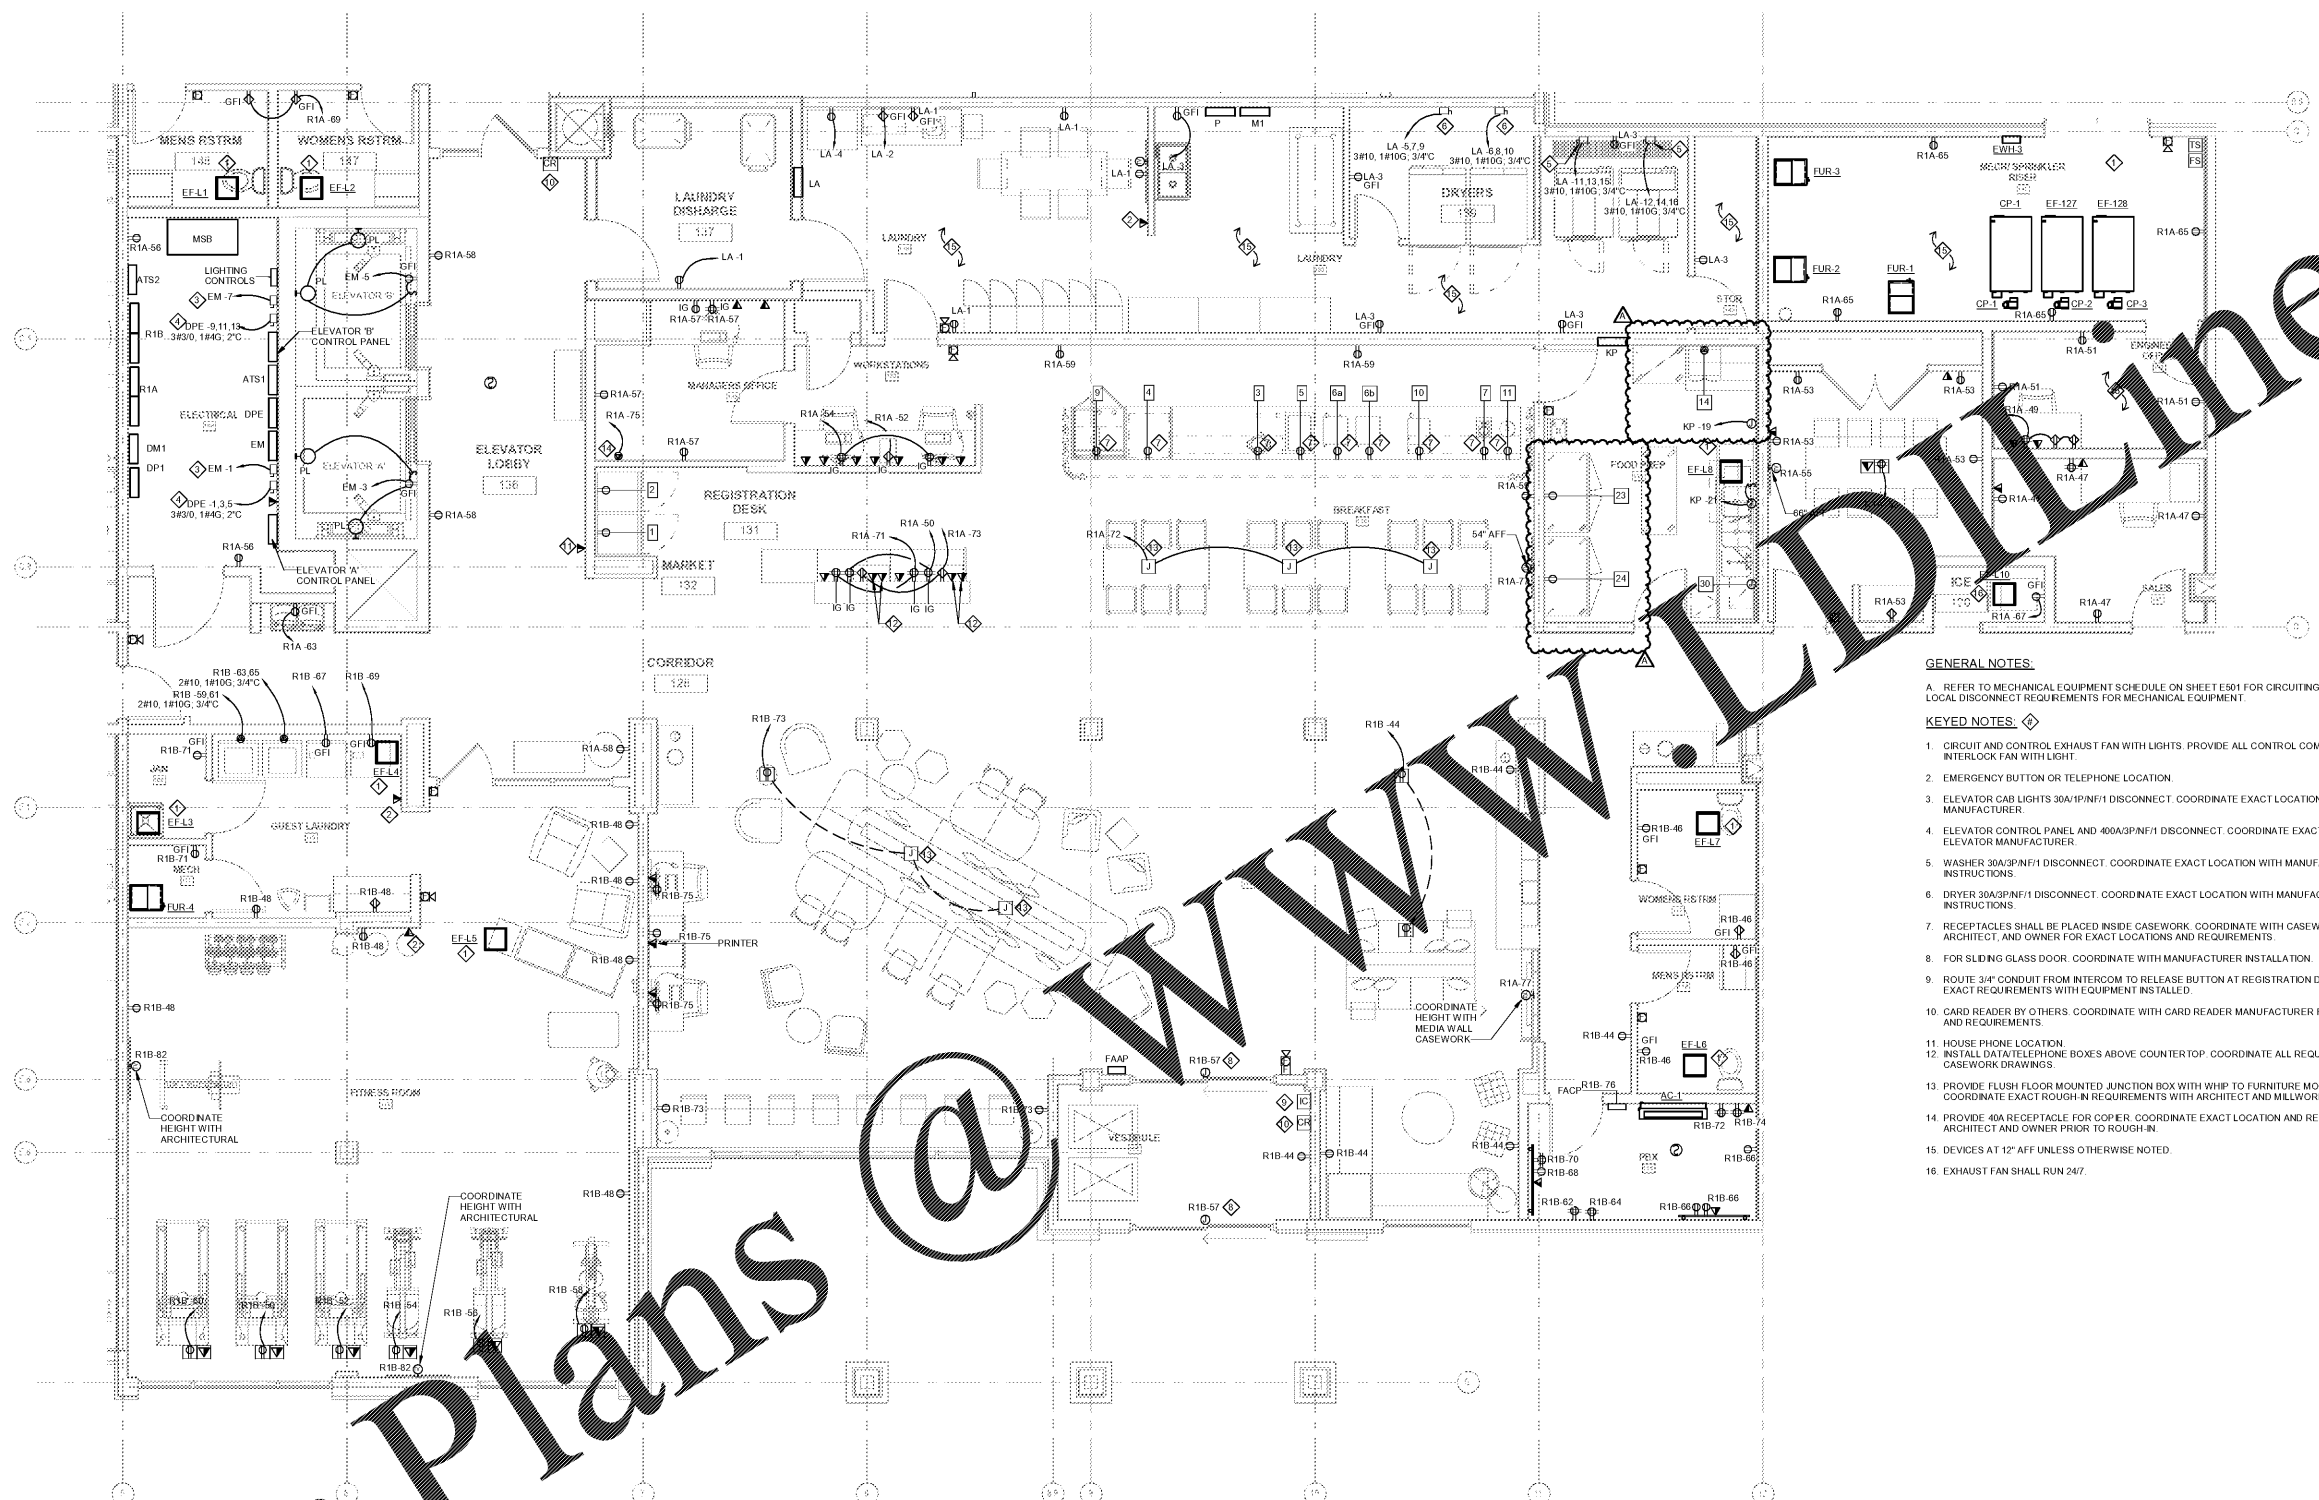

- GENERAL NOTES:**
- A. REFER TO MECHANICAL EQUIPMENT SCHEDULE ON SHEET E501 FOR CIRCUITING, FEEDER AND LOCAL DISCONNECT REQUIREMENTS FOR MECHANICAL EQUIPMENT.
- KEYED NOTES:**
- CIRCUIT AND CONTROL EXHAUST FAN WITH LIGHTS. PROVIDE ALL CONTROL COMPONENTS REQUIRED TO INTERLOCK FAN WITH LIGHT.
 - EMERGENCY BUTTON OR TELEPHONE LOCATION.
 - ELEVATOR CAB LIGHTS 30A/1P/NF/1 DISCONNECT. COORDINATE EXACT LOCATION WITH ELEVATOR MANUFACTURER.
 - ELEVATOR CONTROL PANEL AND 400A/3P/NF/1 DISCONNECT. COORDINATE EXACT LOCATION WITH ELEVATOR MANUFACTURER.
 - WASHER 30A/3P/NF/1 DISCONNECT. COORDINATE EXACT LOCATION WITH MANUFACTURER INSTALLATION INSTRUCTIONS.
 - DRYER 30A/3P/NF/1 DISCONNECT. COORDINATE EXACT LOCATION WITH MANUFACTURER INSTALLATION INSTRUCTIONS.
 - RECEPTACLES SHALL BE PLACED INSIDE CASEWORK. COORDINATE WITH CASEWORK MANUFACTURER, ARCHITECT, AND OWNER FOR EXACT LOCATIONS AND REQUIREMENTS.
 - FOR SLIDING GLASS DOOR. COORDINATE WITH MANUFACTURER INSTALLATION.
 - ROUTE 3/4" CONDUIT FROM INTERROOM TO RELEASE BUTTON AT REGISTRATION DESK. COORDINATE EXACT REQUIREMENTS WITH EQUIPMENT MANUFACTURER.
 - CARD READER BY OTHERS. COORDINATE WITH CARD READER MANUFACTURER FOR EXACT LOCATION AND REQUIREMENTS.
 - HOUSE PHONE LOCATION.
 - INSTALL DATA/TELEPHONE BOXES ABOVE COUNTERTOP. COORDINATE ALL REQUIREMENTS WITH CASEWORK DRAWINGS.
 - PROVIDE FLUSH FLOOR MOUNTED JUNCTION BOX WITH WHP TO FURNITURE MOUNTED RECEPTACLES. COORDINATE EXACT ROUGH-IN REQUIREMENTS WITH ARCHITECT AND MILLWORK MANUFACTURER.
 - PROVIDE 40A RECEPTACLE FOR COOPER. COORDINATE EXACT LOCATION AND RECEPTACLE TYPE WITH ARCHITECT AND OWNER PRIOR TO ROUGH-IN.
 - DEVICES AT 12" AFF UNLESS OTHERWISE NOTED.
 - EXHAUST FAN SHALL RUN 24/7.

KITCHEN EQUIPMENT SCHEDULE

REMARKS:
1. VERIFY ALL REQUIREMENTS WITH ACTUAL EQUIPMENT PROVIDED.
2. PROVIDE CORD AND PLUG. FIELD COORDINATE.

TAG	VOLTS	PH	LOAD NAME	PNL/CKT	CONDUCTORS /CONDUIT	DEVICE	REMARKS
1	120 V	1	DISPLAY FREEZER	KP 1	2#12; 1#12G; 3/4"	NEMA 5-15R	
2	120 V	1	DISPLAY REFRIGERATOR	KP 2	2#12; 1#12G; 3/4"	NEMA 5-15R	
3	120 V	1	WARMING KETTLE	KP 9	2#12; 1#12G; 3/4"	NEMA 5-15R	
4	120 V	1	UC REFRIGERATOR	KP 7	2#12; 1#12G; 3/4"	NEMA 5-15R	
5	120 V	1	REFRIG COLD WELL	KP 11	2#12; 1#12G; 3/4"	NEMA 5-15R	1
6a	120 V	1	MICROWAVE OVEN	KP 13	2#12; 1#12G; 3/4"	NEMA 5-20R	
6b	120 V	1	MICROWAVE OVEN	KP 15	2#12; 1#12G; 3/4"	NEMA 5-20R	
7	120 V	1	WAFFLE IRON	KP 2	2#12; 1#12G; 3/4"	NEMA 5-20R	
9	120 V	1	JUICE DISPENSER	KP 5	2#12; 1#12G; 3/4"	NEMA 5-20R	
10	120 V	1	CONVEYOR GASSTER	KP 17	2#12; 1#12G; 3/4"	NEMA 5-15R	
11	120 V	1	BATTER MIX STARTER KIT	KP 4	2#12; 1#12G; 3/4"	NEMA 5-15R	1
23	120 V	1	MOBILE REACH-IN REFRIGERATOR	KP 8	2#12; 1#12G; 3/4"	NEMA 5-15R	
24	120 V	1	MOBILE REACH-IN FREEZER	KP 16	2#12; 1#12G; 3/4"	NEMA 5-15R	

1 ENLARGED PUBLIC SPACE OVERALL PLAN - LEVEL 1 (POWER)
E301 1/4" = 1'-0"

Order Plans