GENERAL NOTES:

A. EXIT SIGNS, EMERGENCY LIGHTS, AND LIGHT FIXTURES WITH BATTERY BALLAST SHALL BE CIRCUITED WITH UNSWITCHED CONDUCTOR OF CIRCUIT INDICATED, WITH NORMAL POWER BALLAST FOR SWITCHED OPERATION WHERE APPLICABLE.

B. REFERENCE ARCHITECTURAL REFLECTED CEILING PLAN FOR EXACT FIXTURE LOCATIONS.

C. REFER TO SHEET E001 FOR LIGHTING FIXTURE SCHEDULE.

D. COORDINATE ALL REQUIREMENTS FOR POOL EQUIPMENT, BONDING, AND INSTALLATION WITH POOL VENDOR. REFER TO POOL DRAWINGS.

KEYED NOTES:

1. ROUTE CIRCUIT THROUGH LIGHTING CONTROLS. REFERS TO DETAILS ON SHEET E601.
2. PROVIDE CONNECTION TO SUBMERSIBLE POOL LIGHT, FURNISHED BY OTHERS. PROVIDE CONTROL FOR LIGHT PER OWNER REQUIREMENTS.

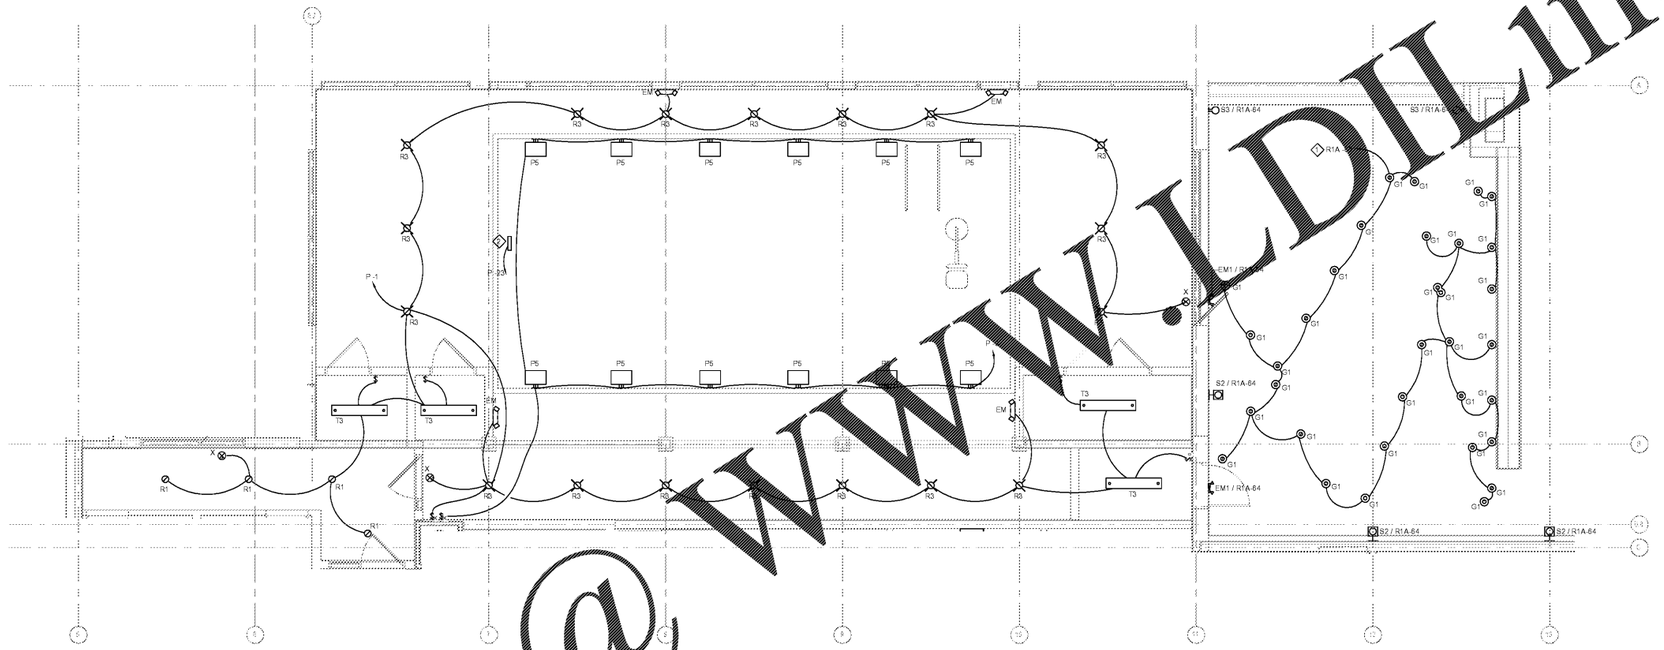

1 E304 ENLARGED PUBLIC POOL OVERAL PLAN - LEVEL 1 (LIGHTING)
1/4" = 1'-0"

Order Plans @ WWW.LDILine.com

mcmillan pazdan smith ARCHITECTURE

CONSULTANT LOGO

DEVITA
ATLANTA • CHARLOTTE • GREENVILLE
RICHMOND
877.4.DEVITA • corp@devitainc.com
Devita & Associates, Inc. Project : 17239
NC Firm License # C-0819
Drawn By: MS Checked By: RAG

SEALS

NORTH CAROLINA PROFESSIONAL SEAL 042363 ENGINEER RYAN A. GRAY 2/9/2018

WINDSOR AUGHTRY

HOME2 ASHEVILLE

390 AIRPORT RD.
ARDEN, NC 28704

SHEET ISSUE:
07/30/18
FOR CONSTRUCTION

Revisions		
Number	Description	Date

PRINCIPAL IN CHARGE:
PROJECT ARCHITECT:
DRAWN BY:

SHEET TITLE:
ENLARGED PUBLIC POOL OVERALL PLAN - LIGHTING

SHEET NO. E304

PROJ. NO. 017376.00