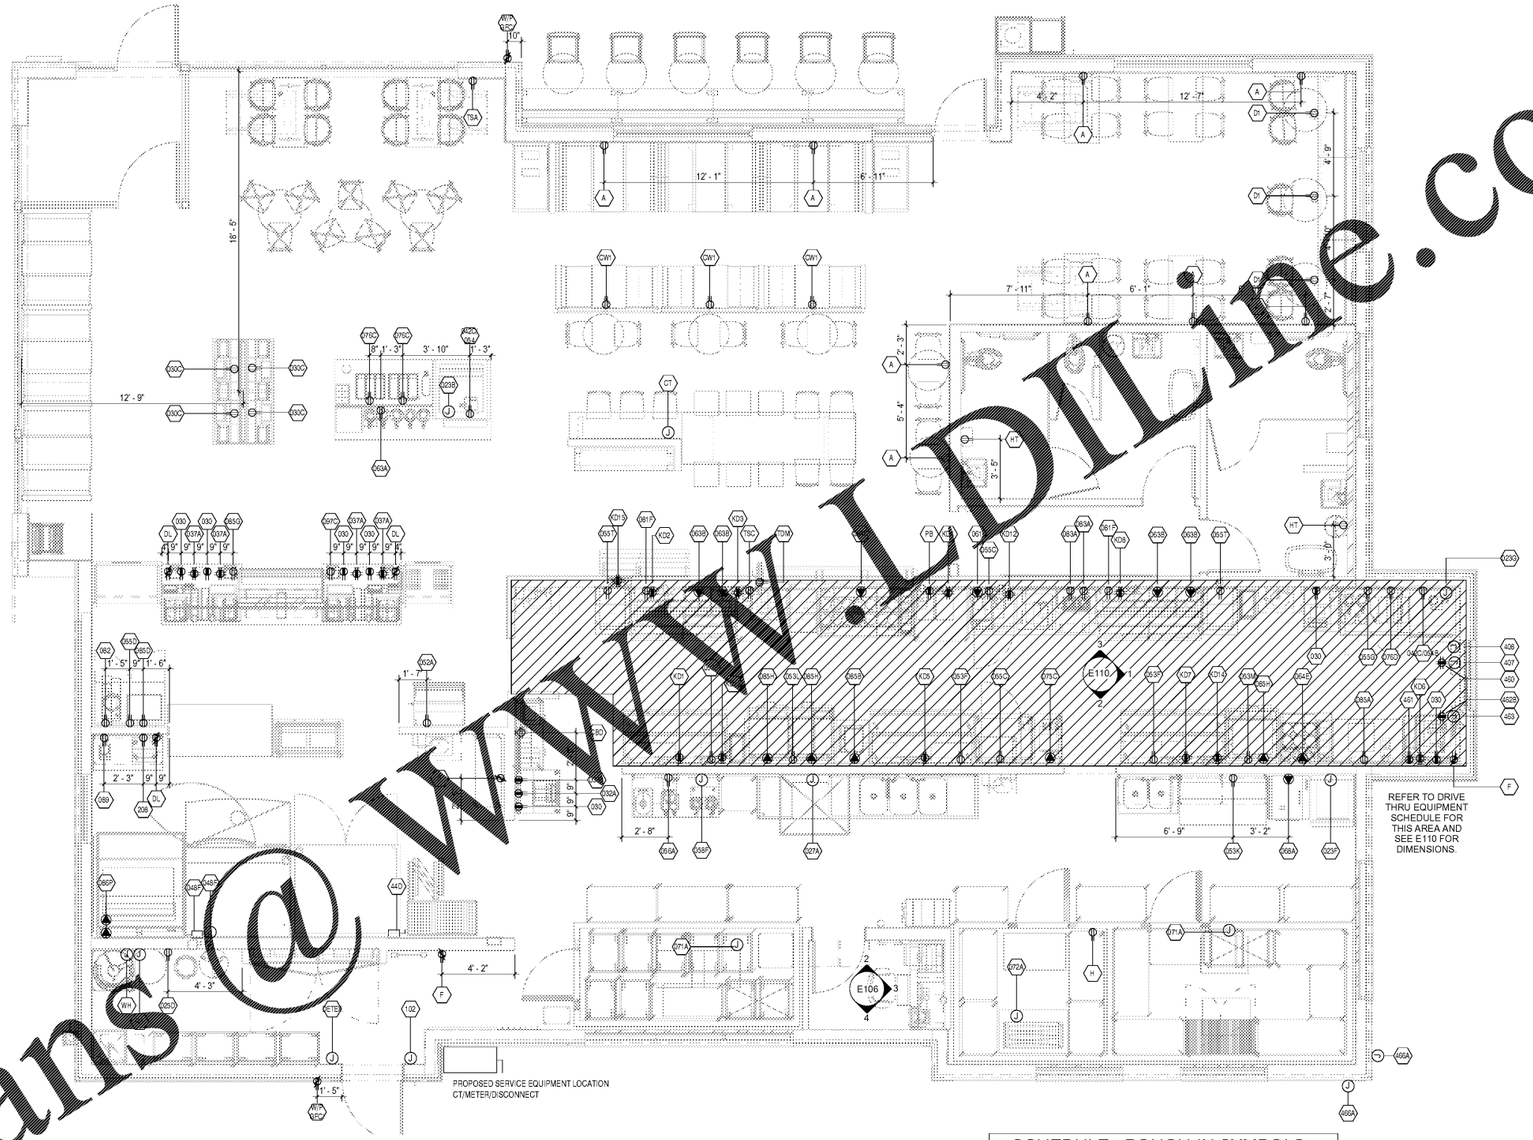


1 ELECTRICAL ROUGH-IN PLAN
1/4" = 1'-0"

NORTH

| SCHEDULE: ROUGH-IN SYMBOLS | |
|---|---|
| SYMBOL | DESCRIPTION |
| | DUPLEX RECEPTACLE |
| | QUADPLEX RECEPTACLE |
| | G.F.I. DUPLEX RECEPTACLE |
| | ISOLATED GROUND DUPLEX RECEPTACLE (HUBBELL IG5392CN ORANGE OR EQUAL) |
| | ISOLATED GROUND QUADPLEX RECEPTACLE |
| J | JUNCTION BOX |
| | DISCONNECT SWITCH |
| | HEAVY DUTY RECEPTACLE - VERIFY NEMA CONFIGURATION |
| | ROUGH-IN FOR TELEPHONE VOICE LINE UNLESS NOTED OTHERWISE |
| | ROUGH-IN FOR TELEPHONE DATA LINE OR DATACOM UNLESS NOTED OTHERWISE |
| | MOTOR CONNECTION |
| | SINGLE SECTION PANELBOARD |
| | BRANCH CIRCUIT WIRING CONCEALED ABOVE CEILING OR IN PARTITION |
| | CIRCUIT HOME RUN |

SEE SHEET E102 FOR ROUGH-IN EQUIPMENT SCHEDULE

SEE SHEET E106 FOR ROUGH-IN REQUIREMENTS AT OFFICE.

SEE SHEET E110 FOR DRIVE THRU KITCHEN EQUIPMENT DIMENSIONS.

Order Plans@WWLDLine.com

12/19/2018 2:28:58 PM

Bakery-Cafe:

# #6119

William J. Mercer, Inc.
353 Eagle Drive
St. Louis, MO 63119
Phone: (314) 962-7272
Fax: (314) 962-3454
Engineering Consultant

ISSUE FOR REVIEW

**Bakery Cafe #6119**

6351 MANATEE AVE. W,
BRADENTON, FL 34209

Panera BREAD

| NO. | DESCRIPTION | DATE |
|---|---|---|
| | | |

## ELECTRICAL ROUGH-IN PLAN

Project Number: 449-18
Sheet Number: E101
Drawn: CJS
Checked: NJD
Issue Date: 10/01/18
DPM: BS
DM: DM
CPM: ME