

- NOTES:**
- TOTAL AREA OF THE SITE = 1.296 ACRES
 - TOTAL DISTURBED AREA OF THE SITE = 1.4 ACRES
 - IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO OBTAIN QUALIFIED PROFESSIONAL ADVICE WHEN QUESTIONS ARISE CONCERNING DESIGN AND EFFECTIVENESS OF EROSION CONTROL DEVICES. 24 HR CONTACT: JACK JOHNSON, P.E. (770) 368-1399. CONTRACTOR SHALL INFORM ENGINEER WHEN CONSTRUCTION BEGINS.
 - SEE SHEETS C-4.2 THROUGH C-4.3 FOR EROSION CONTROL DETAILS TO BE INSTALLED.
 - REFER TO AND COMPLY WITH CITY OF GREER STANDARD NOTES ON SHEET G-2


- EROSION CONTROL NOTES:**
- SLOPES WHICH EXCEED EIGHT (8) VERTICAL FEET SHOULD BE STABILIZED WITH SYNTHETIC OR VEGETATIVE MATS, IN ADDITION TO HYDROSEEDING. IT MAY BE NECESSARY TO INSTALL TEMPORARY SLOPE DRAINS DURING CONSTRUCTION. TEMPORARY BERMS MAY BE NEEDED UNTIL THE SLOPE IS BUILT TO GRADE.
 - STABILIZATION MEASURES SHALL BE INITIATED AS SOON AS PRACTICABLE IN PORTIONS OF THE SITE WHERE CONSTRUCTION ACTIVITIES HAVE TEMPORARILY OR PERMANENTLY CEASED, BUT IN NO CASE MORE THAN FOURTEEN (14) DAYS AFTER WORK HAS CEASED, EXCEPT AS STATED BELOW.
 - WHERE STABILIZATION BY THE 14TH DAY IS PRECLUDED BY SNOW COVER OR FROZEN GROUND CONDITIONS STABILIZATION MEASURES MUST BE INITIATED AS SOON AS PRACTICABLE.
 - WHERE CONSTRUCTION ACTIVITY ON A PORTION OF THE SITE IS TEMPORARILY CEASED, AND EARTH-DISTURBING ACTIVITIES WILL BE RESUMED WITHIN 14 DAYS, TEMPORARY STABILIZATION MEASURES DO NOT HAVE TO BE INITIATED ON THAT PORTION OF THE SITE.
 - ALL SEDIMENT AND EROSION CONTROL DEVICES SHALL BE INSPECTED AT LEAST ONCE EVERY CALENDAR WEEK. IF PERIODIC INSPECTIONS OR OTHER INFORMATION INDICATES THAT A BMP HAS BEEN INAPPROPRIATELY OR INCORRECTLY INSTALLED, THE PERMITTEE MUST ADDRESS THE NECESSARY REPLACEMENT OR MODIFICATION REQUIRED TO CORRECT THE BMP WITHIN 48 HOURS OF IDENTIFICATION.
 - PROVIDE SILT FENCE AND/OR OTHER CONTROL DEVICES, AS MAY BE REQUIRED, TO CONTROL SOIL EROSION DURING UTILITY CONSTRUCTION. ALL DISTURBED AREAS SHALL BE CLEANED, GRADED AND STABILIZED IMMEDIATELY AFTER THE UTILITY INSTALLATION. FILL COVER AND TEMPORARY SEEDING AT THE END OF EACH DAY ARE RECOMMENDED. IF WATER IS ENCOUNTERED WHILE TRENCHING, THE WATER SHOULD BE FILTERED TO REMOVE ANY SEDIMENTS BEFORE BEING PUMPED BACK INTO ANY WATERS OF THE STATE.
 - ALL EROSION CONTROL DEVICES SHALL BE PROPERLY MAINTAINED DURING ALL PHASES OF CONSTRUCTION UNTIL THE COMPLETION OF ALL CONSTRUCTION ACTIVITIES AND ALL DISTURBED AREAS HAVE BEEN STABILIZED. ADDITIONAL CONTROL DEVICES MAY BE REQUIRED DURING CONSTRUCTION IN ORDER TO CONTROL EROSION AND/OR OFFSITE SEDIMENTATION. ALL TEMPORARY CONTROL DEVICES SHALL BE REMOVED ONCE CONSTRUCTION IS COMPLETE AND THE SITE IS STABILIZED.
 - THE CONTRACTOR MUST TAKE NECESSARY ACTION TO MINIMIZE THE TRACKING OF MUD ONTO PAVED ROADWAY(S) FROM CONSTRUCTION AREAS AND THE GENERATION OF DUST. THE CONTRACTOR SHALL DAILY REMOVE MUD/SOIL FROM PAVEMENT, AS MAY BE REQUIRED.
 - TEMPORARY DIVERSION BERMS AND/OR DITCHES WILL BE PROVIDED AS NEEDED DURING CONSTRUCTION TO PROTECT WORK AREAS FROM UPSLOPE RUNOFF AND/OR TO DIVERT SEDIMENT-LADEN WATER TO APPROPRIATE TRAPS OR STABLE OUTLETS.
 - ALL WATERS OF THE STATE (WOS), INCLUDING WETLANDS, ARE TO BE FLAGGED OR OTHERWISE CLEARLY MARKED IN THE FIELD. A DOUBLE ROW OF SILT FENCE IS TO BE INSTALLED IN ALL AREAS WHERE A 50-FOOT BUFFER CAN'T BE MAINTAINED BETWEEN THE LAST ROW OF SILT FENCE AND ALL WOS.
 - LITTER, CONSTRUCTION DEBRIS, OILS, FUELS, AND BUILDING PRODUCTS WITH SIGNIFICANT POTENTIAL FOR IMPACT (SUCH AS STOCK PILES OF FRESHLY TREATED LUMBER) AND CONSTRUCTION CHEMICALS THAT COULD BE EXPOSED TO STORM WATER MUST BE PREVENTED FROM BECOMING A POLLUTANT SOURCE IN STORM WATER DISCHARGES.
 - INITIATE STABILIZATION MEASURES ON ANY EXPOSED STEEP SLOPE (3H:1V OR GREATER) WHERE LAND-DISTURBING ACTIVITIES HAVE PERMANENTLY OR TEMPORARILY CEASED, AND WILL NOT RESUME FOR A PERIOD OF 7 CALENDAR DAYS.
 - MINIMIZE SOIL COMPACTION AND, UNLESS INFEASIBLE, PRESERVE TOPSOIL.
 - MINIMIZE THE DISCHARGE OF POLLUTANTS FROM EQUIPMENT AND VEHICLE WASHING, WHEEL WASH WATER, AND OTHER WASH WATERS. WASH WATERS MUST BE TREATED IN A SEDIMENT BASIN OR ALTERNATIVE CONTROL THAT PROVIDES EQUIVALENT OR BETTER TREATMENT PRIOR TO DISCHARGE.
 - MINIMIZE THE DISCHARGE OF POLLUTANTS FROM DEWATERING OF TRENCHES AND EXCAVATED AREAS. THESE DISCHARGES ARE TO BE ROUTED THROUGH APPROPRIATE BMPs (SEDIMENT BASINS, FILTER BAGS, ETC.).
 - THE FOLLOWING DISCHARGES FROM SITES ARE PROHIBITED:
 - WASTEWATER FROM WASHOUT OF CONCRETE, UNLESS MANAGED BY AN APPROPRIATE CONTROL.
 - WASTEWATER FROM WASHOUT AND CLEANOUT OF STUCCO, PAINT, FROM RELEASE OILS, CURING COMPOUNDS AND OTHER CONSTRUCTION MATERIALS.
 - FUELS, OILS, OR OTHER POLLUTANTS USED IN VEHICLE AND EQUIPMENT OPERATION AND MAINTENANCE; AND
 - SOAPS OR SOLVENTS USED IN VEHICLE AND EQUIPMENT WASHING.
 - AFTER CONSTRUCTION ACTIVITIES BEGIN, INSPECTIONS MUST BE CONDUCTED AT A MINIMUM OF AT LEAST ONCE EVERY CALENDAR WEEK AND MUST BE CONDUCTED UNTIL FINAL STABILIZATION IS REACHED ON ALL AREAS OF THE CONSTRUCTION SITE.
 - IF EXISTING BMPs NEED TO BE MODIFIED OR IF ADDITIONAL BMPs ARE NECESSARY TO COMPLY WITH THE REQUIREMENTS OF THIS PERMIT AND/OR SC'S WATER QUALITY STANDARDS, IMPLEMENTATION MUST BE COMPLETED BEFORE THE NEXT STORM EVENT WHENEVER PRACTICABLE. IF IMPLEMENTATION BEFORE THE NEXT STORM EVENT IS IMPRACTICABLE, THE SITUATION MUST BE DOCUMENTED IN THE SWPPP AND ALTERNATIVE BMPs MUST BE IMPLEMENTED AS SOON AS REASONABLY POSSIBLE.
 - A PRE-CONSTRUCTION CONFERENCE MUST BE HELD FOR EACH CONSTRUCTION SITE WITH AN APPROVED ON-SITE SWPPP PRIOR TO THE IMPLEMENTATION OF CONSTRUCTION ACTIVITIES. FOR NON-LINEAR PROJECTS THAT DISTURB TWO OR MORE ACRES, THIS CONFERENCE MUST BE HELD ON-SITE UNLESS THE DEPARTMENT HAS APPROVED OTHERWISE.
 - SILT FENCING MUST BE WIRE BACKED.

EROSION AND SEDIMENT CONTROL LEGEND			
CODE	PRACTICE	DETAIL	MAP SYMBOL
CO	STABILIZED CONSTRUCTION EXIT		Co
RD	ROCK FILTER DAM		Rd
SF	SEDIMENT BARRIER		SF
TS	TEMPORARY SEEDING		TS
PS	PERMANENT SEEDING		PS
M	MULCHING		M
DC	DUST CONTROL		DC
SS	SLOPE STABILIZATION		SS
IPF	INLET PROTECTION		IPF
IPD	INLET PROTECTION		IPD
	LIMITS OF DISTURBANCE	N/A	---
	SOIL DELINEATION LINE	N/A	-----

SOIL TYPE	
Ca	CARTECAY AND CHEWACLA SOILS
CeB	CECL SANDY LOAM, 2 TO 6 PERCENT SLOPES
McC	MADISON SANDY LOAM, 6 TO 10 PERCENT SLOPES
PcE	PACOLET SANDY LOAM, 15 TO 25 PERCENT SLOPES

- CONSTRUCTION SEQUENCE:**
- RECEIVE NPDES COVERAGE FROM SOUTH CAROLINA DEPARTMENT OF HEALTH AND ENVIRONMENTAL CONTROL (DHEC).
 - CONTRACTOR SHALL NOTIFY DHEC EOC REGIONAL OFFICE OR OCRM OFFICE 48 HOURS PRIOR TO BEGINNING LAND-DISTURBING ACTIVITIES.
 - INSTALLATION OF CONSTRUCTION ENTRANCES(S).
 - CLEARING AND GRUBBING ONLY AS NECESSARY FOR INSTALLATION OF PERIMETER CONTROLS.
 - INSTALLATION OF PERIMETER CONTROLS (E.G., SILT FENCE).
 - CLEARING AND GRUBBING OF SITE OR DEMOLITION (SEDIMENT AND EROSION CONTROL MEASURES FOR THESE AREAS MUST ALREADY BE INSTALLED).
 - CONSTRUCTION OF SEDIMENT TRAP. CONTACT CITY OF GREER STORMWATER INSPECTOR AFTER COMPLETION OF THE SEDIMENT TRAP. CITY INSPECTOR TO APPROVE TRAP AND PERIMETER CONTROLS ARE INSTALLED PRIOR TO STARTING ROUGH GRADING.
 - ROUGH GRADING.
 - INSTALLATION OF STORM DRAINAGE, AND INLET PROTECTION MEASURES.
 - FINE GRADING, PAVING, ETC.
 - PERMANENT/FINAL STABILIZATION.
 - CONTRACTOR TO SCHEDULE CLOSEOUT INSPECTION WITH CITY OF GREER STORMWATER INSPECTOR PRIOR TO REMOVING TEMPORARY BMPs.
 - REMOVAL OF TEMPORARY SEDIMENT AND EROSION CONTROL MEASURES AFTER ENTIRE AREA DRAINING TO THE STRUCTURE IS FINALLY STABILIZED (THE DEPARTMENT RECOMMENDS THAT THE PROJECT OWNER/OPERATOR HAVE THE SWPPP PREPARED OR REGISTRATION EQUIVALENT APPROVE THE REMOVAL OF TEMPORARY STRUCTURES).
 - SUBMIT NOTICE OF TERMINATION (NOT) TO DHEC AS APPROPRIATE.

NOTE: MAINTENANCE OF SEDIMENT AND EROSION CONTROL MEASURES MUST CONTINUE UNTIL THE SITE IS PERMANENTLY STABILIZED AND THE CONTROLS ARE REMOVED.

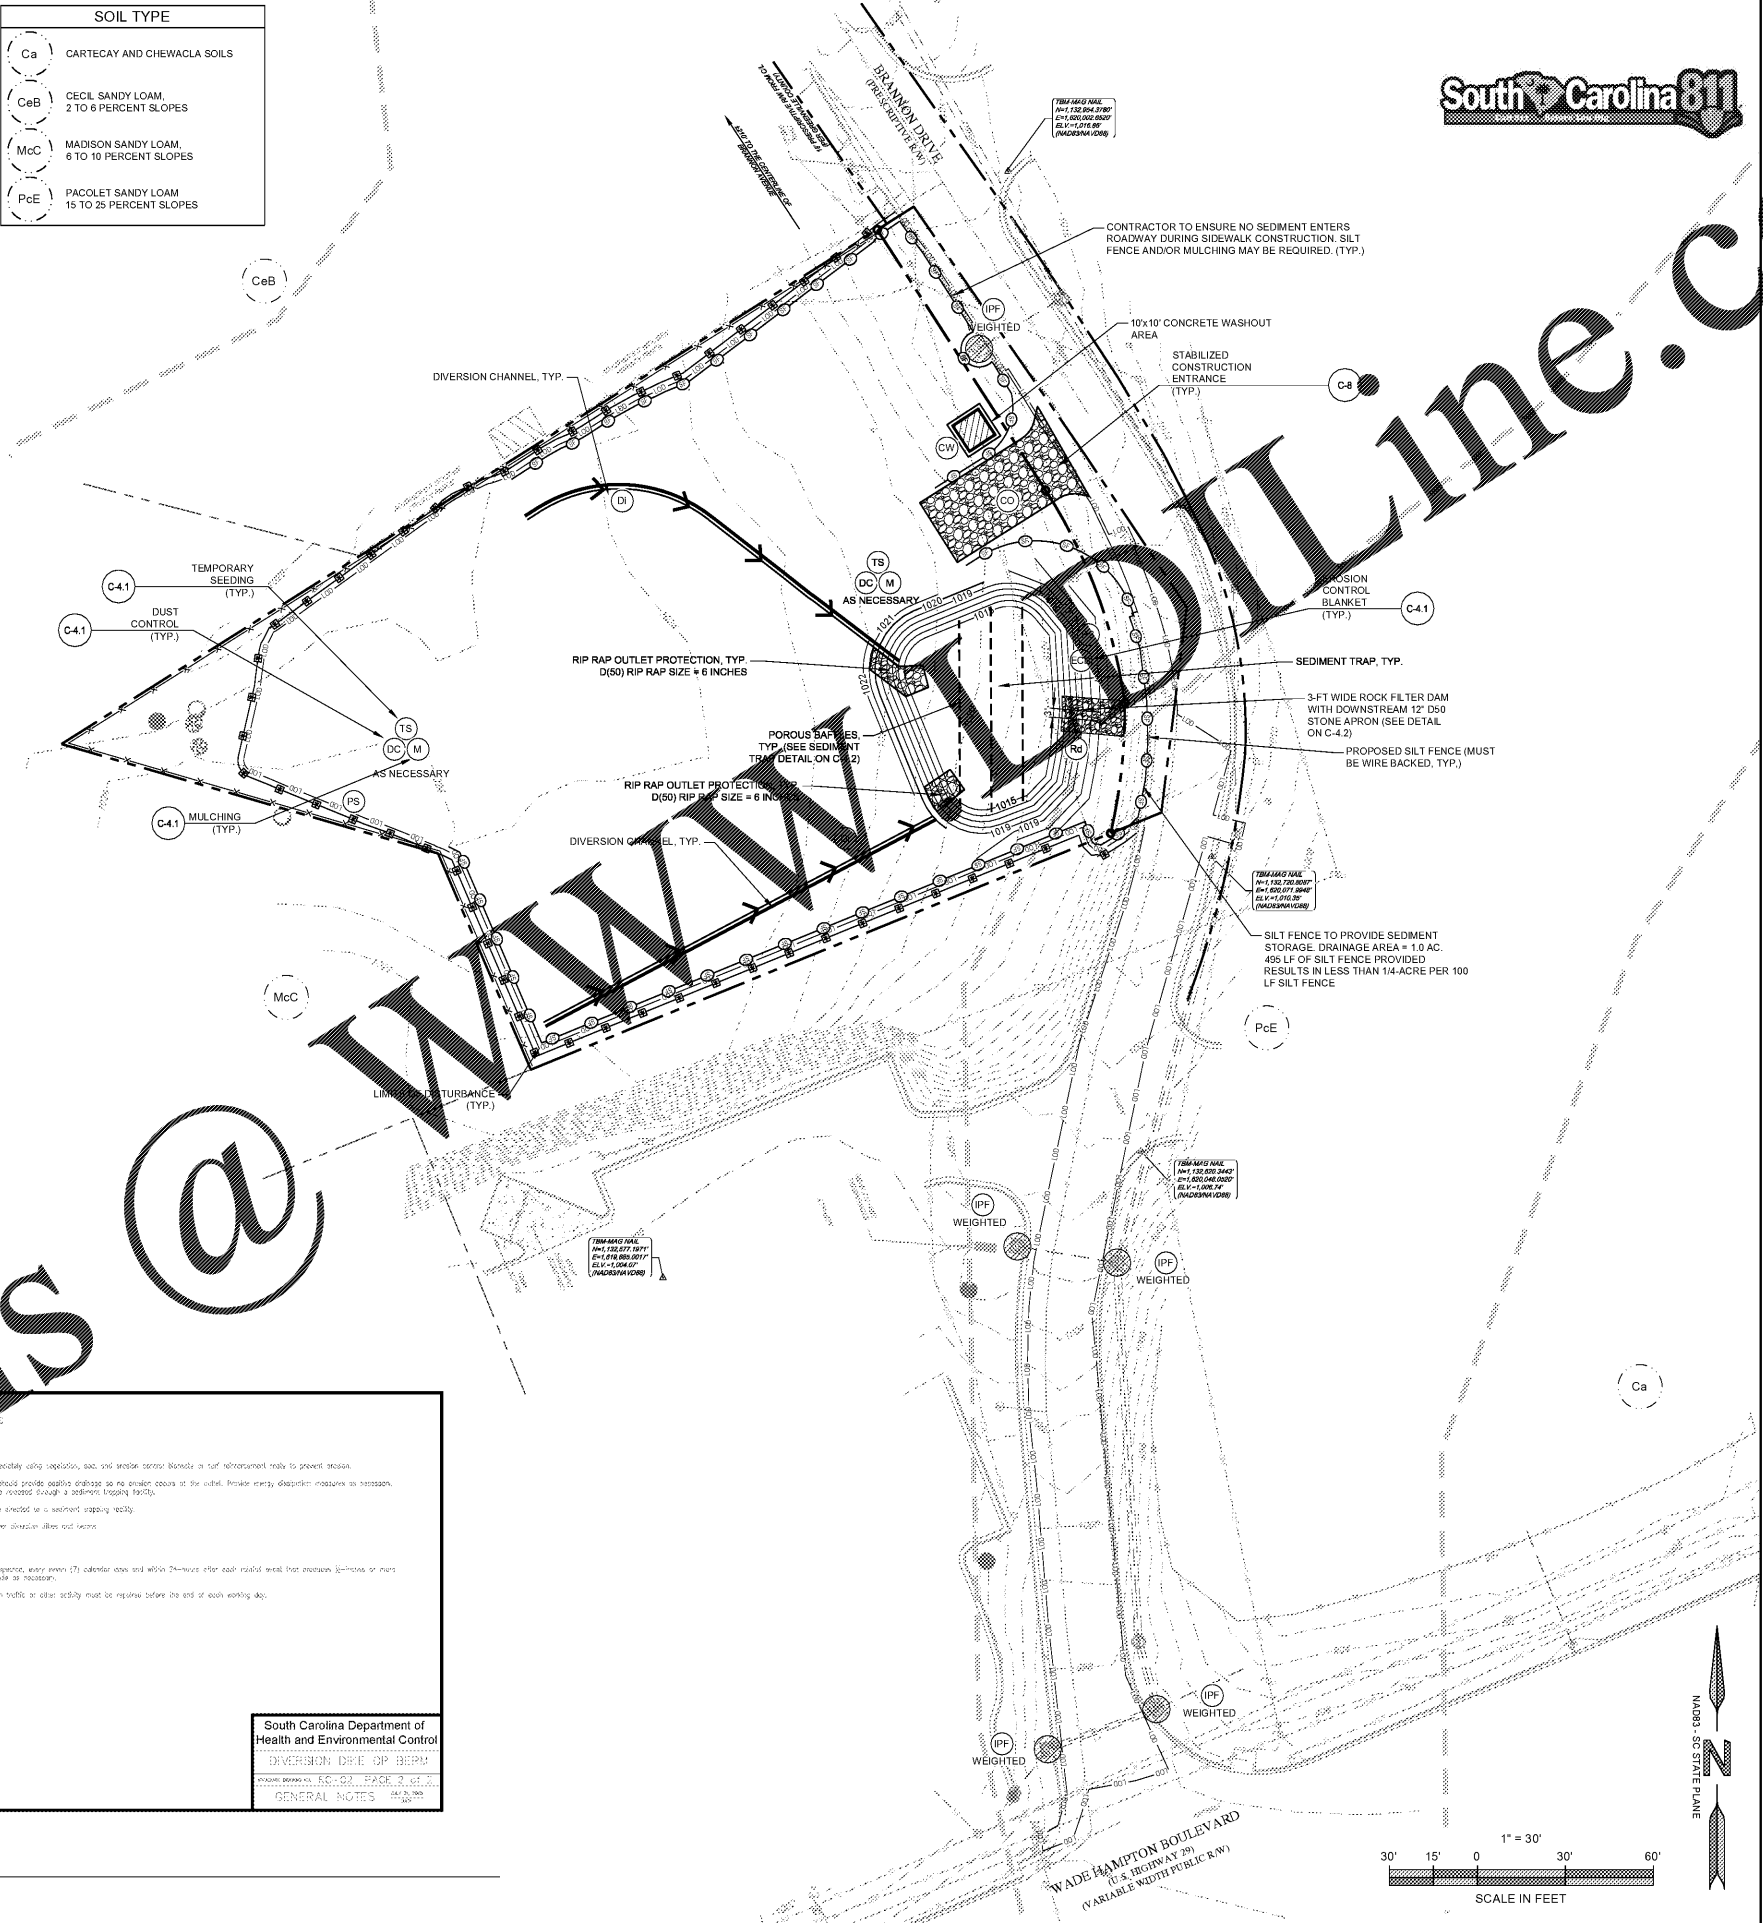

ENGINEER

FORESITE GROUP

Foresite Group, Inc. | www.foresitegroup.com
 3740 B... Ct. | Phone: 770.368.1399
 Suite 100 | Fax: 770.368.1944
 Three Chert Hills, GA 30084

INTER

TIRES • SERVICE • BRAKES • BATTERIES

107-111 BRANNON DRIVE
 GREER, SC 29651

PARCEL # T015000300300 & T015000300301.

SEAL

JOHN C. BRANNON
 PROFESSIONAL ENGINEER
 No. 34332
 11/5/18

REVISIONS	DATE
JURISDICTIONAL COMMENTS	2018-11-02
JURISDICTIONAL COMMENTS	2018-11-09
JURISDICTIONAL COMMENTS	2018-11-14
JURISDICTIONAL COMMENTS	2018-11-19
JURISDICTIONAL COMMENTS	2018-11-28

PROJECT MANAGER:	JMJ
DRAWING BY:	JAM
JURISDICTION:	GREER, SC
DATE:	2018-09-21
SCALE:	1" = 20'
TITLE:	

INITIAL EROSION, SEDIMENTATION, & POLLUTION CONTROL PLAN

SHEET NUMBER: **C-4.0**

COMMENTS: PERMIT SET

JOB/FILE NUMBER: 814.026

Order Plans @

PLAN SYMBOL

South Carolina Department of Health and Environmental Control

CONSTRUCTION ENTRANCE

NOT TO SCALE

South Carolina Department of Health and Environmental Control

GENERAL NOTES

CO C-4.2 STABILIZED CONSTRUCTION EXIT

NOT TO SCALE

