


1 BUILDINGS 4 & 7 GROUND LEVEL - ELECTRICAL PLANS  
 E-7.1 SCALE: 1/8" = 1'-0"

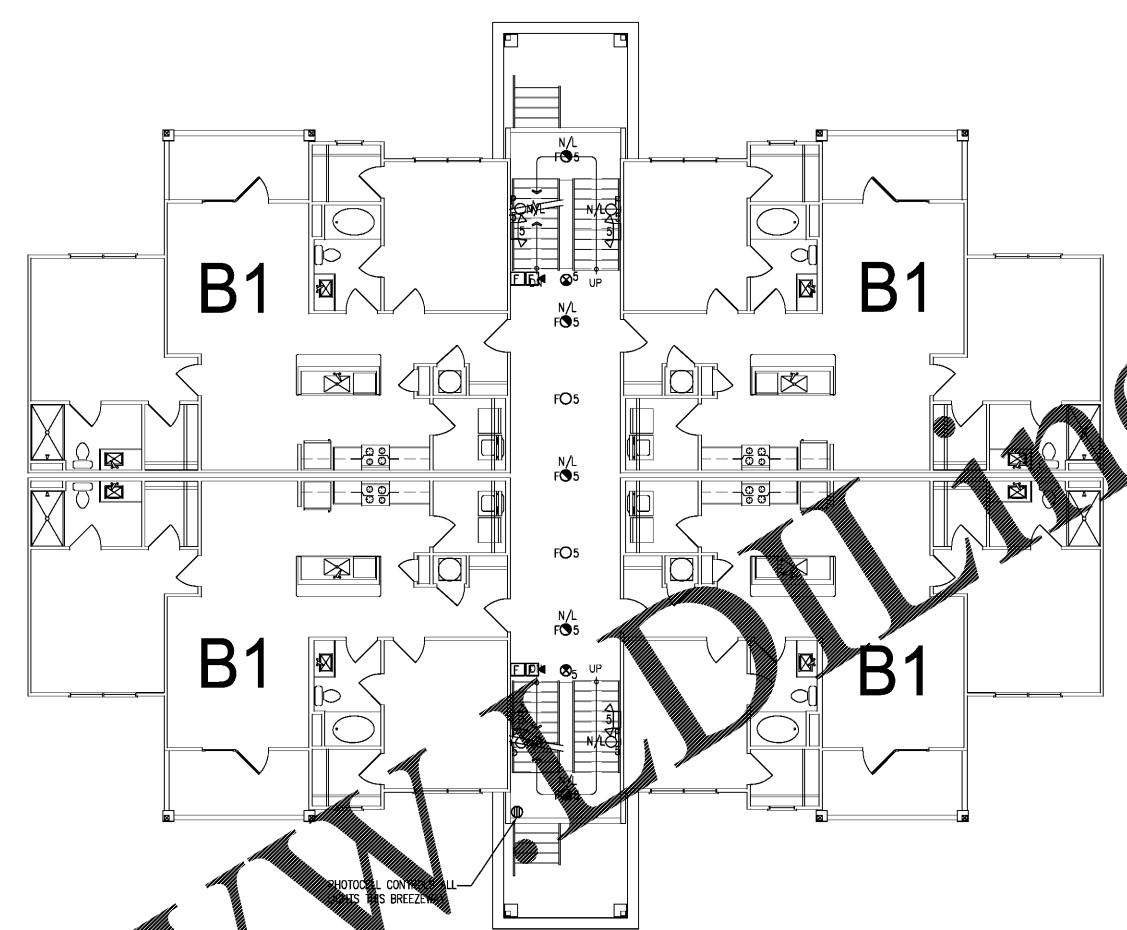

2 BUILDINGS 4 & 7 SECOND LEVEL - ELECTRICAL PLANS  
 E-7.1 SCALE: 1/8" = 1'-0"

Order Plans @

WWW.DLINE.COM



ENGLISH & ASSOCIATES  
 ARCHITECTS, INC.  
 3084 MERCER UNIVERSITY DRIVE, SUITE 100  
 ATLANTA, GEORGIA 30341  
 DENGUSH@ENGLISHASSOCIATESINC.COM

JOB PROGRESS:  
 ITEM: DATE:

REVISIONS:  
 TAG: DATE:

This drawing, as an instrument of service, is and shall remain the property of the Architect. It shall not be reproduced or used in any way without the written permission of the Architect. All questions to be submitted as a formal request for information to the Architect Of Record.

- BUILDING PLAN NOTES:
- 1 BUILDING SERVICE LOCATION. SEE RISER DIAGRAM. PROVIDE PERMANENT PNEUMATIC LABELS AT EACH METER INDICATING UNIT NUMBER. COORDINATE REQUIRED HEIGHT OF LETTERS WITH UTILITY AND FIRE DEPARTMENT.
  - 2 HOUSE PANEL LOCATION.
  - 3 CONDENSER UNIT LOCATIONS. REFER TO PANEL SCHEDULES AND MECHANICAL EQUIPMENT SCHEDULE FOR ELECTRICAL REQUIREMENTS. PROVIDE A DISCONNECT ADJACENT TO EACH UNIT WITH AT LEAST 3'-0" OF CLEARANCE IN FRONT.
  - 4 PROVIDE FIRE ALARM CONNECTION TO TAMPER AND FLOW SWITCHES. COORDINATE QUANTITY AND LOCATION WITH FIRE SPRINKLER CONTRACTOR.
  - 5 COORDINATE FACP LOCATION WITH FIRE MARSHAL. THE FIRE ALARM SYSTEM SHALL BE DESIGNED BY THE FIRE ALARM CONTRACTOR AND THE DRAWINGS SHALL BE SEALED BY A PROFESSIONAL ENGINEER. ALL FIRE ALARM SYSTEMS SHALL REPORT TO THE MAIN SYSTEM IN THE LEASING OFFICE VIA WIRELESS CONNECTION. THERE SHALL BE NO FIRE ALARM CABLING INSTALLED UNDERGROUND. PROVIDE SURGE AND LIGHTNING PROTECTION ON EVERY FACP.
  - 6 PROVIDE (1) 2" CONDUIT FOR TELEPHONE AND (1) 2" CONDUIT FOR CATV TO UTILITY LOCATION. PROVIDE PULL STRING IN EACH CONDUIT. COORDINATE LOCATIONS OF CONDUIT WITH SERVICE PROVIDERS.

ALEXANDRIA  
 AN APARTMENT COMMUNITY  
 FOR  
 Bobo Family Group  
 HUNTSVILLE, ALABAMA

JOB NUMBER:  
 DRAWN BY:  
 CHECKED BY:  
 BUILDINGS 4 & 7  
 GROUND & SECOND LEVEL  
 ELECTRICAL PLANS  
 SHEET NO.

E-7.1