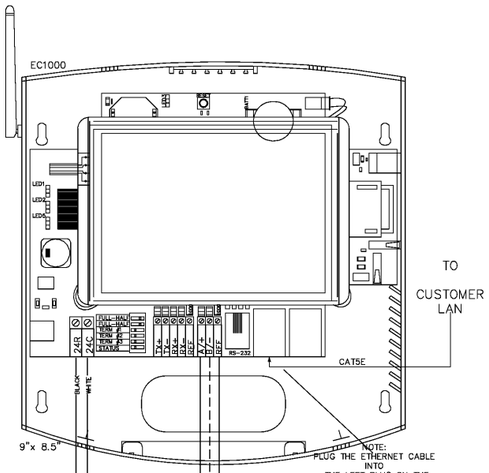

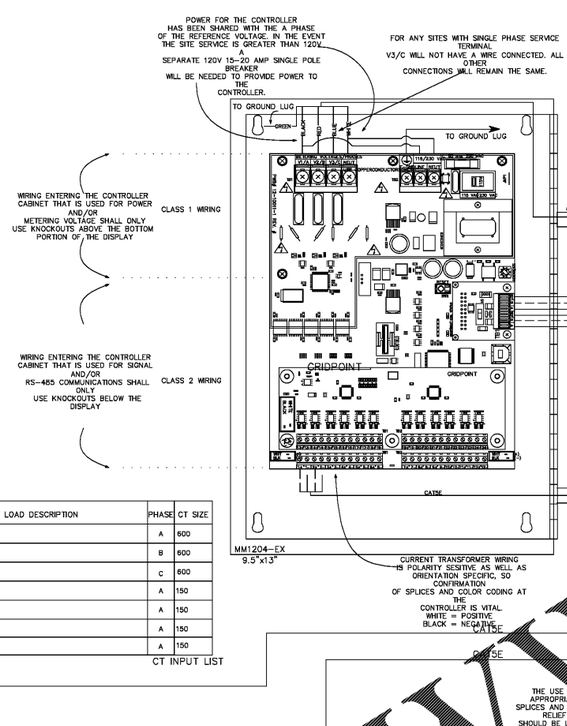

INPUT	LOAD DESCRIPTION	PHASE	CT SIZE
1	MAIN	A	600
2	MAIN	B	600
3	MAIN	C	600
4	RTU	A	150
5	RTU	A	150
6	RTU	A	150
7	ADDITIONAL RTUs	A	150

CT INPUT LIST

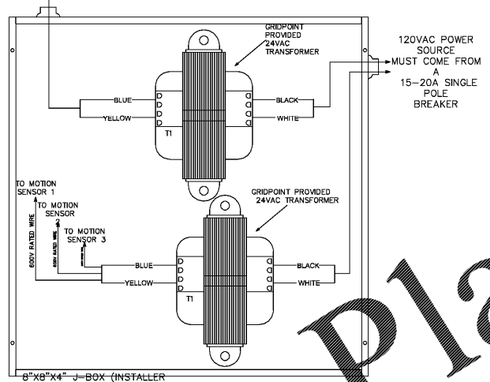

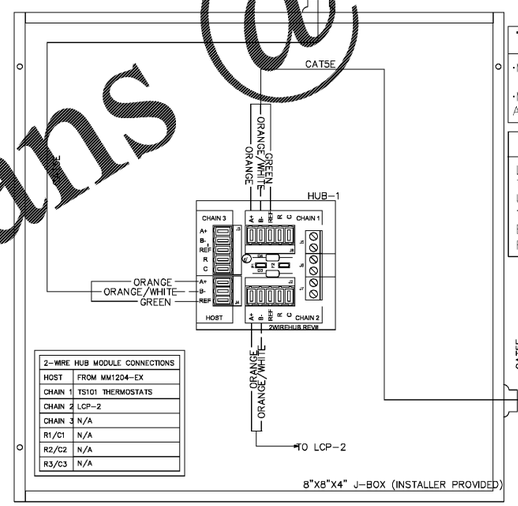

2-WIRE HUB MODULE CONNECTIONS	
HOST	FROM MM1204-EX
CHAIN 1	TS101 THERMOSTATS
CHAIN 2	LCP-2
CHAIN 3	N/A
R1/C1	N/A
R2/C2	N/A
R3/C3	N/A

T-STAT/SENSOR MOUNTING

- MOUNT SHOWROOM'S T-STATS AND SENSORS AT 7'-3" ABOVE FINISHED FLOOR.
- MOUNT HARD PARTS T-STATS AND SENSORS AT 5'-6" ABOVE FINISHED FLOOR.

THERMOSTAT LABELING

LABEL EACH THERMOSTAT PER O'REILLY TERMINOLOGY WITH EXACTLY THE SAME UNIQUE IDENTIFYING "CODE" AS SHOWN ON THE "HVAC PLAN" ON SHEET M1 (FOR EXAMPLE: RTU-1, RTU-2, ETC. OR FURN-1, FURN-2, ETC.)

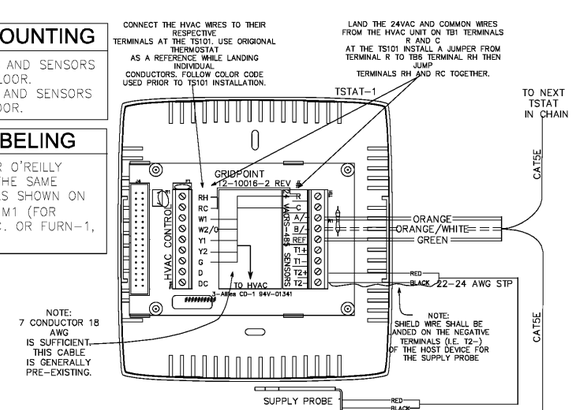

10-08-18

SHEET CHANGED IN ITS ENTIRETY.

O'REILLY PREFERRED ONE LINE DIAGRAM

5305 VALLEY PARK DRIVE SUITE # ROAN, VA - 24019

GRIDPOINT CONTACT

PLEASE CONTACT GRIDPOINT INSTALLATION MANAGEMENT @ 866-800-8906 FOR INSTALLATION CONTACT BASED ON THE STORE LOCATION.
EMAIL: SUPPORT@GRIDPOINT.COM

PRINTS ARE FOR: [X] DESIGN [ ] REVIEW [ ] PERMIT [X] BIDDING [ ] CONSTRUCTION

REVISIONS

DESCRIPTION:	DATE:	BY:

CONFIDENTIAL AND PROPRIETARY

SHEET TITLE:
FULL SYSTEM MINUS LIGHTING/MOTION SENSORS

FILE NAME:
O'REILLY PREFERRED ONE LINE DIAGRAM

DATE: 9/27/2018 | DRAWN BY: DAVID COLWELL

SHEET NO:
EM 1.0

ESTERLY SCHNEIDER & ASSOCIATES, INC. AIA
architects & planners AIAC
1736 East Sunshine, Suite 417
Springfield, Missouri 65804
417.862.0636
Fax: 417.862.3265
e-mail: architect@esterlyschneider.com

DESIGN BY OTHERS - FOR REFERENCE ONLY

PROJECT:
NEW O'REILLY AUTO PARTS STORE
U.S. HWY 231
MURFREESBORO, TN #5
GRIDPOINT EMS

O'Reilly AUTO PARTS
CORPORATE OFFICES
233 SOUTH PATTERSON
SPRINGFIELD, MISSOURI 65802
(417) 862-2674 TELEPHONE

COMM #	4219
DATE:	08-17-18
REVISION DATE:	10-08-18

© COPYRIGHT 2018-2019 - DESIGNS, DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF SERVICE AND ARE THE PROPERTY OF THE DESIGN PROFESSIONAL. REPRODUCTION PROHIBITED WITHOUT THE EXPRESSED WRITTEN CONSENT OF THE DESIGN PROFESSIONAL.

Order Plans @ WWW.DLine.com