


GENERAL LIGHTING NEW NOTES:


- A. REMOVE EXISTING SWITCHES AND FACEPLATES. PROVIDE ALL NEW DEVICES AND FACEPLATES. CONFORM WIRING TO MEET OPERATION SHOWN ON NEW WORK PLAN.
- B. REMOVE EXISTING EXIT SIGNS AND EGRESS LIGHT FIXTURES AND REPLACE. CONFORM WIRING TO MEET OPERATION SHOWN ON NEW WORK PLAN.
- C. LIGHT FIXTURES TO BE REPLACED IN AREAS SHOWN. REPLACE FIXTURE AND FIXTURE WHIP TO JUNCTION BOX FOR FIXTURES IN LAY-IN CEILINGS. PROVIDE ADDITIONAL RACEWAY AND CONDUCTORS AS REQUIRED FOR NEW OCCUPANCY SENSORS, BATTERY UNITS BUILT IN FIXTURES AND NEW DIMMERS IN CLASSROOMS.
- D. PROVIDE UNSWITCHED HOT TO NEW EGRESS FIXTURES FROM CIRCUIT SERVING LIGHTS IN THE AREA TO POWER INTEGRAL BATTERY BALLAST.

KEYED NOTES: (THIS SHEET ONLY)

- ▽ REPLACE SWITCH WITH 0-10V DIMMER. PROVIDE ADDITIONAL CONDUCTORS AS REQUIRED.

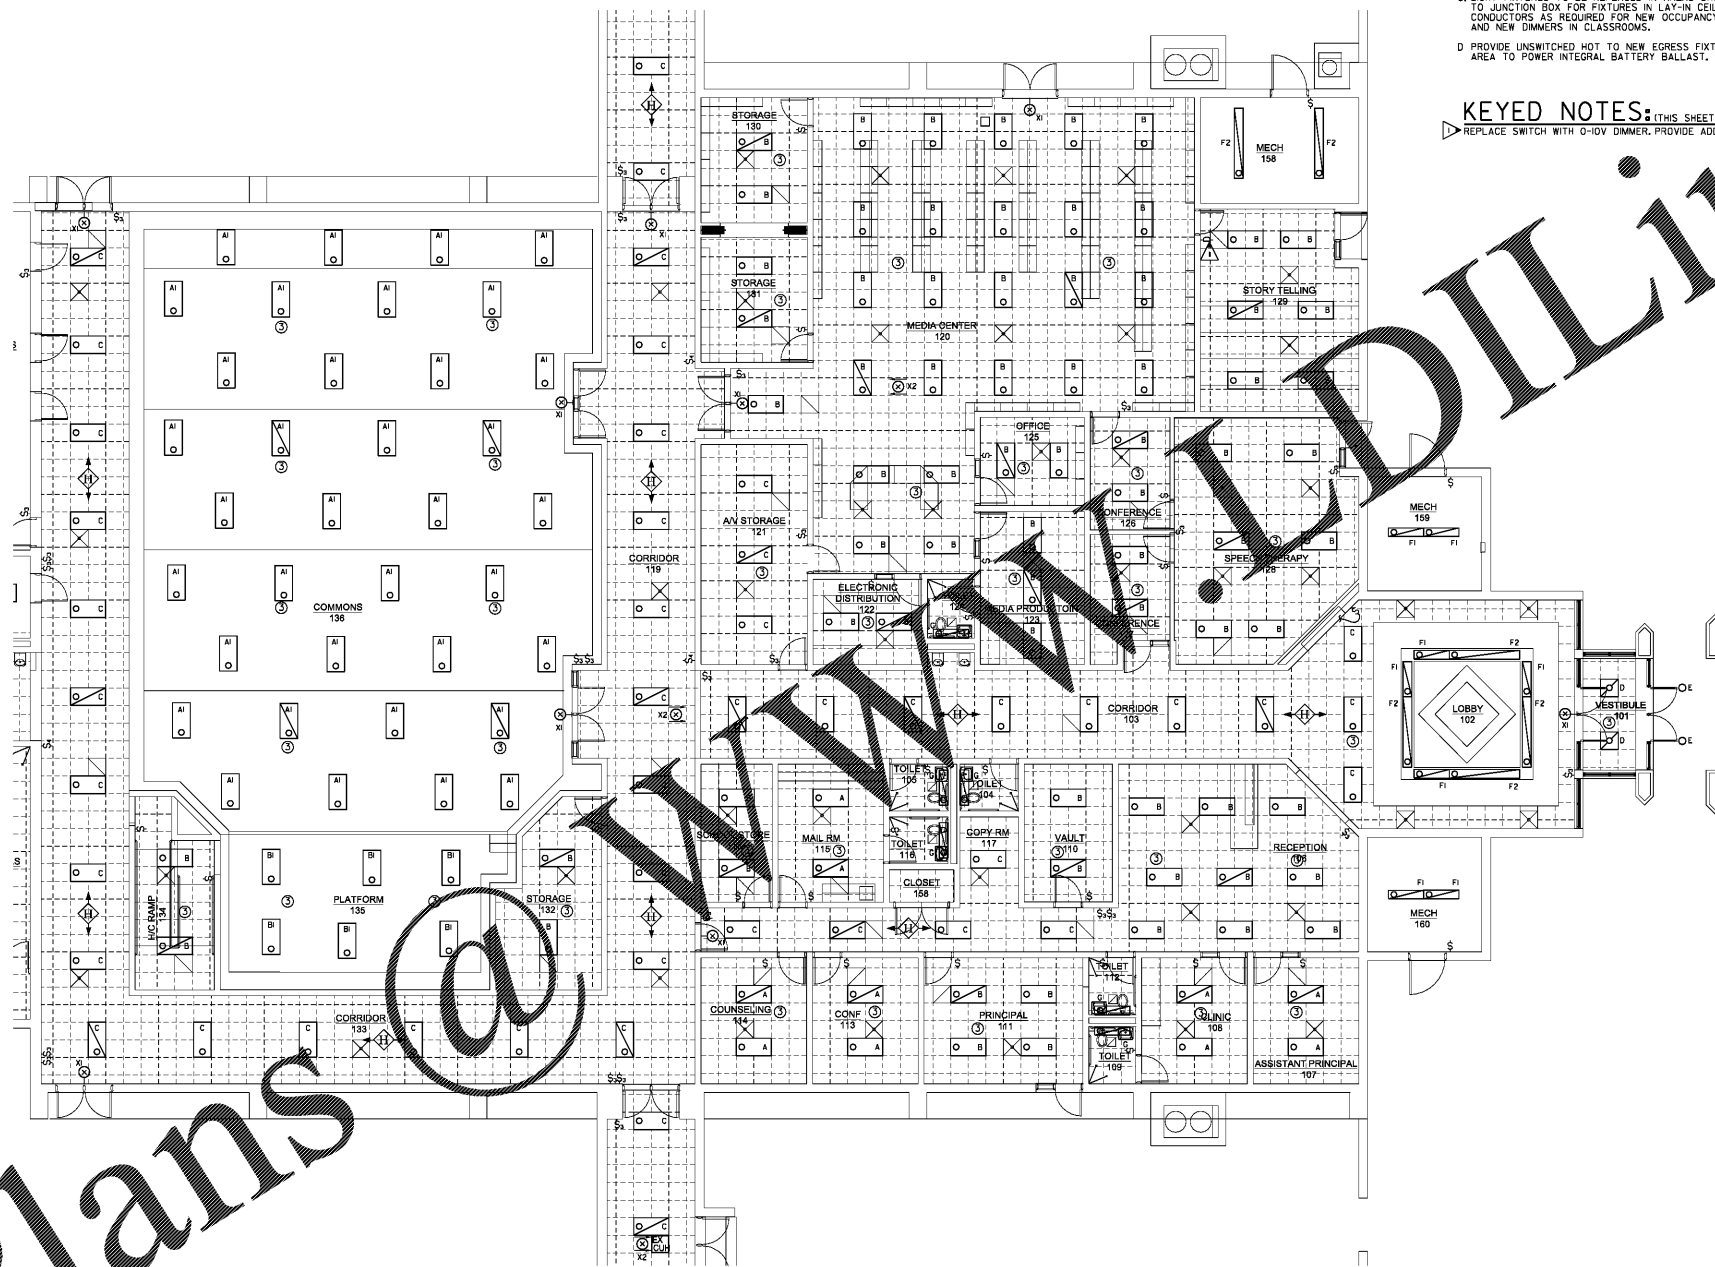

1 FLOOR PLAN WING A - LIGHTING  
E2.1 SCALE: 1/8"=1'-0"

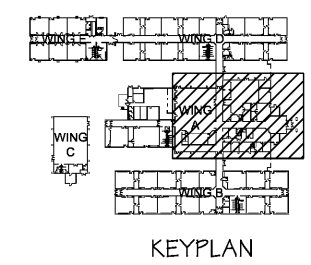

HVAC & LIGHTING REPLACEMENT AT  
**KINGSTON ELEMENTARY SCHOOL**  
 240 HARDIN BRIDGE ROAD  
 KINGSTON, GEORGIA 30145  
 FOR THE BARTOW COUNTY SCHOOL SYSTEM, DR. PHILLIP PAGE, SUPERINTENDENT  
 CARTERSVILLE, GEORGIA



THESE DOCUMENTS, AS INSTRUMENTS OF SERVICE, REMAIN THE PROPERTY OF THE ARCHITECT AND NO PART THEREOF MAY BE USED OR REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION

NO.	REVISIONS	DATE

CONSTRUCTION DOCUMENT:

FLOOR PLAN WING A - LIGHTING

SHEET  
**E2.1**  
 19 OF 30

FILE: 18.10  
 DATE: 12/14/18

Order Plans @ [www.DLine.com](http://www.DLine.com)