

DEMOLITION NOTES:

- ① REMOVE EXISTING HORIZONTAL FAN COIL UNIT AND ALL ASSOCIATED CONTROLS AND WIRING. DISCONNECT ALL EXISTING PIPING AND DUCTWORK. SEE DETAIL 1, SHEET M402 FOR DISCONNECTION POINTS OF PIPING AND DUCTWORK.
- ② REMOVE EXISTING ROOF MOUNTED EXHAUST FAN AND EXISTING ROOF CURB. DISCONNECT ALL ASSOCIATED DUCT, CONTROLS, AND WIRING. SEE DETAIL 2, SHEET M402 FOR DISCONNECTION POINTS OF DUCTWORK.



FULTON COUNTY SCHOOL SYSTEM
**RIVER EVES ELEMENTARY SCHOOL -
 RENOVATION**
 8000 EVES ROAD
 ROSWELL, GA 30076




PROJECT NO:	18046.00
50% CD'S	08/07/2018
PERMIT SET	08/20/2018
95% CD'S	11/08/2018
BID SET	2/03/2018



CONTRACT DOCUMENT
 ISSUED FOR
 CONSTRUCTION

SHEET TITLE
**MECHANICAL
 DUCTWORK PLAN -
 SECTION B -
 DEMOLITION**

SHEET NUMBER
MD101B

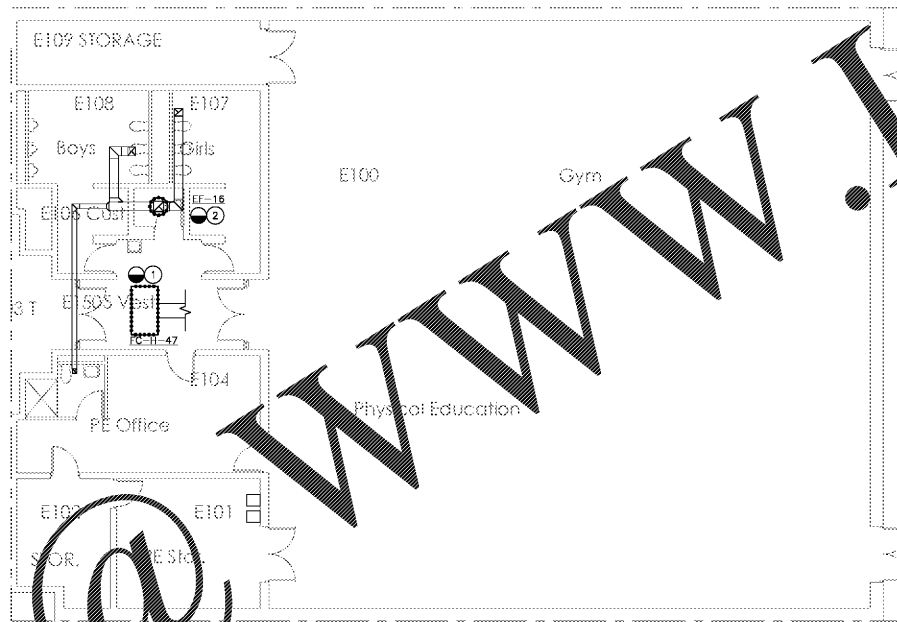

Order Plans @ WWW.LDILine.com

WWW.LDILine.com