GENERAL NOTES:

1. CONTRACTOR SHALL FIELD VERIFY EXACT CIRCUITS SERVING EXISTING MECHANICAL EQUIPMENT.
2. COORDINATE SAFETY SWITCH, MANUAL MOTOR STARTER AND OTHER WIRING DEVICES WITH FIELD CONDITIONS. INSTALL DISCONNECTING MEANS AS CLOSE TO EQUIPMENT AS POSSIBLE. DISCONNECTS SERVING ABOVE CEILING EQUIPMENT SHALL BE INSTALLED ABOVE CEILING.

DRAWING NOTES:

1. CONNECT NEW FAN COIL UNIT TO EXISTING CIRCUIT. PROVIDE SAFETY SWITCH AS INDICATED.
2. CONNECT NEW ROOF MOUNTED EXHAUST FAN TO EXISTING CIRCUIT. PROVIDE NEW MANUAL MOTOR STARTER SWITCH AS INDICATED.

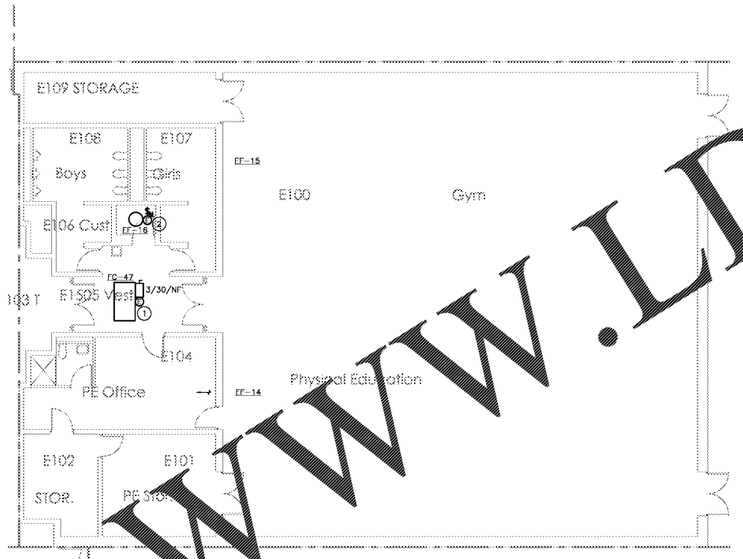

ELECTRICAL POWER PLAN – SECTION B

SCALE: 1/8" = 1'-0"

Order Plans @ WWW.LDILine.com

CDH
Road
A 30060-69
770.42
www.cd
COPYRIGHT © 20 CDH PARTNERS, INC.
ALL RIGHTS RESERVED

FULTON COUNTY SCHOOL SYSTEM

RIVER EVES ELEMENTARY SCHOOL - RENOVATION

9000 EVES ROAD
ROSWELL, GA 30076

PROJECT NO: 18046.00

	50% CD'S	08/07/2018
	PERMIT SET	09/20/2018
	95% CD'S	11/08/2018
	BID SET	12/03/2018

GEORGIA REGISTERED PROFESSIONAL ENGINEER
No. PE044507
JASON ALAN GREER

CONTRACT DOCUMENT
ISSUED FOR
CONSTRUCTION

SHEET TITLE
ELECTRICAL POWER PLAN - SECTION B

SHEET NUMBER
E101B

KEY PLAN



GRAPHIC SCALE
8 4 0 8 16
SCALE: 1/8"=1'-0"
UNIT OF MEASURE: FEET