


Written dimensions on these drawings shall have precedence over scaled dimensions. Contractor shall verify and be responsible for all dimensions and conditions on the job. harris + smith Architecture must be notified immediately in writing of any variation from the dimensions and conditions shown on these drawings. Field verify all conditions prior to laying out or fabricating. Show all field conditions on drawings. harris + smith Architecture reserves the right to modify drawings without notice. harris + smith Architecture, Inc. expressly reserves its common law copyright and other property rights in these documents. These documents are not to be reproduced, changed, or copied in any form or by any means, electronic or mechanical, including photocopying, recording, or by any information storage and retrieval system, without the prior written permission and written consent of harris + smith Architecture, Inc. In the event of unauthorized use of these documents by a third party, the third party shall hold harris + smith Architecture harmless and agrees to remunerate harris + smith Architecture in an amount equal to the original fee for the original documents, plus legal fees, court costs, collection fees and other costs.

- FIRE PROTECTION NOTES**
- EQUIPMENT AND MATERIALS USED AND WORK PERFORMED SHALL BE IN ACCORDANCE WITH THE LATEST RULES AND REGULATIONS OF THE FOLLOWING: (A) NFPA-13 (B) LOCAL AND STATE REGULATIONS
 - COORDINATE SPRINKLER PIPING AND HEAD LOCATIONS WITH DUCTWORK AND LIGHTING FIXTURES. DUCTWORK HAS RIGHT OF WAY.
 - CONTRACTOR SHALL PROVIDE SHOP DRAWINGS AND HYDRAULIC CALCULATIONS FOR ENGINEER REVIEW.
 - APPROVAL OF THE COMPLETE SYSTEM SHALL BE OBTAINED FROM THE AUTHORITIES HAVING JURISDICTION, AND A COPY OF SAME SHALL BE DELIVERED TO THE OWNER.
 - SUBMIT TO THE ENGINEER FOR APPROVAL, (3) COPIES OF HYDRAULIC CALCULATIONS, SHOP DRAWINGS AND DETAILS SHOWING MAINS, RISERS AND DRAINS, RUNS, BRANCHES, VALVES, ALARMS, ETC., FOR THE COMPLETE FIRE PROTECTION SYSTEM. ALSO SUBMIT FOR APPROVAL THE MANUFACTURER'S NAME, FIGURE NUMBERS, OR OTHER MEANS OF IDENTIFICATION OF ALL PIPE FITTINGS, VALVES, SPRINKLERS AND OTHER MATERIALS REQUIRED FOR INSTALLATION OF THE WORK.
 - COORDINATE FINAL LOCATION OF SPRINKLER HEADS WITH ARCHITECTURAL DRAWINGS.
 - ALL SPRINKLER LINES SHALL AVOID INTERFERENCE WITH LIGHTING FIXTURES, DUCTS AND PIPING.
 - SPRINKLER HEADS SHALL BE LOCATED IN THE CENTER OF CEILING TILES.
 - SEE DRAWING FP0.1.1 FOR FIRE PROTECTION SCHEDULE.

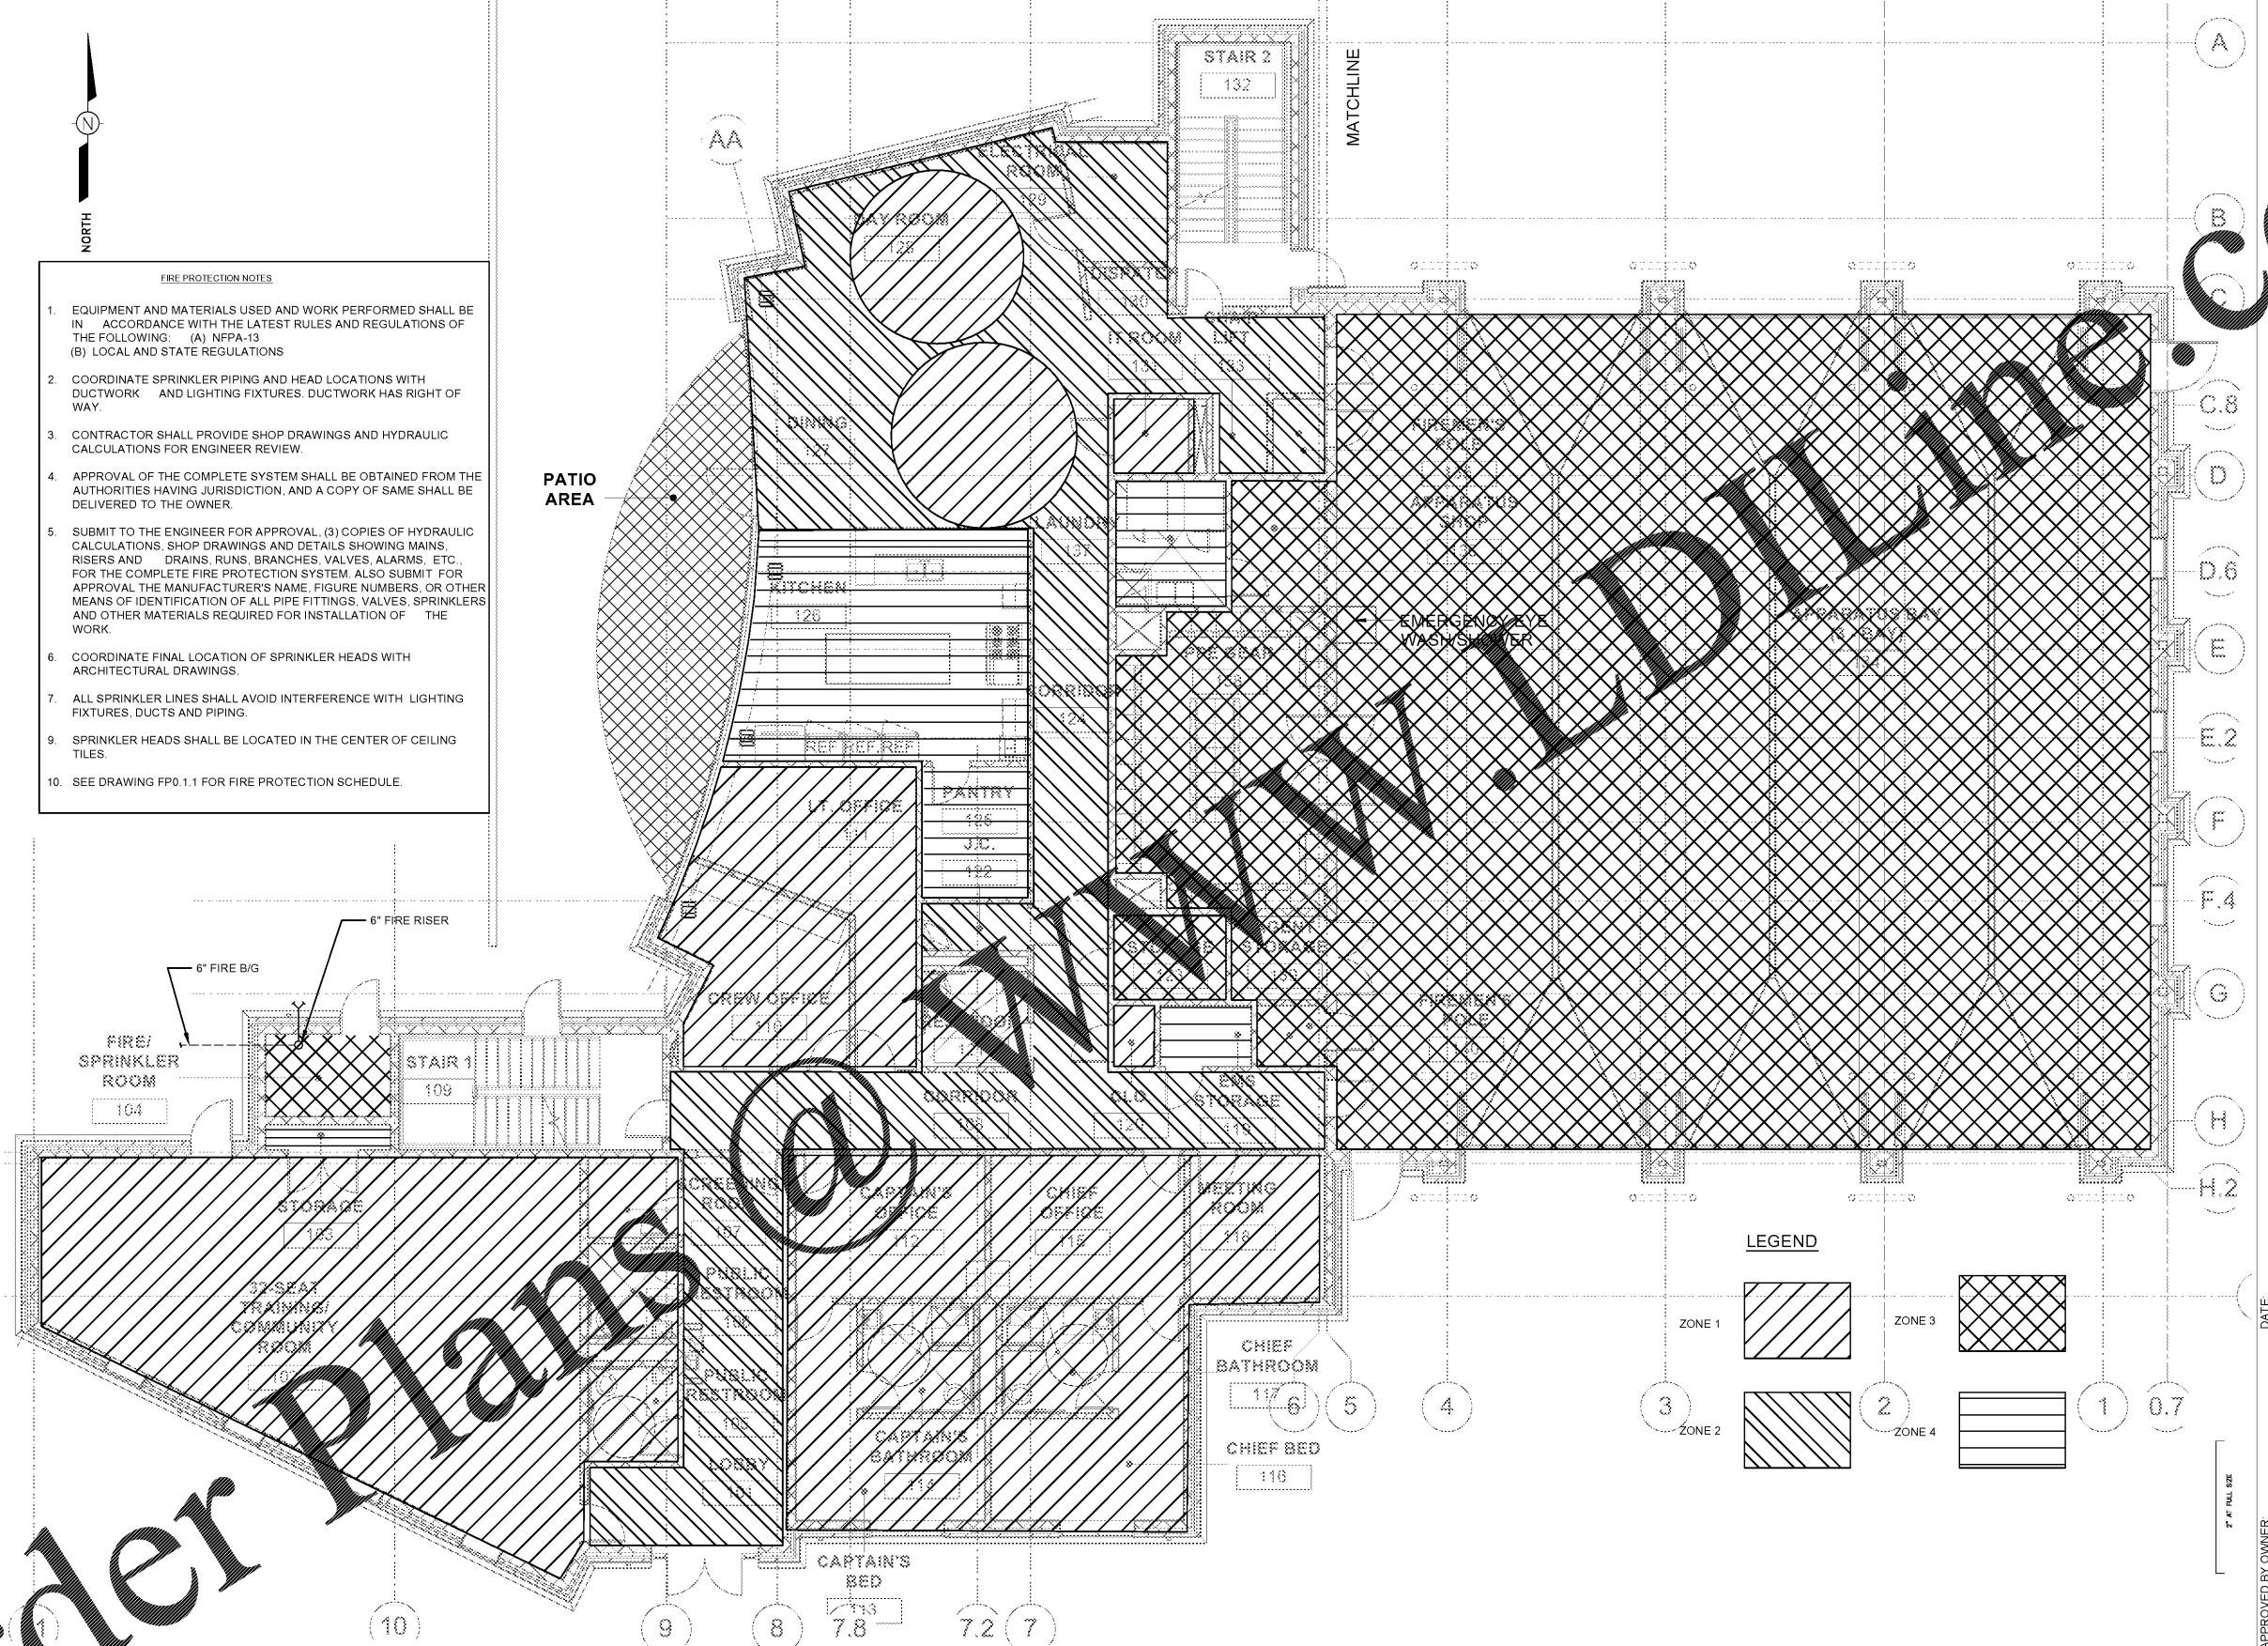

Order Plans @

1 FIRE PROTECTION PLAN - FIRST FLOOR
 FP2.1.1 SCALE: 3/16" = 1'-0"

ENGINEERED SYSTEMS & SERVICES
 2950 Horizon Park Drive
 Suite B
 Suwanee, GA 30024
 Phone: 770-810-5700
 Fax: 770-825-9295

CLIENT

Joint Venture
 ARCADIS/ BPA
 2845 Paces Ferry Road
 Suite 400
 Atlanta, Georgia 30339

Architect:
harris + smith
 101 Marietta Street NW
 Suite #2320
 Atlanta, Georgia 30303
 P 404 584 8773
 F 404 522 6920
 www.harris-smith.com

MECH / Elec. Plumbing
 Engineered Systems & Services
 Suwanee, Georgia
 Steve / Civil
 Brindley Pieters & Associates, Inc. Atlanta, Georgia 30303
 Landscape: P&A, Inc. Atlanta, Georgia

PROJECT TITLE
CITY OF ATLANTA FIRE STATION #22
 849 HOLLYWOOD ROAD
 ATLANTA, GA 30318

SEAL

NFC REVISIONS
 10/22/2018 ISSUED FOR CONSTRUCTION

DRAWN BY: ABA
 CHECKED BY: JLR
 DATE: 10/22/2018

KEYPLAN

SCALE: AS INDICATED
FIRE PROTECTION PLAN FIRST FLOOR
SHEET # FP2.1.1
 JOB NUMBER: 03001204