

OVERVIEW

TYPICALLY THE EXHAUST HOOD KIT PROVIDED BY FRANKE FOODSERVICE SYSTEMS WILL INCLUDE THE FOLLOWING:

1. HOOD AND ACCESSORIES
2. METAL FAB UL LISTED GREASE EXHAUST DUCT
3. LOREN COOK EXHAUST FAN
4. AMEREX FIRE SYSTEM

THE SHIPMENT FROM FRANKE FOODSERVICE SYSTEMS WILL INCLUDE THE FOLLOWING:

1. HOOD
2. UTILITY CHASE
3. WALL PLACING
4. FACSA PANELS
5. CHANGING GREASE FILTERS
6. METAL FAB GREASE EXHAUST DUCT

THE LOREN COOK EXHAUST FAN AND ROOF CURB IS DROPPED SHIPPED FROM THEIR FACTORY.

FIRE SUPPRESSION SYSTEM
THE HOOD HAS BEEN FACTORY PRE-PIPED FOR AN AMEREX FIRE SUPPRESSION SYSTEM. THE HOOD KIT FROM FRANKE FOODSERVICE SYSTEMS INCLUDES COMPLETE INSTALLATION OF THE FIRE SUPPRESSION SYSTEM INCLUDING ALL PLANS, PERMITS, CHECK OUT AND CERTIFICATION. THE LOCAL AMEREX REPRESENTATIVE WILL BRING ALL THE SYSTEM COMPONENTS AT THE TIME OF INSTALLATION.

AS AN OPTION, THE HOODS MAY BE PRE-PIPED FOR ANSUL FIRE SUPPRESSION SYSTEM.

CONTACT INFORMATION
ANSUL INSTALLATION QUESTIONS

ANSUL, INC., HANNETTE, MS
OFFICE PHONE: 1-800-842-4785

CONTACT INFORMATION
SHIPPING INFORMATION

FOR ALL FRANKE HOOD PARTS -- MARA ALDAY
FRANKE FOODSERVICE SYSTEMS, INC.
800 AMATION PARKWAY
SUNNYVALE, TN 37172
41-815-482-4000

HOOD INSTALLATION QUESTIONS
FRANKE FOODSERVICE SYSTEMS, INC. TECHNICAL SUPPORT
PHONE - 1-800-837-2863 OPTION 2
E-MAIL - 1-815-482-5471
E-MAIL - FS-TECH@FRANKE.COM

AMEREX INSTALLATION QUESTIONS
THE HOOD IS FACTORY PRE-PIPED FOR AN AMEREX FIRE SUPPRESSION SYSTEM. THE LOCAL AMEREX DISTRIBUTOR WILL MAKE CONTACT WITH THE GENERAL CONTRACTOR TO SET UP THE INSTALLATION SCHEDULE. IF YOU HAVE NOT HEARD FROM THE DISTRIBUTOR, CONTACT:
KAREN HAHN
AMEREX CORPORATION, TRUSSVILLE, AL
1-205-635-5730

LOREN COOK FAN INSTALLATION
IF THERE ARE QUESTIONS OR ISSUES WITH THE LOREN COOK FAN INSTALLATION CONTACT:
DAVID RAY
LOREN COOK COMPANY, SPRINGFIELD, MO
1-417-889-8474

METAL-FAB DUCT INSTALLATION
IF THERE ARE QUESTIONS OR ISSUES WITH THE METAL-FAB DUCT INSTALLATION CONTACT:
METAL FAB, INC. WENDELL, MS
COMMERCIAL SERVICE, COMMERCIAL VENT PRODUCTS
1-800-836-2830

FRYER HOOD LISTING AND APPROVAL REFERENCE



INTERTEK TESTING SERVICES, INC.
FRYER HOOD IS E.T.L. LISTED EXHAUST HOODS WITHOUT EXHAUST DAMPERS, REPORT NO. 3198208. TESTED UNDER IN ACCORDANCE WITH UNDERWRITERS LABORATORIES STANDARDS UL710 AND ULCS646.

NATIONAL FIRE PROTECTION ASSOCIATION
FRYER HOOD MEETS ALL REQUIREMENTS OF NFPA-96 "STANDARD FOR VENTILATION CONTROL AND FIRE PROTECTION OF COMMERCIAL COOKING OPERATIONS"

NATIONAL SANITATION FOUNDATION
MEETS ALL REQUIREMENTS OF NSF STANDARD NUMBER 2 "FOOD SERVICE EQUIPMENT"

MECHANICAL CODES
MEETS ALL REQUIREMENTS OF THE IMC, BOCA, SBCCI AND IBC.

2 LISTINGS AND APPROVALS
SCALE: NO SCALE

DRAWING INFORMATION		
DATE	DESCRIPTION	BY
01-07-19	FOR CONSTRUCTION	KM

N-C-A
CONSULTANTS / GROUP
4585 140TH AVE. NORTH, SUITE #1001
CLEARWATER, FLORIDA
PHONE: (877) 530-0078
CALL NCA MARKETING FOR PRICING
NCA JOB# 19-107

NO.	DATE	REVISION




PREMIER KINGS, INC.
5525 CARMICHAEL ROAD
MONTOMOERY, ALABAMA 36117
PHONE: (205) 833-1111
LINDSEY@KINGALABAMA.COM

21754 Alabam Avenue
Birmingham, AL 35203
Phone: (205) 322-7511
Fax: (205) 322-1778
email: info@hplha.com
www.hplha.com

hendon
huckestein
architects, pc
architecture • planning • interior design



PROJECT # 18026.02
RCC-60 FALL 20/20 MAGE NOVEMBER 2018 DESIGN RELEASE
BURGER KING RESTAURANT
STREET ADDRESS
HARPERSVILLE, AL

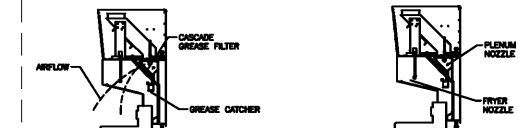


GREASE EXTRACTION
THE FRANKE EXHAUST HOOD MODEL 180000A IS FACTORY PRE-PIPED FOR AN AMEREX FIRE SUPPRESSION SYSTEM. THE HOOD IS E.T.L. LISTED EXHAUST HOODS WITHOUT EXHAUST DAMPERS, REPORT NO. 3198208. TESTED UNDER IN ACCORDANCE WITH UNDERWRITERS LABORATORIES STANDARDS UL710 AND ULCS646.




CLEANING
AT THE END OF EACH DAY, AFTER THE FRYER HAS BEEN SHUT OFF, THE GREASE FILTERS ARE REMOVED FROM THE HOOD, THEY ARE WASHED AND CLEANED, CLEANED AND RE-INSTALLED. THE USE OF TOOLS, THE GREASE FILTERS TWO PIECE DESIGN AND LOCKING TYP NOZZLES PERMIT ACCESS FOR CLEANING. THE GREASE CATCHER IS ALSO REMOVED, CLEANED AND REPLACED.


GENERAL SPECIFICATION
THE FRANKE HOOD IS FACTORY PRE-PIPED FOR AN AMEREX FIRE SUPPRESSION SYSTEM. THE HOOD IS E.T.L. LISTED EXHAUST HOODS WITHOUT EXHAUST DAMPERS, REPORT NO. 3198208. TESTED UNDER IN ACCORDANCE WITH UNDERWRITERS LABORATORIES STANDARDS UL710 AND ULCS646.

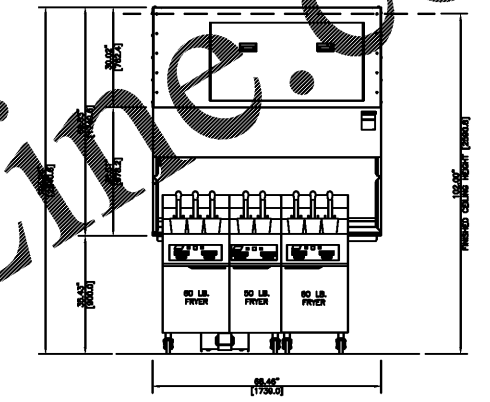


4 PREFERRED FRYER CONFIGURATION FRONT ELEVATION
SCALE: NO SCALE

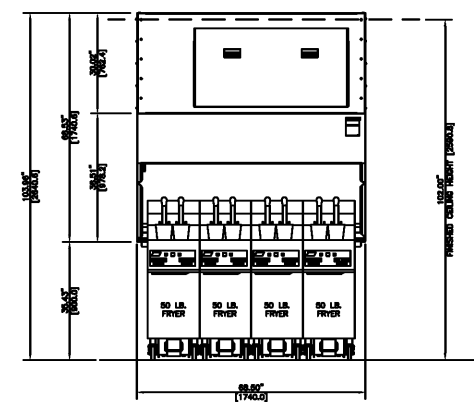


5 OPTIONAL FRYER CONFIGURATION FRONT ELEVATION
SCALE: NO SCALE

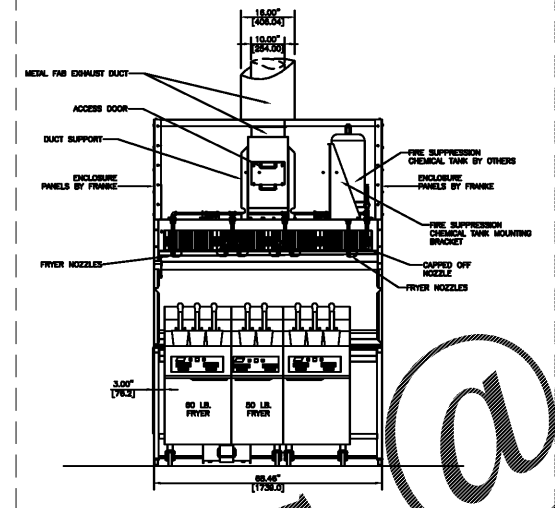


6 PREFERRED FRYER CONFIGURATION FRONT ELEVATION FIRE SUPPRESSION DETAIL - AMEREX
SCALE: NO SCALE

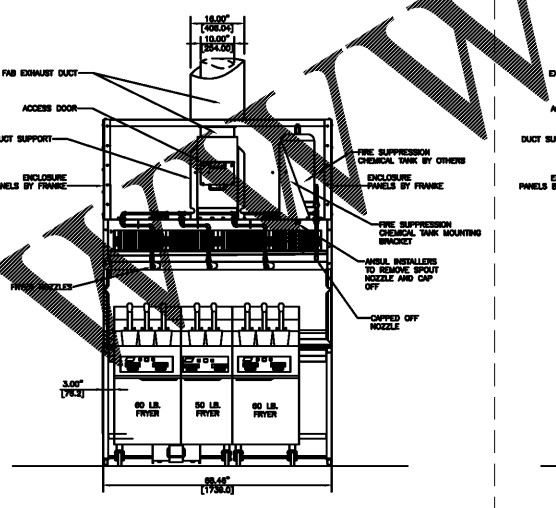


7 PREFERRED FRYER CONFIGURATION FRONT ELEVATION FIRE SUPPRESSION DETAIL - ANSUL
SCALE: NO SCALE

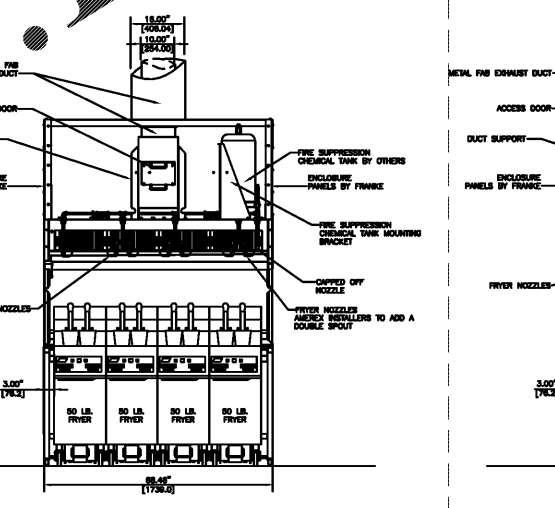


8 OPTIONAL FRYER CONFIGURATION FRONT ELEVATION FIRE SUPPRESSION DETAIL - AMEREX
SCALE: NO SCALE

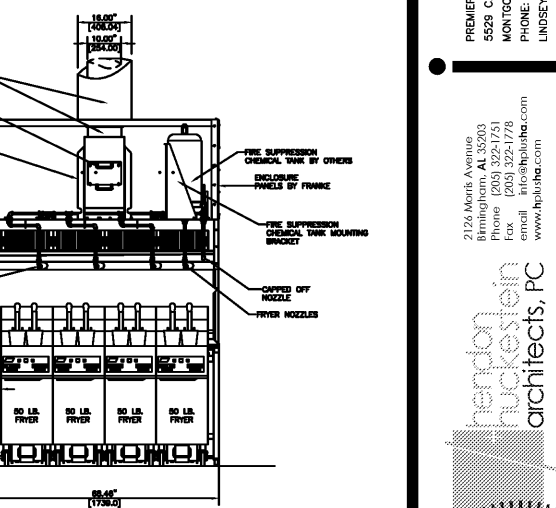


9 OPTIONAL FRYER CONFIGURATION FRONT ELEVATION FIRE SUPPRESSION DETAIL - ANSUL
SCALE: NO SCALE

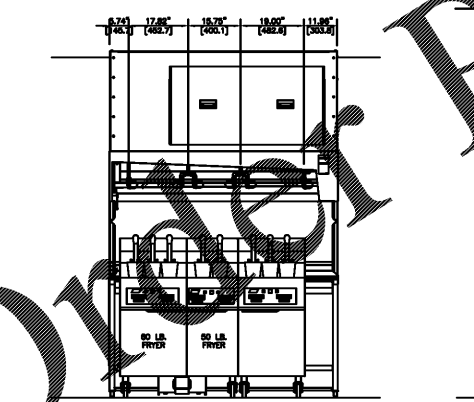


10 AMEREX FIRE SUPPRESSION PIPING DETAIL - PREFERRED FRYER CONFIGURATION
SCALE: NO SCALE

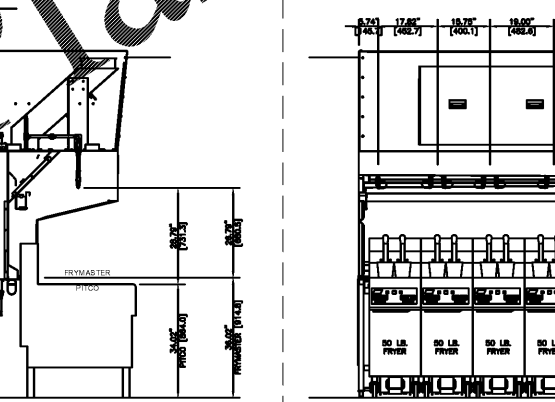

11 AMEREX FIRE SUPPRESSION PIPING DETAIL - OPTIONAL FRYER CONFIGURATION
SCALE: NO SCALE

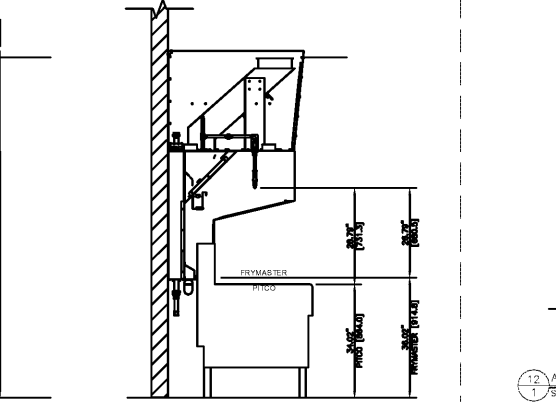

12 ANSUL FIRE SUPPRESSION PIPING DETAIL - PREFERRED FRYER CONFIGURATION
SCALE: NO SCALE

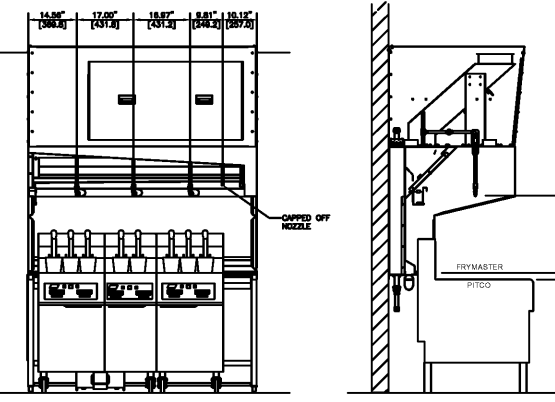

13 ANSUL FIRE SUPPRESSION PIPING DETAIL - PREFERRED FRYER CONFIGURATION
SCALE: NO SCALE

© Copyright 2018- Drawings, specifications, notes, database, computer files, field data, and reports as instruments of service prepared by the Design of Record. As instruments of services, these items remain the property of the Design of Record, who shall retain all statutory and other reserved rights, including the copyright thereto. Any use, reproduction or changes to these documents without written consent of NCA Consultants is a violation of federal copyright laws.