

PARKER'S CANE BAY

THE PARKER COMPANIES  
17 WEST MIDNIGHTHURST  
DAYTONA BEACH, FL 32114


Parkers

Revisions

FRAMING DETAILS

DATE: 2/1/2019  
BY: [Signature]  
SCALE: AS SHOWN

S402

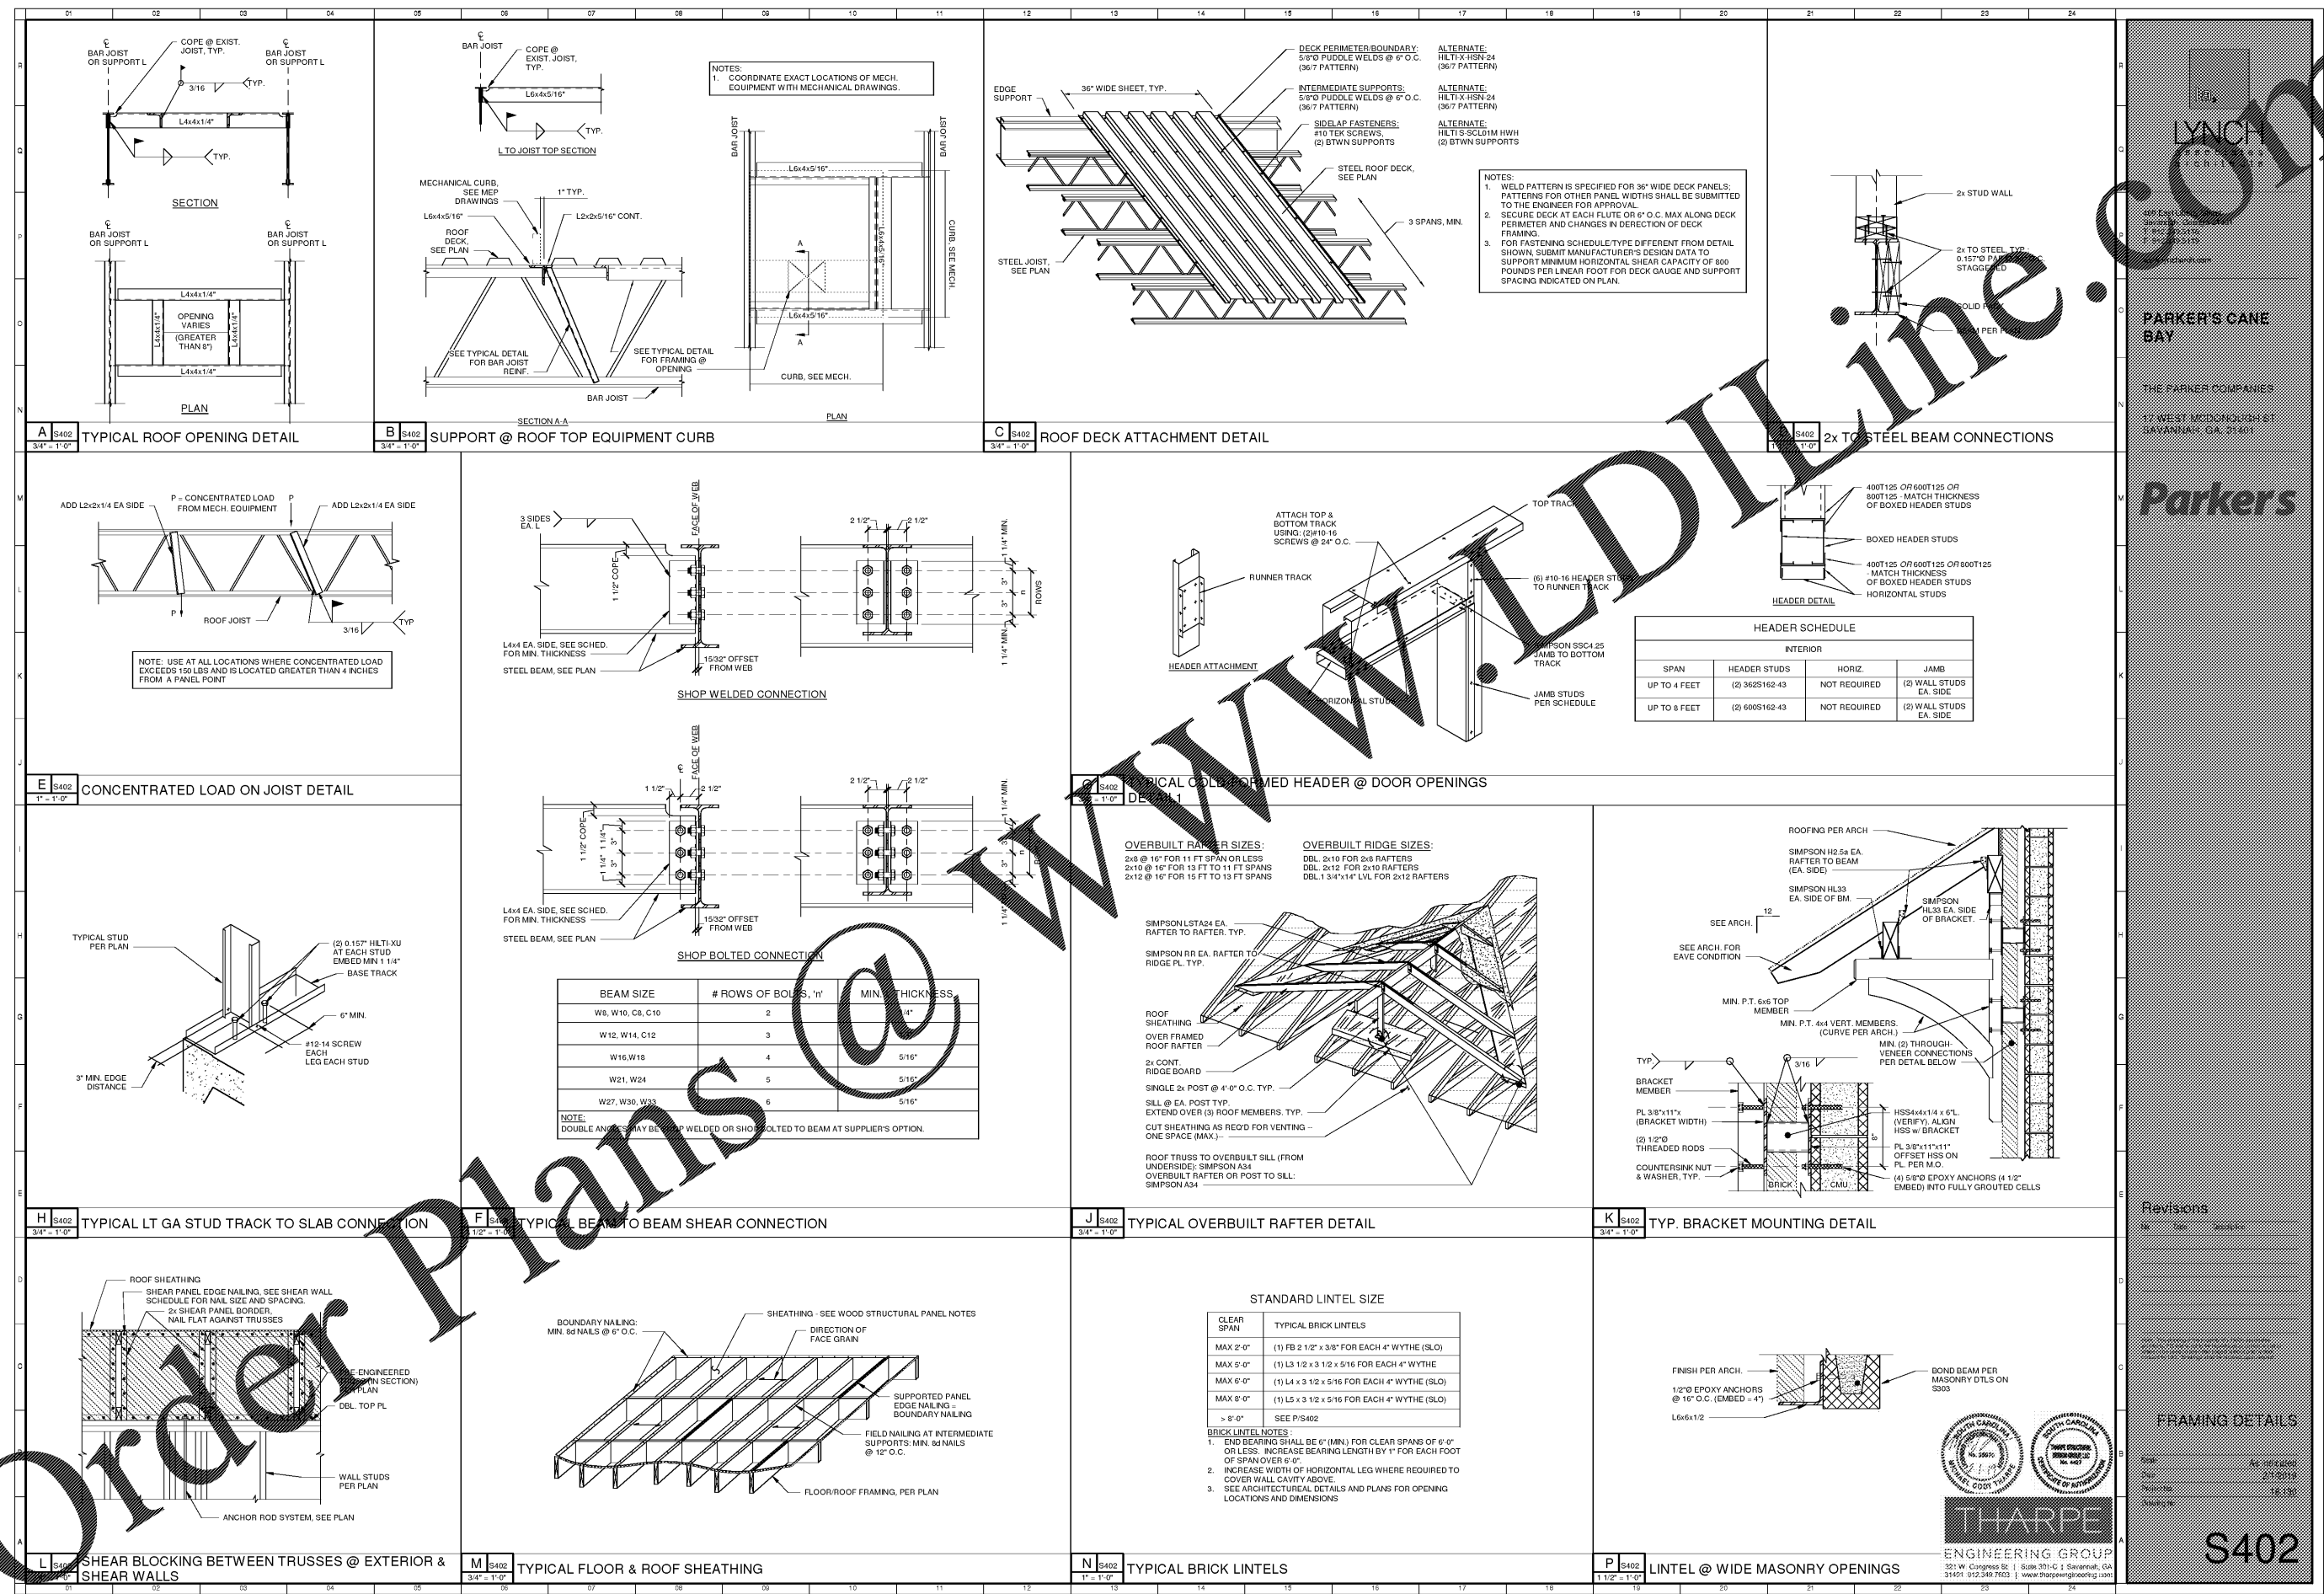

A S402 TYPICAL ROOF OPENING DETAIL

B S402 SUPPORT @ ROOF TOP EQUIPMENT CURB

C S402 ROOF DECK ATTACHMENT DETAIL

D S402 2x TO STEEL BEAM CONNECTIONS

E S402 CONCENTRATED LOAD ON JOIST DETAIL

F S402 SHOP WELDED CONNECTION

G S402 SHOP BOLTED CONNECTION

H S402 TYPICAL COLLECTED HEADER @ DOOR OPENINGS

I S402 OVERBUILT RAFTER DETAIL

J S402 TYP. BRACKET MOUNTING DETAIL

K S402 TYPICAL LT GA STUD TRACK TO SLAB CONNECTION

L S402 TYPICAL BEAM TO BEAM SHEAR CONNECTION

M S402 TYPICAL OVERBUILT RAFTER DETAIL

N S402 TYP. BRACKET MOUNTING DETAIL

O S402 SHEAR BLOCKING BETWEEN TRUSSES @ EXTERIOR & SHEAR WALLS

P S402 TYPICAL FLOOR & ROOF SHEATHING

Q S402 TYPICAL BRICK LINTELS

R S402 LINTEL @ WIDE MASONRY OPENINGS

BEAM SIZE	# ROWS OF BOLTS, 'n'	MIN. THICKNESS
W8, W10, C8, C10	2	5/16"
W12, W14, C12	3	5/16"
W16, W18	4	5/16"
W21, W24	5	5/16"
W27, W30, W33	6	5/16"

NOTE: DOUBLE ANGLE MAY BE WELDED OR SHOP BOLTED TO BEAM AT SUPPLIER'S OPTION.

CLEAR SPAN	TYPICAL BRICK LINTELS
MAX 2'-0"	(1) FB 2 1/2" x 3/8" FOR EACH 4" WYTHE (SLO)
MAX 5'-0"	(1) L3 1/2 x 3 1/2 x 5/16 FOR EACH 4" WYTHE
MAX 6'-0"	(1) L4 x 3 1/2 x 5/16 FOR EACH 4" WYTHE (SLO)
MAX 8'-0"	(1) L5 x 3 1/2 x 5/16 FOR EACH 4" WYTHE (SLO)
> 8'-0"	SEE P/S402

BRICK LINTEL NOTES:  
1. END BEARING SHALL BE 6" (MIN.) FOR CLEAR SPANS OF 6'-0" OR LESS. INCREASE BEARING LENGTH BY 1" FOR EACH FOOT OF SPAN OVER 6'-0".  
2. INCREASE WIDTH OF HORIZONTAL LEG WHERE REQUIRED TO COVER WALL CAVITY ABOVE.  
3. SEE ARCHITECTURAL DETAILS AND PLANS FOR OPENING LOCATIONS AND DIMENSIONS

Order Plans @



THARPE ENGINEERING GROUP  
321 W. Congress St. | Suite 301-C | Savannah, GA  
912.522.7623 | www.tharpeengineering.com