



1. WATER HEATER
 2. HOT WATER TO SYSTEM
 3. COLD WATER SUPPLY
 4. SHUT-OFF VALVE
 5. VACUUM RELIEF VALVE
 6. DIELECTRIC UNION
 7. 3/4" PRESSURE AND TEMPERATURE RELIEF VALVE
 8. DRAIN VALVE
 9. RELIEF VALVE DISCHARGE PIPED FULL SIZE TO FLOOR DRAIN
 10. DRIP PAN DRIP PIPED FULL SIZE TO FLOOR DRAIN
 11. DRIP PAN (3" HIGH, 24 GA GALVANIZED STEEL)
 12. HOT WATER RETURN
 13. CHECK VALVE
- NOTE: WATER HEATERS SHALL BE SEISMICALLY RESTRAINED.

1 WATER HEATER DETAIL - WH-1 & WH-2
P401 NOT TO SCALE

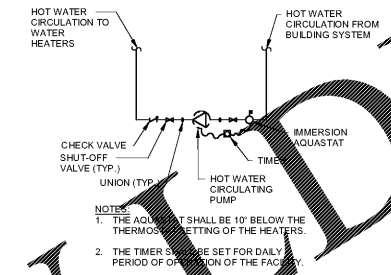


- NOTES:
1. THE AQUASTAT SHALL BE 10" BELOW THE THERMOSTAT SETTING OF THE HEATERS.
 2. THE TIMER SHALL BE SET FOR DAILY PERIOD OF OPERATION OF THE FACILITY.


2 CIRCULATING PUMP DETAIL
P401 NOT TO SCALE

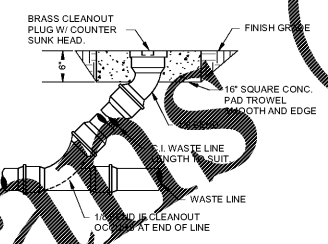

3 CLEANOUT TO GRADE DETAIL
NOT TO SCALE

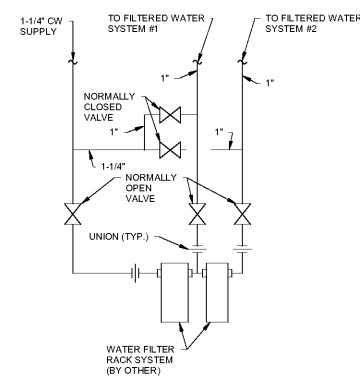


4 WATER FILTER DETAIL
P401 NOT TO SCALE

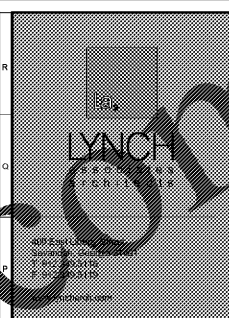

PARKER'S CANE BAY

THE PARKER COMPANIES
17 WEST MCCONOUGH ST.
SAVANNAH, GA 31401



Revisions

NO.	DATE	DESCRIPTION

PLUMBING DETAILS

Scale: As Indicated
Date: 07/01/19
Project: P401
Drawing #: P401



P401