



HARRISON FRENCH & ASSOCIATES, LTD.
 1705 S. Station Blvd, Suite 3
 Bentonville, Arkansas 72712
 479.273.7780
 479.520.9685
 www.hfa-ae.com

PLAN LEGEND

- EXISTING TO REMAIN
- NEW EQUIPMENT/ FINISHES
- - - - - RELOCATED EQUIPMENT
- NEW CONCRETE

NOTES:

1. METAL BUILDING SUPPLIER TO PROVIDE A CONTINUOUS WALL GIRT LOCATED 54" A.F.F. AT ALL WALLS.
2. METAL BUILDING SUPPLIER TO PROVIDE ALL PRE-FINISHED METAL TRIM, COLOR TO MATCH EXISTING.
3. ALL METAL BUILDING TRIM TO MATCH EXISTING.
4. ALL OUTSIDE METAL PANELS TO MATCH EXISTING WALL PANELS.
5. METAL BUILDING SUPPLIER TO PROVIDE R-13 VINYL COVERED BATT INSULATION FOR ALL EXTERIOR WALL. PROVIDE R-13 VINYL COVERED BATT INSULATION AT ROOF.
6. PAINT ALL TRIM AND HOLLOW METAL DOORS PER DOOR SCHEDULE. REF: YA2. BOLLARDS TO BE SAFETY YELLOW.
7. METAL BUILDING SUPPLIER TO PROVIDE VERTICAL RED STEEL FRAMING ALONG ALL DOOR JAMBS & HORIZONTAL RED STEEL FRAMING ALONG ALL DOOR HEADS.
8. PRE-ENGINEERED METAL PROVIDED BY OWNER THROUGH: "VARCO PRUDEN BUILDINGS" CONTACT: RYAN KILLGORE 1-901-748-6118 RKILLGORE@VP.COM
9. ITEMS PROVIDED BY OWNER FOR G.C. TO INSTALL: METAL BUILDING FRAMING, WALL-ROOF PANELS, RIDGE VENTS, METAL TRIM, VINYL COVERED BATT INSULATION, DOORS & HARDWARE.
10. FIRE EXTINGUISHERS SHALL BE PROVIDED IN ACCORDANCE WITH ALL CURRENT APPLICABLE CODES.
11. ALL PLYWOOD SHALL MEET THE CLASS C FLAME SPREAD AND SMOKE-DEVELOPED RATING REQUIREMENTS PER ALL CURRENT APPLICABLE CODES.
12. PROVIDE CONCRETE SLOPED @ 2% MAX FOR OVERHEAD DOOR. EXTEND BEYOND TO MEET CONCRETE SLAB.
13. ALLOW 1/2" ADDITIONAL CLEARANCE AT DOOR OPENINGS AS REQUIRED FOR SHIMMING.
14. ALL AIR LINES AND FITTINGS ABOVE GROUND SHALL BE SCHEDULE 40 GALVANIZED STEEL.
15. ALL OVERHEAD LUBE OIL LINES AND FITTINGS SHALL BE SCHEDULE 80 BLACK IRON.
16. LINES TO GREASE REELS SHALL BE 1/2" A.S.T.M. 106A SEAMLESS STEEL TUBING 8000 PSI FOR GREASE. LINES TO OTHER LUBE REELS SHALL BE 1000 PSI SEAMLESS STEEL TUBING. JOINTS SHALL BE MADE SOCKET WELD FORGED STEEL FITTINGS, A.S.T.M. A 105. INSULATE WITH PIPE JACKET.
17. OVERHEAD OIL REELS SHALL BE SUSPENDED FROM OVERHEAD BUILDING BEAM AND BRACED TO PREVENT LATERAL MOVEMENT. BOTTOM OF REELS SHALL BE 10 FEET ABOVE FLOOR.
18. ALL OVERHEAD LINES SHALL BE MOUNTED AGAINST ROOF PURLINS OR BEAMS AND SUPPORTED AT LEAST EVERY 10 FEET ON PIPE HANGERS.
19. ALL VALVES SHALL BE BRASS GLOBE VALVES AT LEAST 2 FEET ABOVE FINISH FLOOR.
20. ALL AIR LINE RUN TERMINATIONS SHALL HAVE A MOISTURE TRAP WITH A 1/2" PETCOCK TO DRAIN TRAP. REF: MECHANICAL.
21. OVERHEAD OIL REELS, REEL ASSEMBLY WILL CONTAIN 2 OIL REELS, 3 LUBE REELS, & 1 GREASE REEL. GREASE REEL TO BE CLOSEST TO BUILDING COLUMN. REF: BYA1 CONNECT REELS TO PRODUCT CONTAINERS IN STORAGE AREA.

STIPULATION FOR REUSE
 THESE DRAWINGS ARE PREPARED FOR THE PROJECT AND SITE SPECIFIC. ANY REUSE OF THESE DRAWINGS FOR ANY OTHER PROJECT WITHOUT THE WRITTEN PERMISSION OF HFA IS STRICTLY PROHIBITED. HFA SHALL NOT BE RESPONSIBLE FOR ANY DAMAGES OR INJURIES RESULTING FROM THE REUSE OF THESE DRAWINGS FOR ANY OTHER PROJECT WITHOUT THE WRITTEN PERMISSION OF HFA. HFA SHALL NOT BE RESPONSIBLE FOR ANY DAMAGES OR INJURIES RESULTING FROM THE REUSE OF THESE DRAWINGS FOR ANY OTHER PROJECT WITHOUT THE WRITTEN PERMISSION OF HFA.

13365 GLENBROOK AVE
 MEADOWVIEW, VA 24361
Love's
Travel Stop & Country Stores
 LIGHT MECHANICAL SERVICE ADDITION
 PROJECT NUMBER: 03-18-20813





OCT 26 2018

ISSUE BLOCK

STORE NO.	613
DOCUMENT DATE:	10/25/18
CHECKED BY:	RAF
DRAWN BY:	RWM
PRGTO CYCLE:	

ENLARGED FLOOR PLAN

SHEET: **YA1**

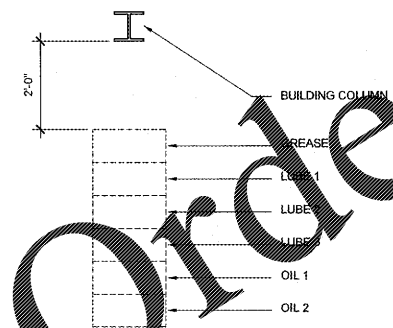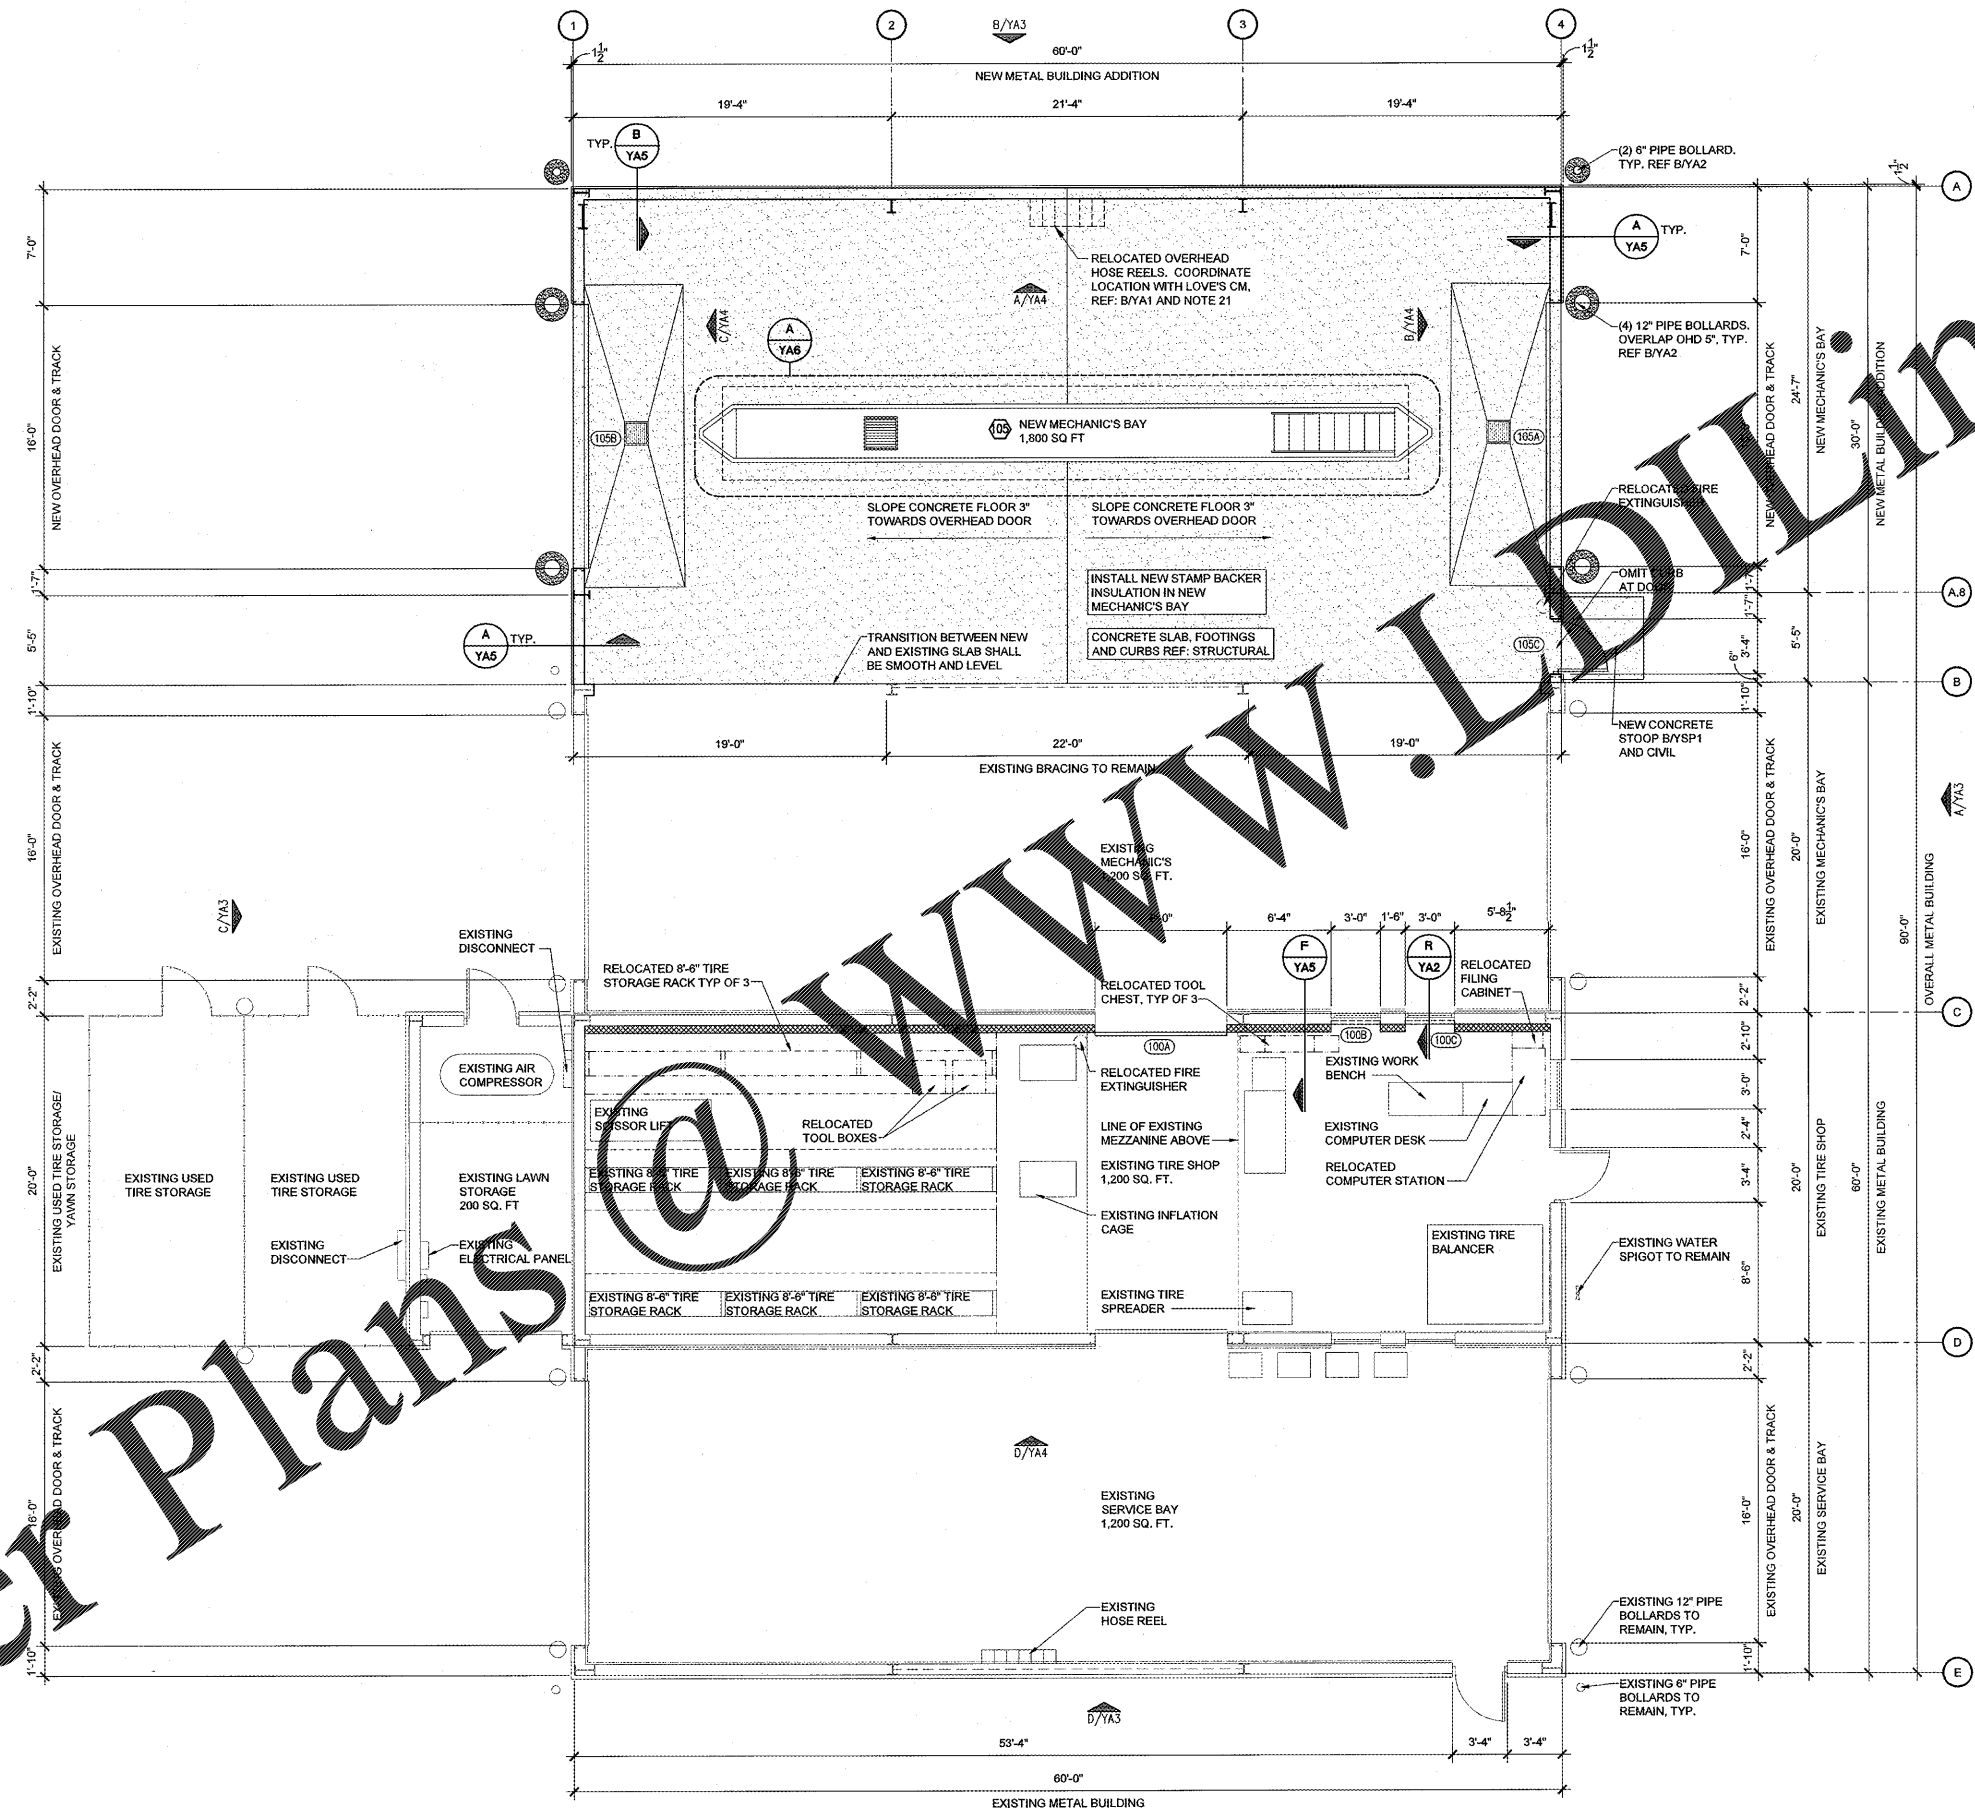

B OVERHEAD REEL CONFIGURATION PLAN
 SCALE: 1/2" = 1'-0"

A OVERALL PLAN DETAIL
 SCALE: 3/16" = 1'-0"

C:\2018\11\06\en - User: rdm\rajgins
 L:\2018\10\20\13\Love's - Meadowview, VA\181003DCS\Hatch\sheet\118\YA1 FLOOR PLAN.dwg