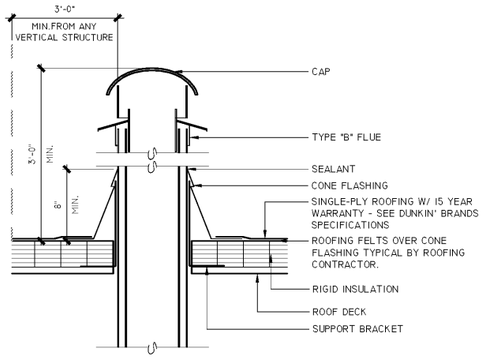

EXHAUST PIPE PENETRATION DETAIL

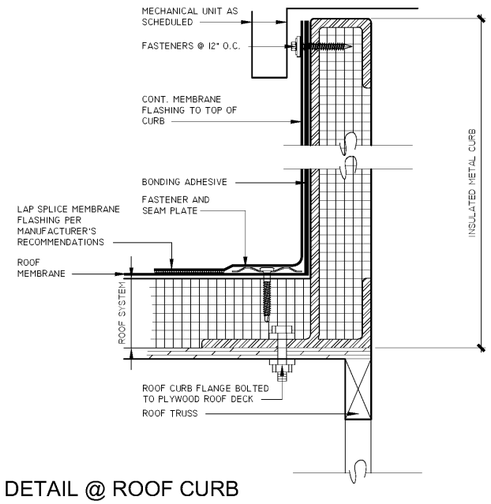

DETAIL @ ROOF CURB

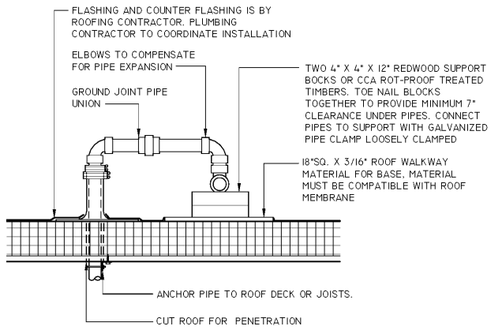

NOTES:

1. REFER TO PLANS FOR PIPE SIZE(S) AND LOCATION(S). USE WELDED OR SCREWED FITTINGS AS SPECIFIED FOR PIPE SIZE. LOCATE PENETRATION MINIMUM 18" FROM ADJACENT WALLS, EQUIPMENT CURBS, PARAPETS, EXPANSION JOINTS, ETCETERA.
2. LOCATE SUPPORTS AT THE FOLLOWING SPACING: 1-1/2"=9', 1-1/4"=8', 1"=7' & 3/4"=6'. PROVIDE SUPPORTS AS CLOSE AS POSSIBLE TO EACH ELBOW AND TEE.

ROOF PENETRATION DETAIL

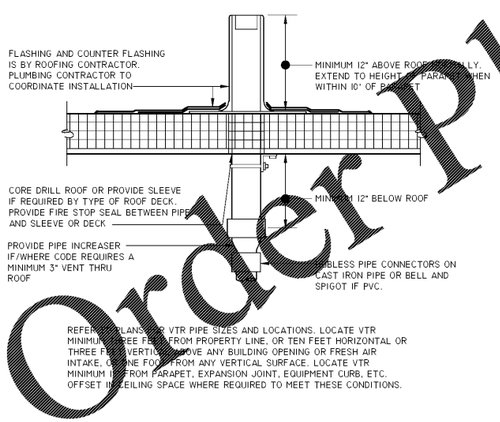

VENT TO ROOF DETAIL

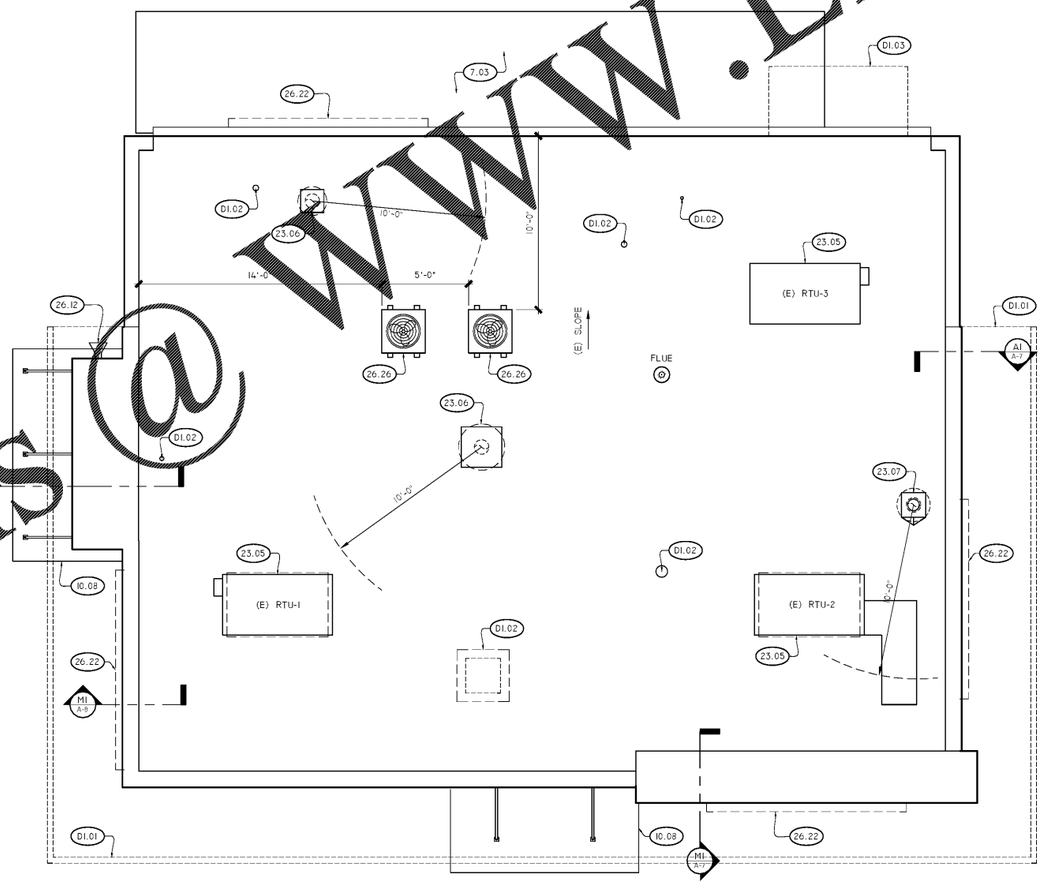

F1 ROOF PLAN

SCALE: 1/4" = 1'-0"

ROOF PLAN KEY NOTES: (0.0)

7.03	WALK-IN BOX MEMBRANE ROOFING PROVIDED BY WALK-IN BOX INSTALLER.
10.08	NEW CANOPY AS MANUFACTURED BY UNI-STRUCTURE - GC TO PROVIDE CANOPY, TRIM, BLOCKING AND ELECTRICAL CONNECTIONS AS REQUIRED. SEE NATIONAL ACCOUNTS FOR ORDERING.
23.05	EXISTING RTU TO REMAIN - SEE MECHANICAL PLANS.
23.06	NEW EXHAUST FAN ON EXISTING CURB - SEE MECHANICAL PLANS.
23.07	NEW EXHAUST FAN ON NEW CURB - SEE MECHANICAL PLANS.
26.12	NEW DRIVE-THRU CAMERA MOUNTED TO EXTERIOR. SEE EXTERIOR ELEVATIONS & ELECTRICAL PLANS.
26.22	DD SIGNAGE BY SIGN VENDOR, PERMITTED & INSTALLED UNDER SEPARATE COVER AND PERMIT. GC SHALL PROVIDE BLOCKING & ELECTRICAL CONNECTION IN ACCORDANCE WITH APPROVED SIGN SHOP DRAWINGS AND ELECTRICAL PLANS.
26.26	WALK-IN BOX CONDENSER UNITS SUPPLIED BY WALK-IN BOX VENDOR, TYP.
D1.01	DEMOLISH AND REMOVE [illegible] OF EXISTING MANSARD OVERHANG.
D1.02	DEMOLISH AND REMOVE EXISTING ROOF PENETRATION - CAP OPENING /PATCH ROOF AS REQUIRED.
D1.03	DEMOLISH AND REMOVE EXISTING CANOPY IN ITS ENTIRETY.

ARCHITECT OF RECORD
JAMES D. SMITH, AIA
522 BAY LN.
CENTERVILLE, MA 02632

I CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND I AM A DULY LICENSED ARCHITECT UNDER THE LAWS OF THE STATE OF TENNESSEE, LICENSE No. 108892, EXPIRATION DATE 01.31.20

DUNKIN'

dunkin' brands.
STORE #358032
US-11W
BRISTOL, TN

REVISION		
No.	DATE	DESCRIPTION
DWG DATE:		2-1-2019
DRAWN BY:		STAFF
PROJECT No.:		17182

DWG TITLE:

ROOF PLAN

SHEET No.
A-2

WWW.LDILine.com
Order Plans @