


GENERAL NOTES

1. ALL RECEPTACLES IN KITCHEN AREA SHALL BE "GFC" PROTECTED IN ACCORDANCE WITH NEC ART. 210.8(B). PROVIDE GFI RATED BREAKER AT PANEL FOR KITCHEN EQUIPMENT.
2. SEE ARCHITECTURAL ELEVATIONS FOR PLACEMENT OF DEVICES.
3. SEE SHEET E-3 FOR POINT OF SALES POWER AND DATA WIRING.

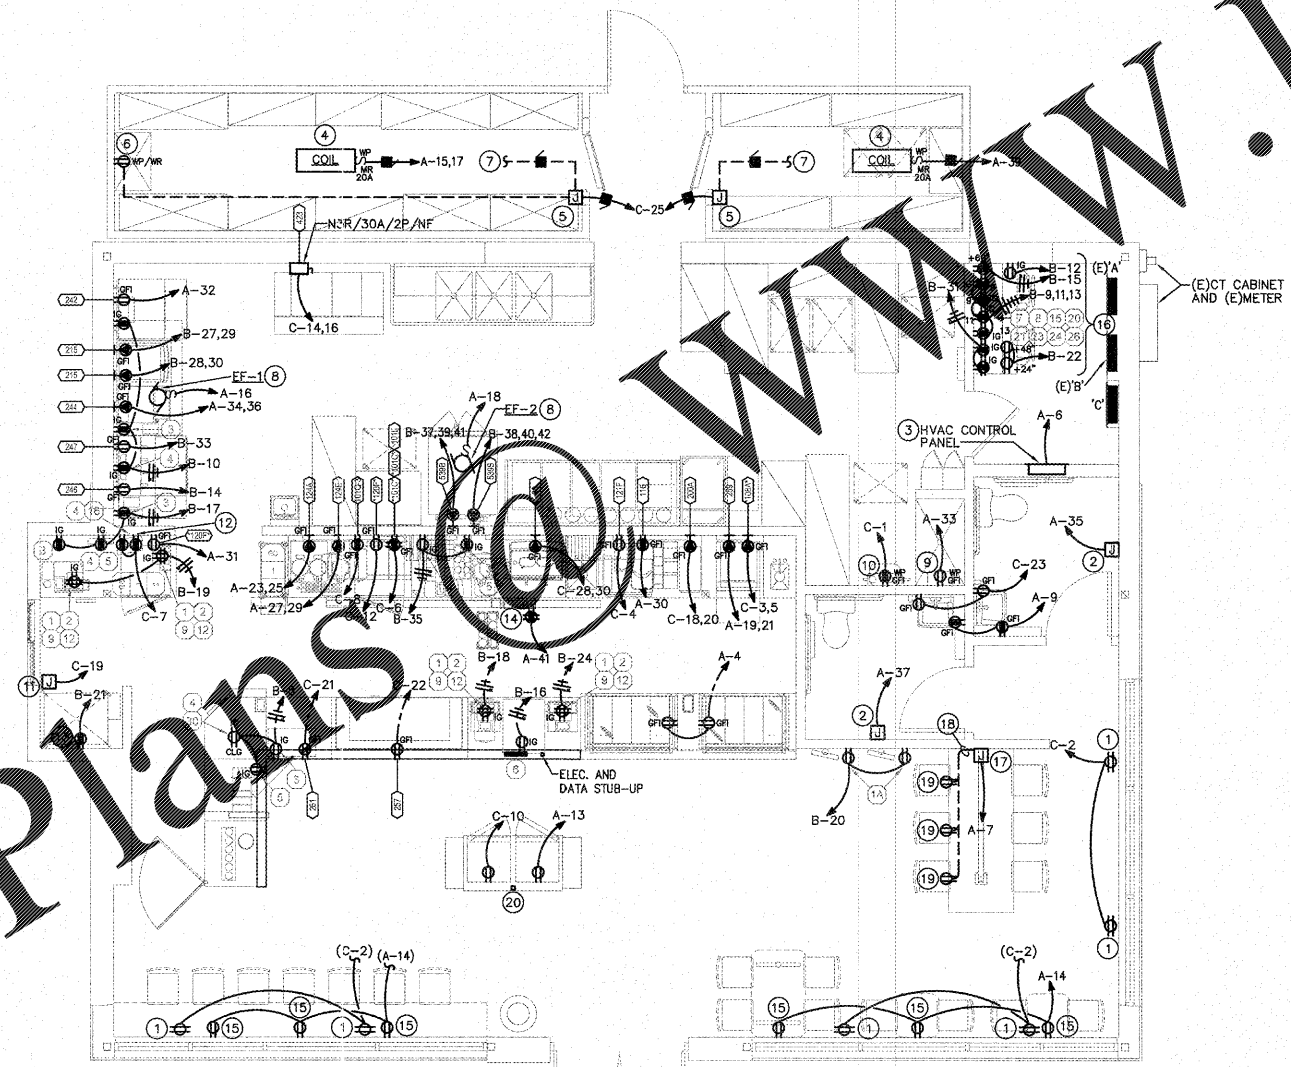

POWER PLAN
 SCALE: 1/4"=1'-0"

POWER PLAN NOTES

1. PROVIDE FLUSH MOUNTED RECEPTACLE ABOVE WINDOW HEADER OR IN LAY-IN CEILING TLE. RECEPTACLE TO BE MOUNTED WITHIN 16" OF TOP OF WINDOW. IF CEILING MOUNTED, J-BOX SHALL BE SUPPORTED TO STRUCTURE ABOVE WITH THREADED ROD.
2. SURFACE MOUNTED J-BOX FOR CONNECTION TO HAND DRYER. COORDINATE EXACT LOCATION WITH GC PRIOR TO ROUGH-IN.
3. HVAC CONTROL PANEL BY MECHANICAL. ELECTRICAL CONTRACTOR SHALL PROVIDE ALL INTERCONNECTING WIRING FROM HVAC PANEL TO RTU & EF UNITS. COORDINATE WIRING REQUIREMENTS WITH MECHANICAL CONTRACTOR PRIOR TO BID.
4. WALK-IN BOX EVAPORATOR/COIL (INSIDE BOX) CONNECTED TO CONDENSING UNIT. CONTRACTOR SHALL FIELD VERIFY WITH EQUIPMENT INSTALLED AND PROVIDE ALL NECESSARY MATERIALS AND LABOR AS REQUIRED TO PROVIDE A COMPLETE AND OPERATIONAL SYSTEM.
5. CONNECT COOLER AND FREEZER DOOR/VENT HEATER AS REQUIRED.
6. PROVIDE RECEPTACLE WITH "WHILE IN-USE" TYPE COVER FOR CONNECTION TO DRAIN LINE HEAT TAPE; HEAT TAPE BY OTHERS. INSTALL GFCI CIRCUIT BREAKER AT PANELBOARD.
7. MAKE FINAL CONNECTION TO LIGHT SWITCH AND LIGHT FIXTURE(S). FIXTURES AND SWITCH PROVIDED BY COOLER/FREEZER MANUFACTURER, INSTALLED BY THIS CONTRACTOR.
8. EXHAUST FAN FURNISHED AND INSTALLED BY MECHANICAL CONTRACTOR. SERVICE DISCONNECT FURNISHED WITH FAN. EXHAUST FAN SHALL BE CONTROLLED VIA HVAC CONTROL PANEL. E.C. SHALL PROVIDE ALL INTERCONNECTION WIRING REQUIRED. COORDINATE INSTALLATION AND WIRING REQUIREMENTS WITH MECHANICAL CONTRACTOR. COORDINATE EXACT LOCATION WITH MECHANICAL DRAWINGS.
9. PROVIDE DISCONNECT SWITCH (N3R/60/3/NF) FOR ELECTRIC WATER HEATER. PROVIDE LIQUID-TIGHT FLEX CONNECTION. COORDINATE EXACT LOCATION IN FIELD PRIOR TO ROUGH-IN.
10. CONNECT BOOSTER PUMP; PROVIDE GFI RECEPTACLE OR HARDWIRED CONNECTION, AS REQUIRED. IF HARDWIRED, INSTALL 20A, 1-POLE SNAP SWITCH FOR DISCONNECTING MEANS.
11. WIRE A/C POWER TO OUTLET LOCATED WITHIN PRE-INSTALLED DRIVE-THRU WINDOW.
12. MOUNT RECEPTACLE AT BULKHEAD ABOVE. SEE ARCHITECTURAL FOOD SERVICE SHEETS FOR LOCATION.
13. WIRE PRE-INSTALLED DRIVE-THRU RECEPTACLE FOR WIRELESS HEADSET TRANSMITTER AFTER WINDOW INSTALLATION. SEE ARCHITECTURAL PLANS FOR DETAIL.
14. RECEPTACLE MOUNTED AT MENU BOARD. SEE ARCHITECTURAL FOOD SERVICE SHEETS FOR LOCATION.
15. PROVIDE COMBINATION USB CHARGER/RECEPTACLE, HUBBELL #USB15X2W OR EQUAL. COORDINATE EXACT LOCATION, ORIENTATION AND MOUNTING HEIGHT WITH ARCHITECTURAL PLANS PRIOR TO ROUGH-IN.
16. COORDINATE FINAL PLACEMENT OF ALL DEVICES WITH FRANCHISEE.
17. JUNCTION BOX IN WALL FOR COMMUNITY TABLE OUTLETS.
18. RUN CONDUIT ALONG UNDERSIDE OF TABLE FROM JUNCTION BOX TO CENTERLINE OF TABLE AND CONNECT TO POWER SYSTEM. SECURE WITH STRAPS.
19. POWER DOMES, EQUALLY SPACED.
20. POWER POLE, SEE DETAIL, THIS SHEET.

DUNKIN'

dunkin'
 STORE #358032
 US-11W
 BRISTOL, TN

REVISION		
No.	DATE	DESCRIPTION

DWG DATE: 2-1-2019
 DRAWN BY: SC/AM
 PROJECT No.: 19005
 DWG TITLE:

POWER PLAN

SHEET No.
E-2

Order Plans

WWW.LDOnline.com