


- ELECTRICAL PLAN NOTES**
1. ROUTE CIRCUIT(S) VIA LIGHTING CONTROL RELAY PANEL. SEE SCHEDULE ON SHEET E-1A.
 2. 1" C WITH PULL STRING TO RIS SYSTEM. SEE SHEET E-3 AND ARCHITECTURAL SITE SHEETS FOR ADDITIONAL INFORMATION.
 3. 3/4" C WITH PULL STRING FOR CONNECTION OF GROUND LOOP, STMB CONDUIT UP INTO MENU BOARD/SPEAKER POST.
 4. PROVIDE THE FOLLOWING CONDUITS FROM SPEAKER POST TO SINGLE DETECTOR, INTERCOM SYSTEM AND INTERCOM OFFICE:
 (3) 1" C WITH PULL STRING, PROVIDE (1) 1/2" C FOR POWER. SEE SHEETS AS-1 AND AS-2 FOR ADDITIONAL INFORMATION.
 5. POWER CONNECTION TO DRIVE-THRU CANOPY LIGHTS. COORDINATE WITH CANOPY VENDOR FOR REQUIREMENTS. COORDINATE WITH GC FOR EXACT LOCATION.
 6. PROVIDE THE FOLLOWING CONDUITS FROM MENU BOARD TO OFFICE: (1) 1" C WITH PULL STRING, (1) 1/2" C FOR POWER. SEE SHEETS AS-1 AND AS-2 FOR ADDITIONAL INFORMATION.
 7. JUNCTION BOX AND WEATHER-PROOF DISCONNECT SWITCH FOR SIGN. SEE ARCHITECTURAL ELEVATIONS FOR SIGN LOCATIONS. VERIFY JUNCTION BOX LOCATION WITH SIGN VENDOR PRIOR TO ROUGH-IN.
 8. EXISTING SITE LIGHTING FIXTURES SHALL REMAIN. SERVICE, CLEAN AND RELAMP LIGHT FIXTURES AS REQUIRED.



ELECTRICAL SITE PLAN
 SCALE: 1/16" = 1'-0"

Harold Hart, P.E.
 CONSULTING ENGINEER
 8928 W. LINEBAUGH AVE - STE. 101
 TAMPA, FLORIDA 33626
 Telephone: (813) 287-2719
 Fax: (813) 961-1985
 © 2018 - All Rights Reserved

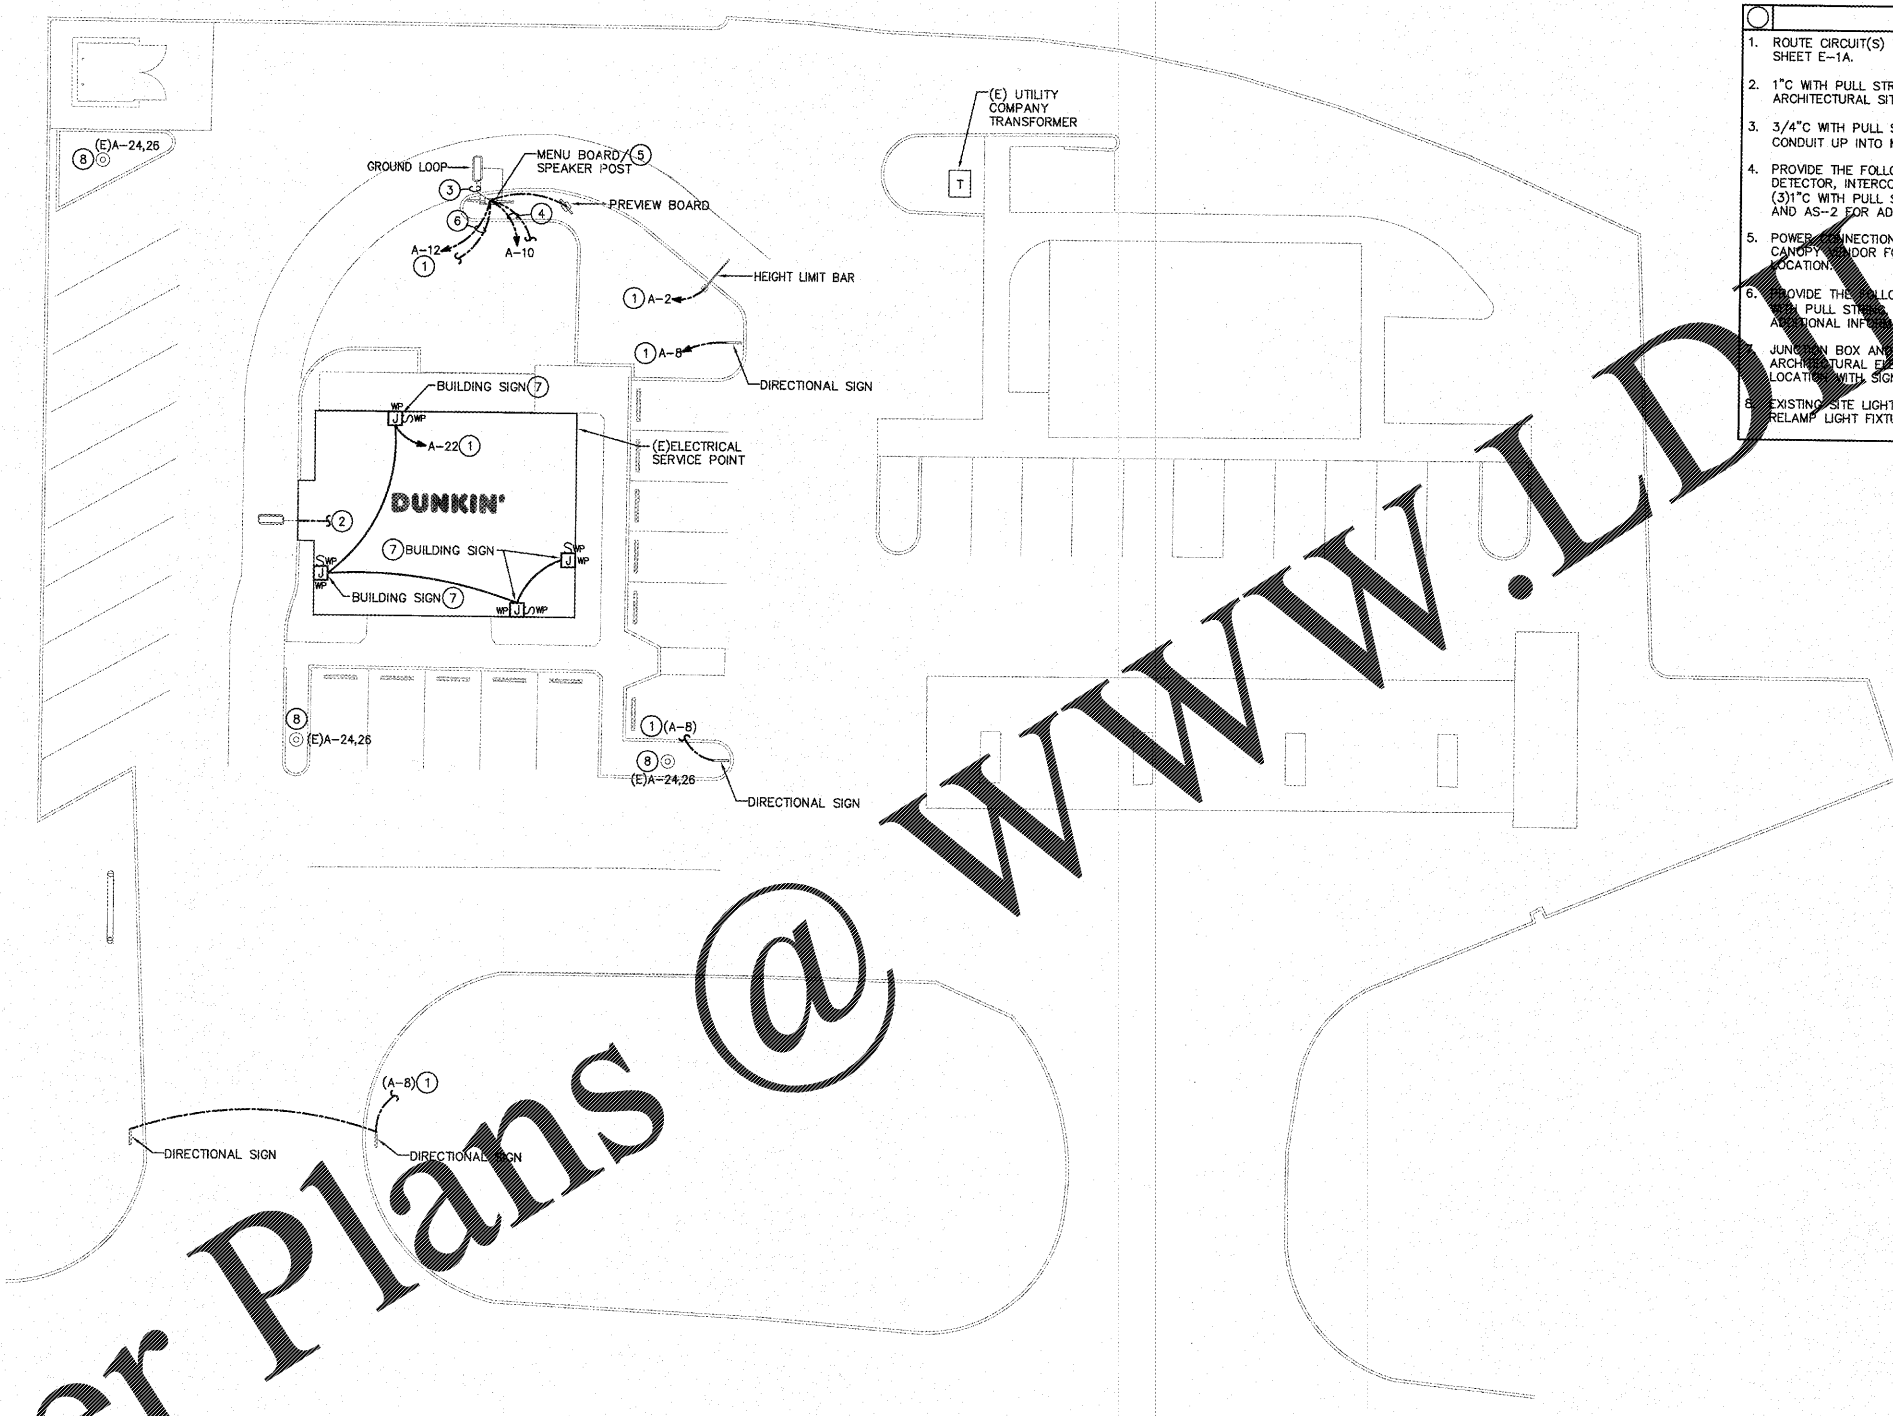

dunkin'
 brand.
 STORE #358032
 US-11W
 BRISTOL, TN

REVISION		
No.	DATE	DESCRIPTION

DWG DATE: 2-1-2019
 DRAWN BY: SC/AM
 PROJECT No.: 19005
 DWG TITLE:

SITE PLAN -
 ELECTRICAL

SHEET No.
ES-1

Order Plans @ www.ltdplans.com