




NO	REVISION / SUBMISSIONS	DATE

CABLE PATHWAY SYMBOL LEGEND	
	CABLE TRAY ABOVE CEILING FOR ALL LOW VOLTAGE WIRING, (FIRE ALARM, DATA, CONTROLS, ETC.) COORDINATE WITH OTHER TRADES FOR EXACT LOCATION.
	CONDUIT SLEEVE: NUMBER AND SIZE, (2) 2" - FOR ALL CLASSROOMS, (1) 2" - FOR ALL OFFICES. UNO
IMPORTANT:	
CABLE SYSTEM FOR CONTROLS, PA, PHONE, AND DATA MAY BE ROUTED IN CABLE TRAY, EXCEPT WHEN LOCATED IN AREAS WITHOUT CEILINGS, EXPOSED, OR SUBJECT TO DAMAGE, IN WHICH CASE THE SYSTEM WILL BE REQUIRED TO BE RUN IN CONDUIT.	

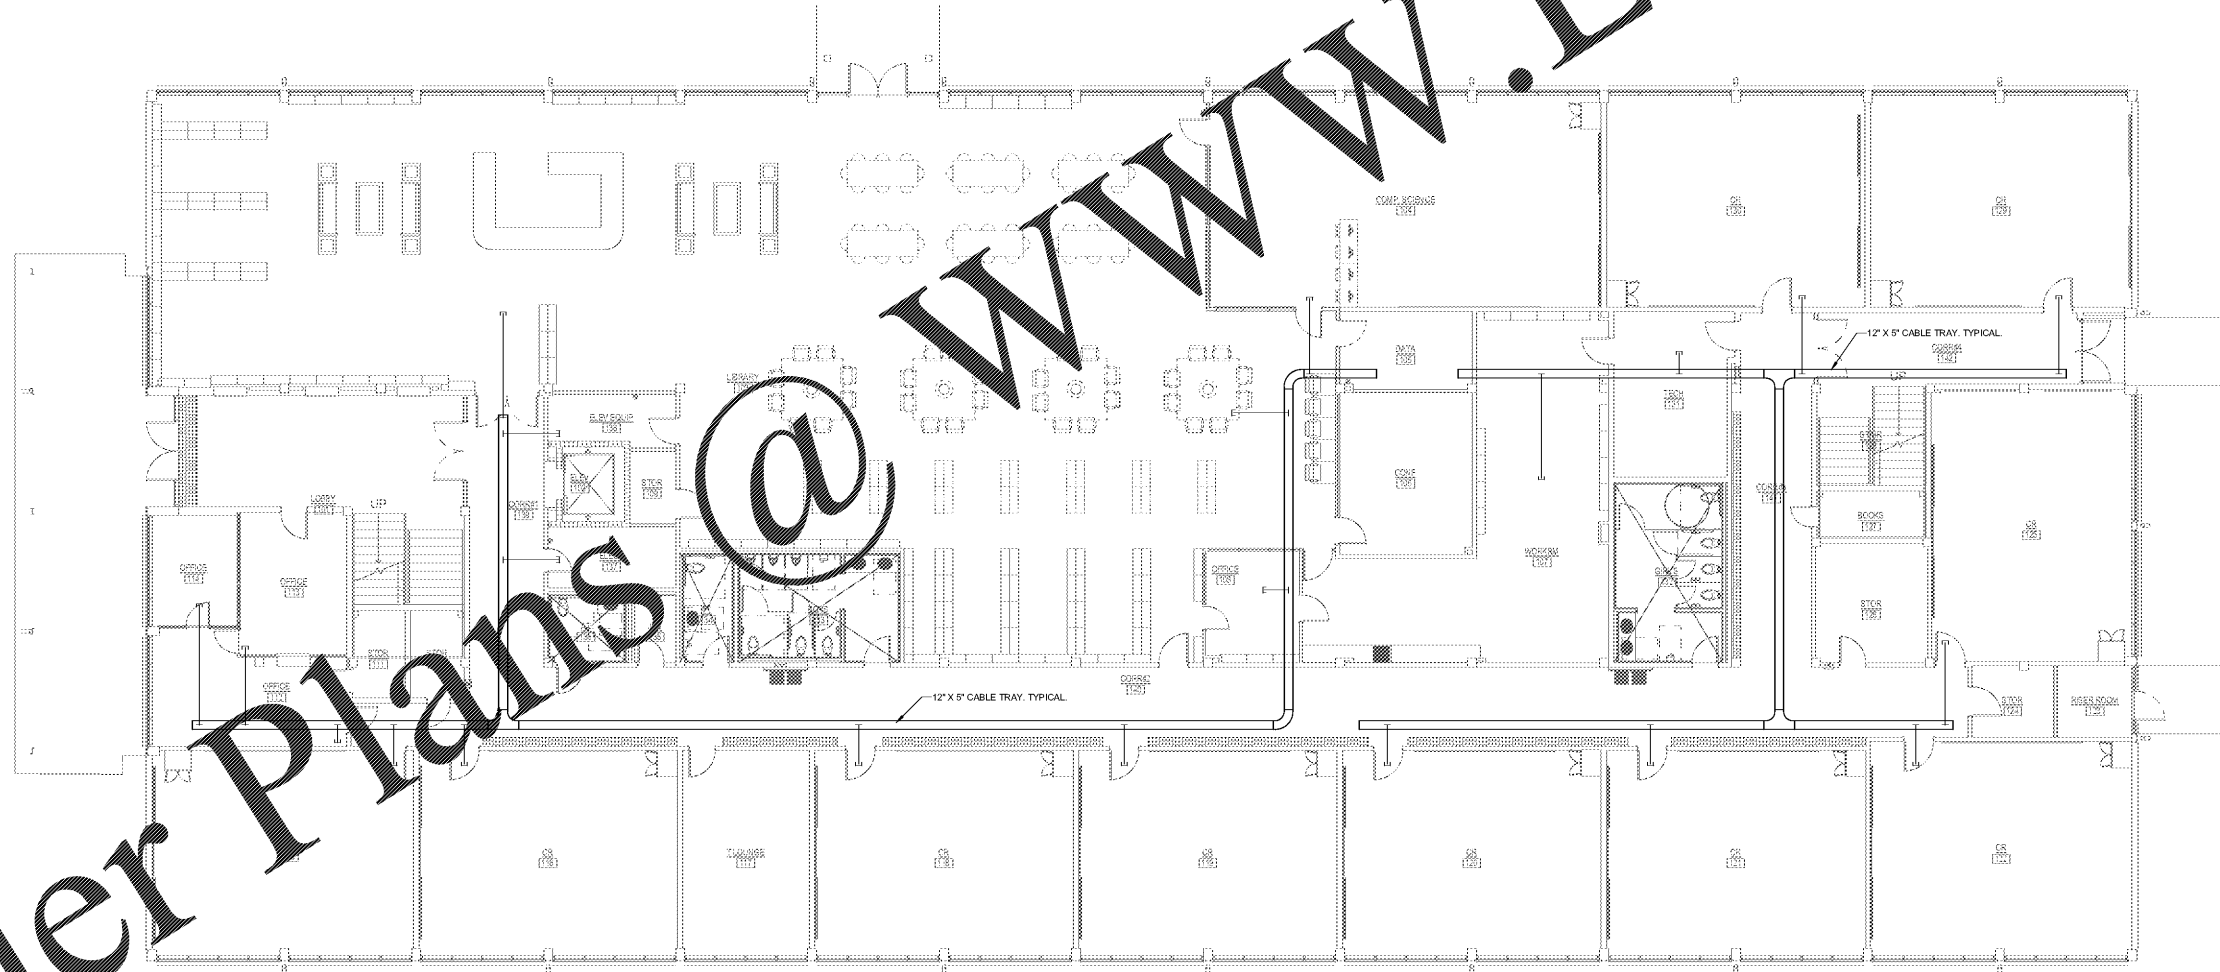


2 CABLE PATHWAY PLAN - LEVEL 1
E3.21 SCALE: 1/8" = 1'-0"

JOHN A. TUTTEN & ASSOCIATES
ARCHITECTS
4680 U.S. HIGHWAY 17 NORTH
BRUNSWICK, GEORGIA 31520
www.jtat.com

GLYNN ACADEMY HIGH SCHOOL
SCIENCE BLDG. (5015) MODERNIZATION
1001 MANSFIELD ST. BRUNSWICK GA, 31520
GLYNN COUNTY BOARD OF EDUCATION

CAPITAL OUTLAY
PROJECT # TBD
SYSTEM CODE: 668
SCHOOL CODE: 4752
FTE: 1793

CABLE PATHWAY PLAN - LEVEL 1



ISSUED FOR:
BID SET

JV, MP
DRAWN BY
DPCE
CHECKED BY
DJP
APPROVED BY
01/19/19
PROJECT NO.
1802
PROJECT NUMBER

SHEET
NUMBER:
E3.21

dpce DON PENN CONSULTING ENGINEER
1001 BELLANA BLVD.
SUITE 110
WESTLAKE, TX 79082
© 1977-2019
All Rights Reserved.

1/15/2019 4:13:41 PM C:\Users\jvaldez\Documents\17-2015_GA_SCIENCE BUILDING MEPV2016_jvaldez.EDW

Order Plans @ WWW.LDILine.com