
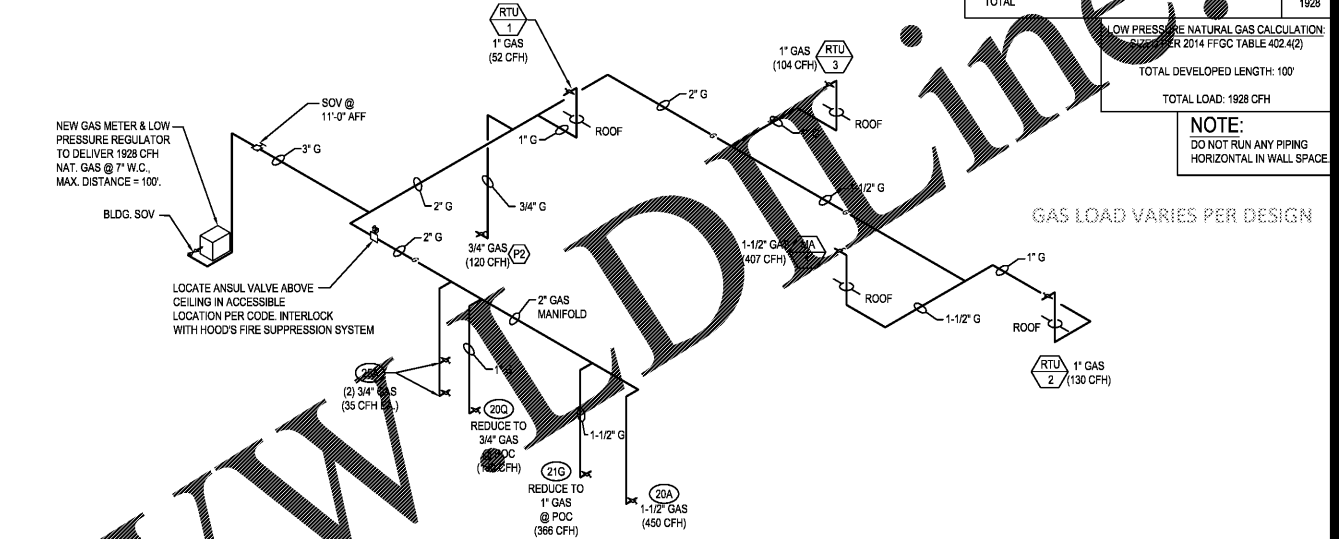


WATER RISER DIAGRAM 11
NO SCALE P-400



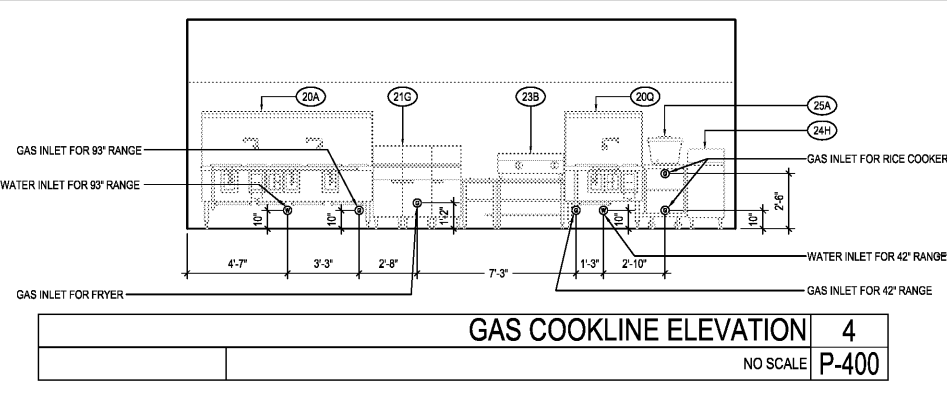


GAS EQUIPMENT SCHEDULE					
ITEM	QTY	EQUIPMENT	CFH		
			EACH	EACH	TOTAL
(P2)	1	WATER HEATER	120	120	120
(20A)	1	CHINESE RANGE	450	450	450
(20C)	1	CHINESE RANGE	190	190	190
(21C)	3	DEEP FRYER	122	122	366
(25A)	2	RICE COOKER	35	35	70
MAU-1	1	MAKE-UP AIR	407	407	
RTU-1	1	AIR CONDITIONER	65	65	65
RTU-2	1	AIR CONDITIONER	130	130	130
RTU-3	1	AIR CONDITIONER	130	130	130
TOTAL					1928

LOW PRESSURE NATURAL GAS CALCULATION
NUMBER 2014 FFGC TABLE 402.4(2)
TOTAL DEVELOPED LENGTH: 100'
TOTAL LOAD: 1928 CFH

NOTE:
DO NOT RUN ANY PIPING HORIZONTAL IN WALL SPACE

GAS RISER DIAGRAM 3
NO SCALE P-400

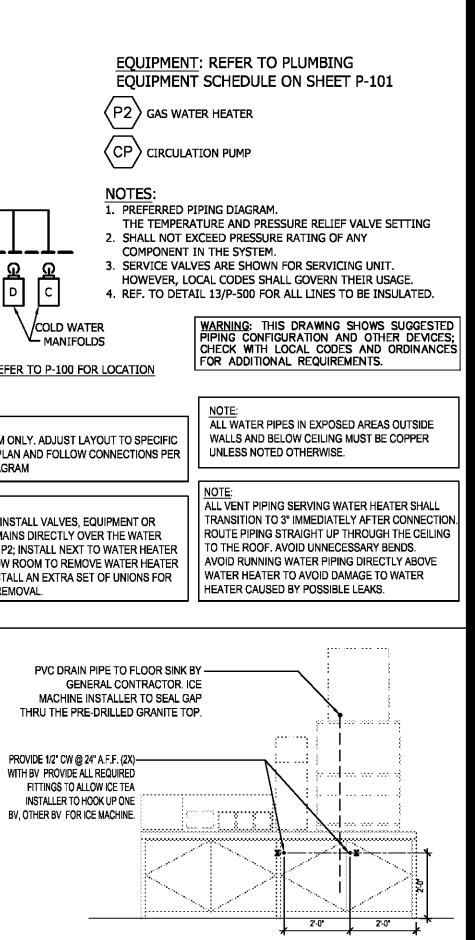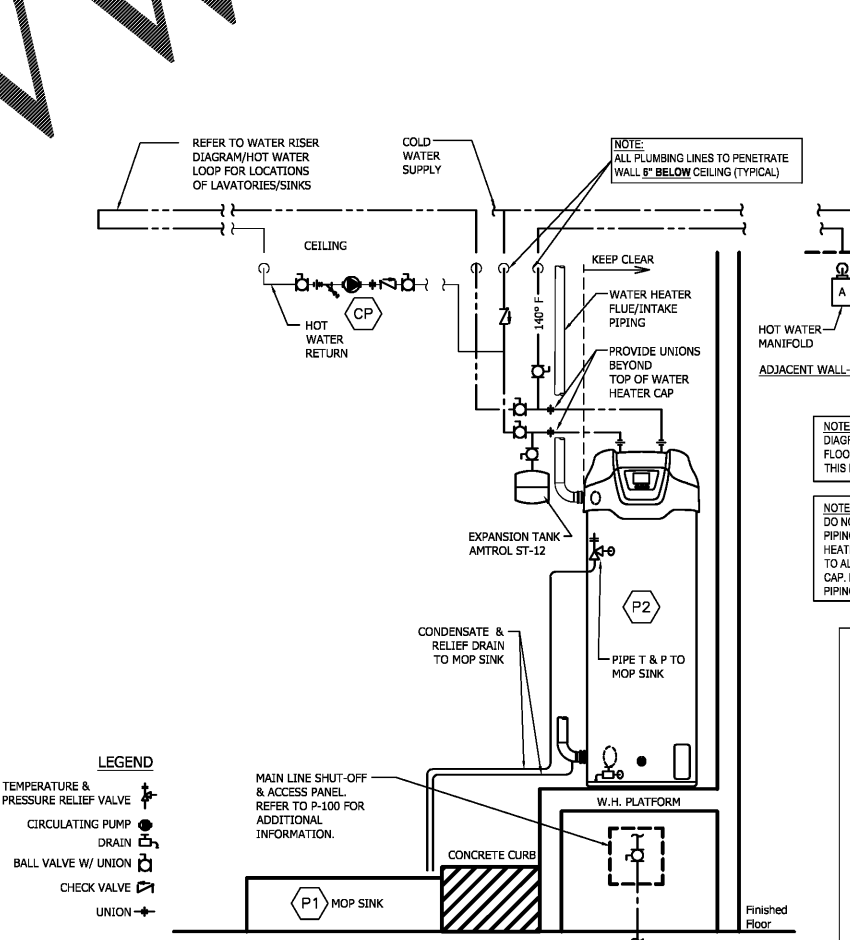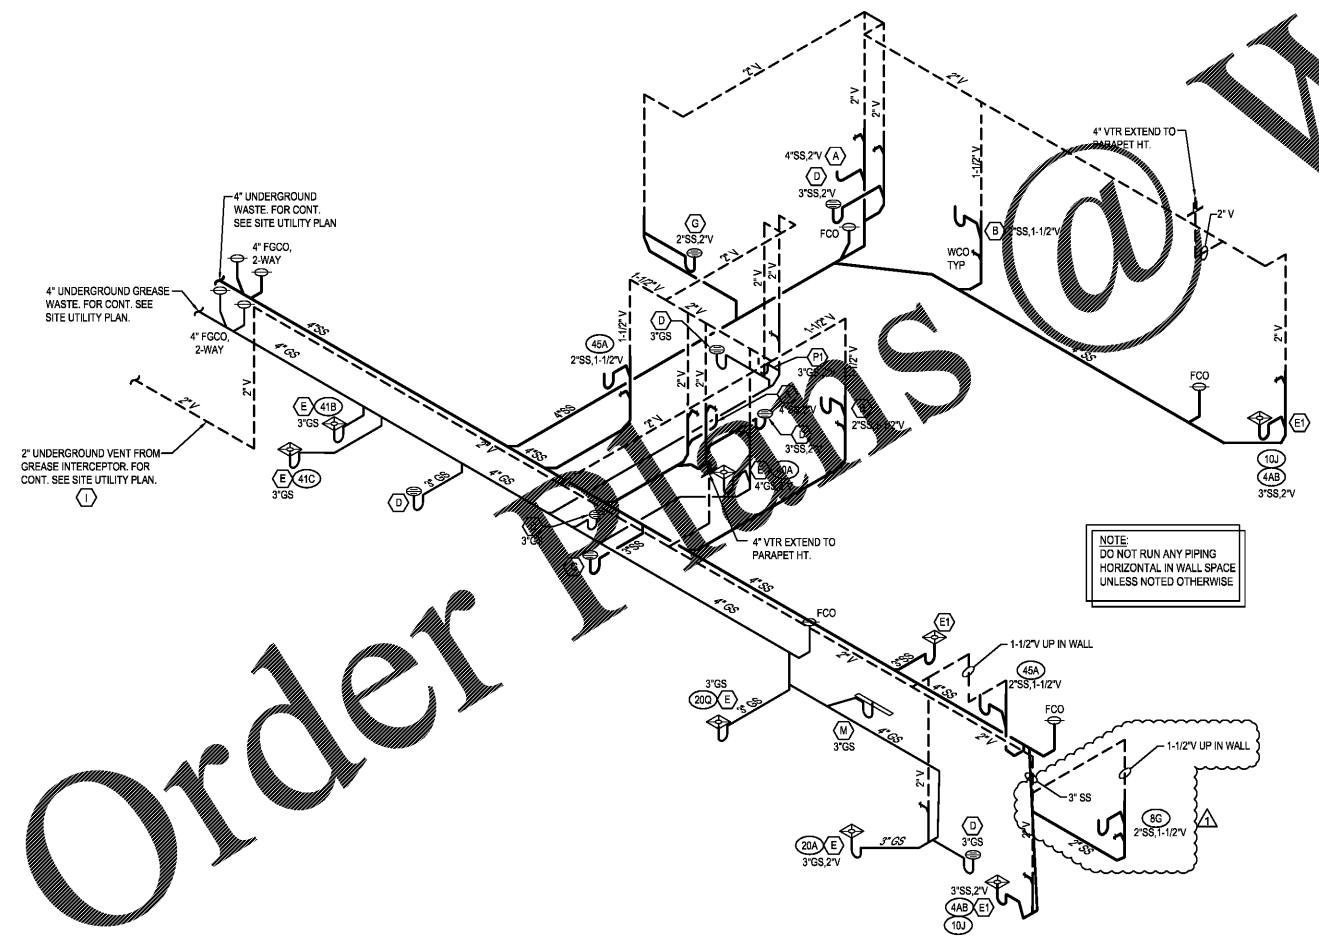

WASTE AND VENT RISER DIAGRAM 9
NO SCALE P-400

HOT WATER SYSTEM DIAGRAM 5
NO SCALE P-400

DRINK STATION PLUMBING 1
NO SCALE P-400



PANDA RESTAURANT GROUP INC.
1683 Walnut Grove Ave.
Rosemead, California
91770
Telephone: 626.799.9898
Facsimile: 626.372.8288


All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:

NO.	DESCRIPTION	DATE
1	ISSUED FOR BID & PERMIT	12-11-18
2	BID SET	01-30-19

ISSUE DATE:

DRAWN BY: SJM
PANDA PROJECT #: S8-19-D6573
ARCH PROJECT #: P7336



PANDA EXPRESS
WARM & WELCOME 2200
ATLANTIC BLVD & MARKETPLACE DR
JACKSONVILLE, FL 32225

P-400

WATER, GAS, WASTE & VENT RISER DIAGRAMS

TRUE WARM & WELCOME 2200