



PANDA RESTAURANT GROUP INC.  
1683 Walnut Grove Ave.  
Rosemead, California  
91770  
Telephone: 626.799.9898  
Facsimile: 626.372.8286

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:

NO.	DESCRIPTION	DATE

ISSUE DATE:

1	ISSUED FOR BID & PERMIT	12-11-18
2	BID SET	01-30-19

DRAWN BY: SJM

PANDA PROJECT #: S8-19-D6573

ARCH PROJECT #: P7336



**PANDA EXPRESS**  
WARM & WELCOME 2200  
ATLANTIC BLVD & MARKETPLACE DR  
JACKSONVILLE, FL 32225

**M-401**

HOOD DETAIL PLAN

TRUE WARM & WELCOME 2200

**REVISIONS**

NO.	DESCRIPTION	DATE

**REVISIONS:**


ISSUE DATE:

1	ISSUED FOR BID & PERMIT	12-11-18
2	BID SET	01-30-19

DRAWN BY: SJM

PANDA PROJECT #: S8-19-D6573

ARCH PROJECT #: P7336

3002 Dow Ave., Suite 410, Turin, CA 92780 PHONE: (714) 957-1500 FAX: (818) 227-5975 EMAIL: [top88@cphveano.com](mailto:top88@cphveano.com)

**CAPTIVE**

Southern California Office

Panda Express - Jacksonville FL (D6573)

DATE: 11/26/2018

DWG.#: 3627099


DRAWN BY: AHJ-86

SCALE: 3/4" = 1'-0"

MASTER DRAWING

SHEET NO. 2

**TYPICAL CONTROL PANEL WALL UTILITY CABINET MOUNT INSTALLATION WITH FIRE SUPPRESSION SYSTEM**

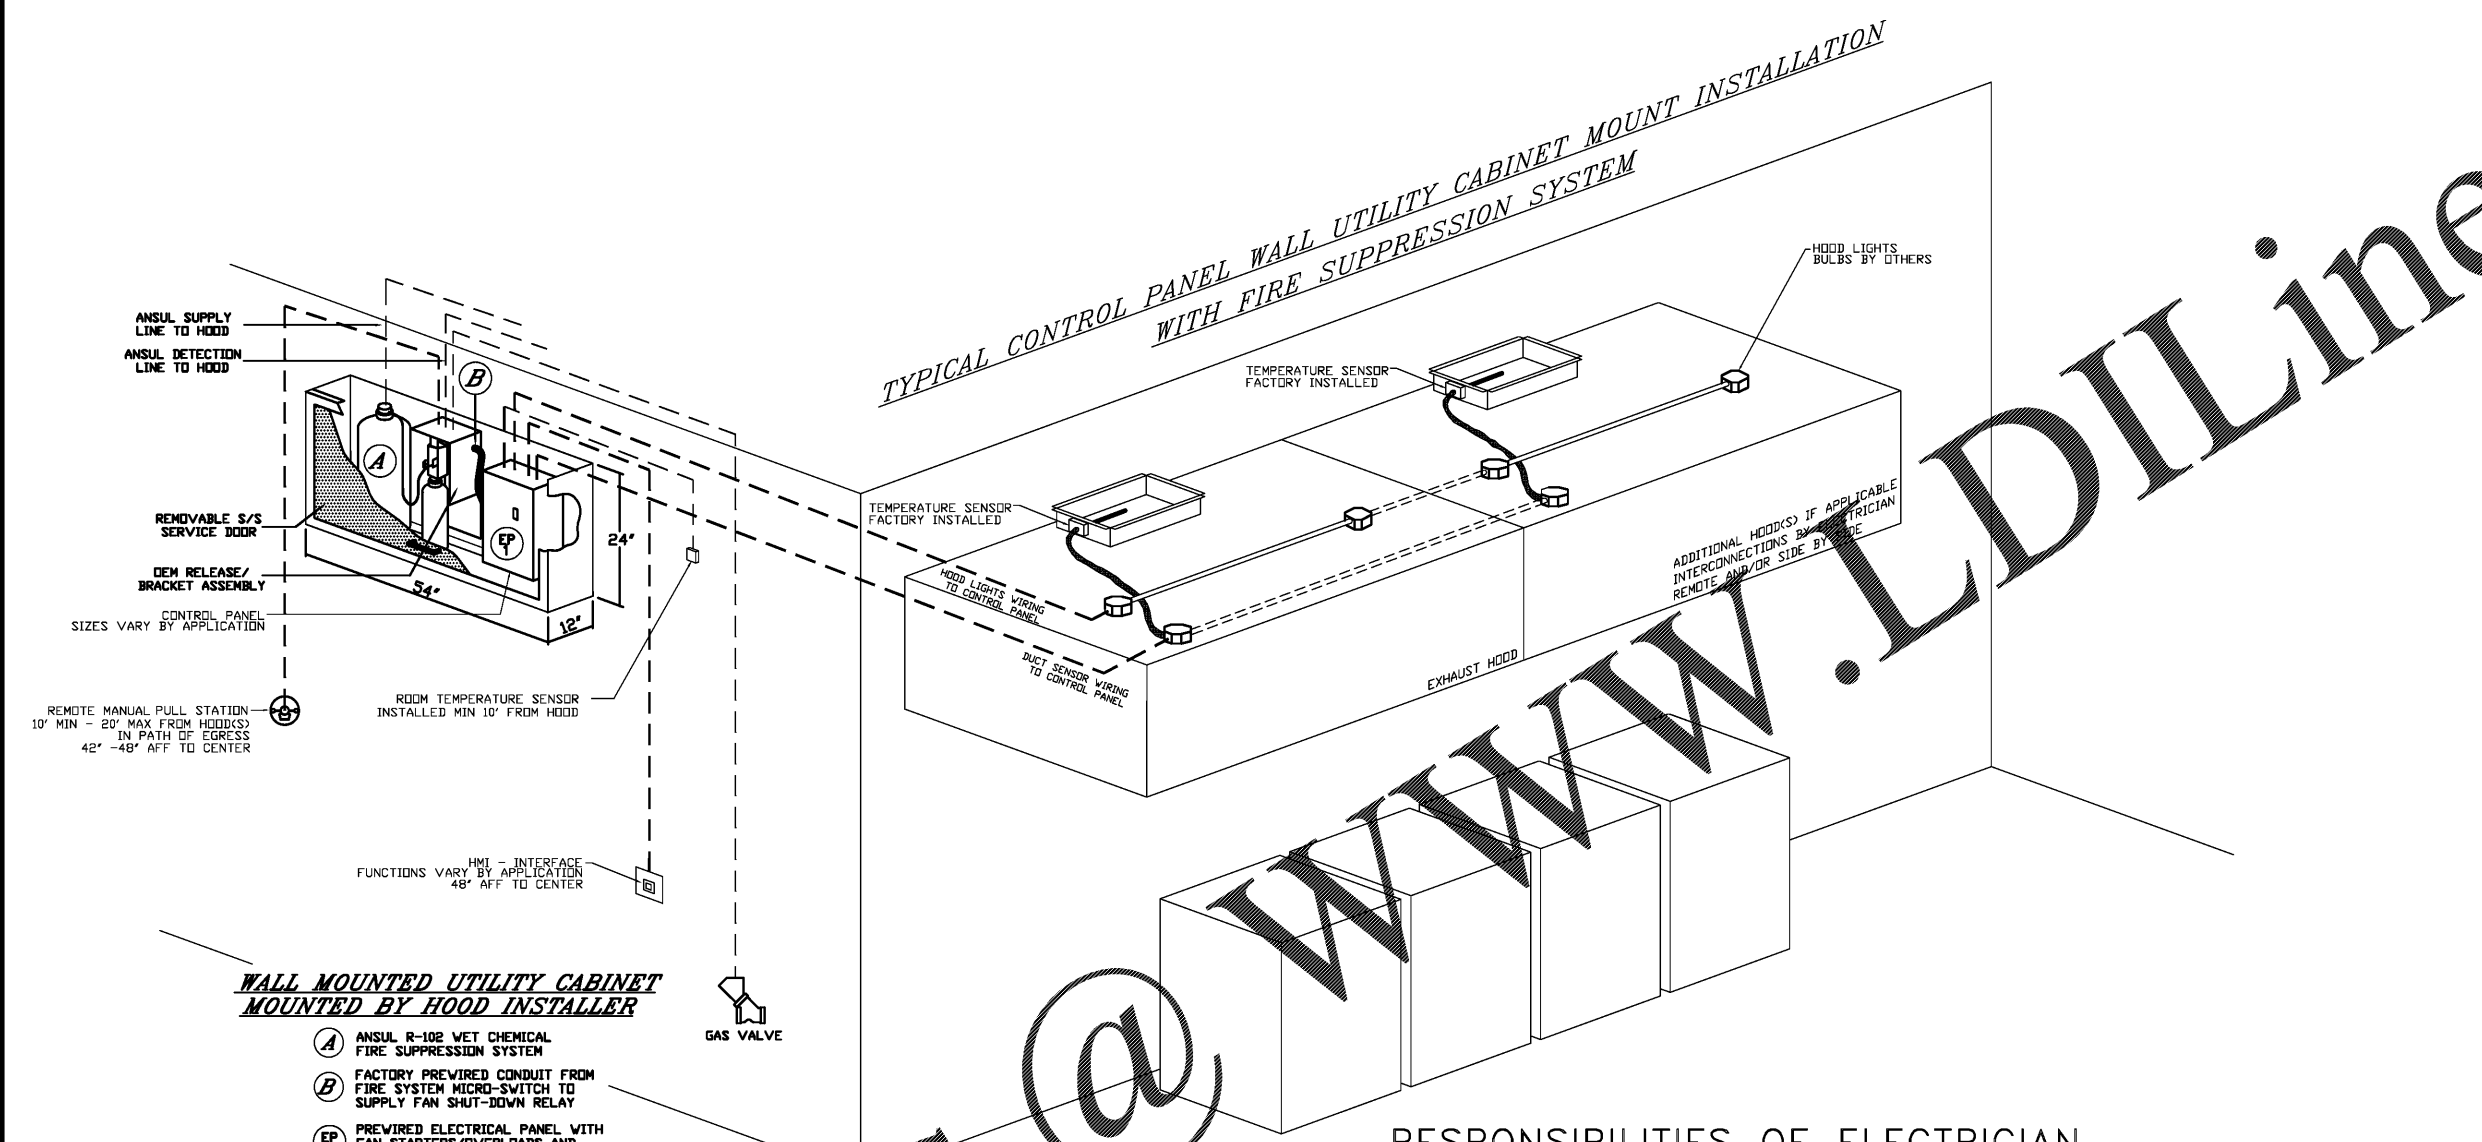

**WALL MOUNTED UTILITY CABINET MOUNTED BY HOOD INSTALLER**

- (A) ANSUL R-102 WET CHEMICAL FIRE SUPPRESSION SYSTEM
- (B) FACTORY PREWIRED CONDUIT FROM FIRE SYSTEM MICRO-SWITCH TO SUPPLY FAN SHUT-DOWN RELAY
- (EP) PREWIRED ELECTRICAL PANEL WITH FAN STARTERS/OVERLOADS AND SUPPLY FAN SHUT-DOWN RELAY.

**RESPONSIBILITIES OF ELECTRICIAN**

1. WIRE 120V FROM MAIN PANEL TO CONTROL PANEL
2. WIRE LIGHT FIXTURES BETWEEN HOOD(S) & BACK TO CONTROL PANEL
3. WIRE TEMPERATURE SENSOR(S) FROM EXHAUST COLLARS TO CONTROL PANEL
4. MOUNT & WIRE ROOM SENSOR TO CONTROL PANEL
5. WIRE FAN POWER FROM MAIN PANEL THROUGH CONTROL PANEL TO FAN(S)
6. WIRE SHUNT COIL TO CONTROL PANEL
7. WIRE GAS VALVE (IF APPLICABLE) TO CONTROL PANEL (120V FROM CONTROL PANEL)

**ADDITIONAL RESPONSIBILITIES IF APPLICABLE**

1. IF MULTIPLE FIRE SYSTEMS ON SINGLE CONTROL PANEL, THE FOLLOWING MUST OCCUR
  - A. ANSUL AUTOMAN MICROSWITCHES TO BE WIRED IN SERIES BACK TO CONTROL PANEL
  - B. ANSUL CATRIDGE MICROSWITCHES TO BE WIRED IN SERIES BACK TO CONTROL PANEL

**RESPONSIBILITIES OF ALARM CONTRACTOR**

1. WIRE ANSUL ALARM MICROSWITCH TO BUILDING ALARM PANEL

\*TERMINAL BLOCK WIRING DETAILS CAN BE FOUND ON ELECTRICAL WIRING DIAGRAMS\*

Order Plans @ [www.ldilines.com](http://www.ldilines.com)