

Enclosed Safety Switches General Duty Safety Switches

Table 9: Fusible Safety Switch Short Circuit Current Rating

Fuse Class	UL Listed Short Circuit Rating
Plug	10 kA
H, K	10 kA
J, R	100 kA
T ²	100 kA

1 Only applicable to 200-600 A except D325NT, D325NTR, D326NT and D326NTR.
2 Only applicable to D325NT, D325NTR, D326NT, D326NTR, T327N and T327NR.

Table 10: Non-Fusible Safety Switch Short Circuit Current Rating

Fuse Class or Circuit Breaker Type 1	UL Listed Short Circuit Rating
Any Brand Circuit Breaker	10 kA
H or J PowerPact Circuit Breaker	Up to 65 kA ²
H, K	10 kA
J, R	100 kA ³
T	100 kA ⁴

1 Ampere rating of fuse or circuit breaker not to exceed switch ampere ratings.
2 Only applicable to DU324 and DU324NRB. HD, JD = 25 kA maximum.
3 SCCR = 50 kA, applicable to DU222RB, DU322, DU322RB.
4 Only applicable to DU323, DU323RB, DU325 and DU326.

Standards

General duty safety switches are manufactured in accordance with these standards:

- UL 98, Standard for Enclosed and Dead Front Switches. UL Listed File E2875
- NEMA Standards Publication KS1, Enclosed Switches
- Federal Specifications WS-865c for Type NDS (Type 1) and Type LD (Type 3R)

Table 11: Terminal Lug Data 1

Ampere Rating	Conductors Per Phase	Wire Range Wire Bending Space Per NEC® Table 312.6 AWG/kcmil	Lug Wire Range AWG/kcmil
30 ²	1	12-8 (Al) or 14-8 (Cu)	12-8 (Al) or 14-8 (Cu)
30	1	12-6 (Al) or 14-6 (Cu)	12-6 (Al) or 14-6 (Cu)
60	1	12-3 (Al) or 14-3 (Cu)	12-2 (Al) or 14-2 (Cu)
100	1	12-1 (Al) or 14-1 (Cu)	12-1/0 (Al) or 14-1/0 (Cu)
200	1	6-250 (Al/Cu)	6-300 (Al/Cu)
400	1 or 2	1/0-600 (Al/Cu) or 1/0-300 (Al/Cu)	(1) 1/0-750 (Al/Cu) or (2) 1/0-300 (Al/Cu)
400	2	1/0-250 (Al/Cu)	(1) 1/0-600 (Al/Cu) or (2) 1/0-250 (Al/Cu)
600	2	4-500 (Al/Cu)	4-600 (Al/Cu)
800	3	3/0-500 (Al/Cu)	3/0-500 (Al/Cu)

1 30-100 A switches suitable for 60°C (140°F) or 75°C (167°F) conductors. 200-600 A switches suitable for 75°C (167°F) conductors.
2 Light duty switches only.

Heavy Duty Enclosed Safety Switches General Information



Table 44: Terminal Lug Data 1

Rating (A)	Wires Per Phase and Neutral	Wire Range Wire Bending Space Per NEC Table 312.6 AWG/kcmil	Lug Wire Range AWG/kcmil	Optional 2 Versa-Crimp™ Compression Lug Field-Installed	Optional 3 Versa-Crimp™ Compression Lug Field-Installed 2
30	1	12-8 (Al) or 14-8 (Cu)	12-2 (Al) or 14-2 (Cu)		
60 ¹	2	12-6 (Al) or 14-6 (Cu)	12-2 (Al) or 14-2 (Cu)		
100 ¹	1	12-3 (Al) or 14-3 (Cu)	12-2 (Al) or 14-2 (Cu)	VCEL02114S1	VCEL030214S1
200 ¹	1	6-250 (Al/Cu)	6-300 (Al/Cu)	VCEL030218H1	VCEL030218H1
400 ¹	1 or 2	1/0-600 (Al/Cu) or 1/0-300 (Al/Cu)	1/0-750 (Al/Cu) or 1/0-300 (Al/Cu)	VCEL030218H1 ¹⁰ or VCEL030918H1 ¹⁰	VCEL030218H1 ¹⁰ or VCEL030918H1 ¹⁰
600	2	4-500 (Al/Cu)	4-600 (Al/Cu)	VCEL030218H1	VCEL030218H1
800	3	3/0-500 (Al/Cu)	3/0-500 (Al/Cu)	H12X2E 11	H12X2E 11
1200	4	3/0-750 (Al/Cu)	3/0-750 (Al/Cu)	H12X2E 12	H12X2E 12

1 This table is for 60°C (140°F) or 75°C (167°F) conductors. 200-1200 A switches suitable for 75°C (167°F) conductors.
2 Versa-Crimp™ is a registered trademark of the Square D Company.
3 For Type 1 and 2 switches, use 30 AWG copper wire for 30 A rating, 40 AWG copper wire for 60 A rating, 50 AWG copper wire for 100 A rating, 60 AWG copper wire for 200 A rating, 80 AWG copper wire for 400 A rating, 100 AWG copper wire for 600 A rating, and 120 AWG copper wire for 800 A rating.
4 Order C10-14 and E10-14 from Thomas and Betts.
5 H500FA and H1000FA are 12-1/2" long. H1500FA is 15" long. H1500FA is 15" long. H1500FA is 15" long. H1500FA is 15" long.
6 H1000FA and H1500FA are 12-1/2" long. H1500FA is 15" long. H1500FA is 15" long. H1500FA is 15" long.
7 H225A30 and H225A30 are 12-1/2" long. H225A30 is 15" long. H225A30 is 15" long. H225A30 is 15" long.
8 Maximum wire bending space allows for (1) 300 kcmil or (2) 300 kcmil Al/Cu on Type 44XUS stainless steel and Type 12 switches.
9 For Type 1 and 2 switches, use 30 AWG copper wire for 30 A rating, 40 AWG copper wire for 60 A rating, 50 AWG copper wire for 100 A rating, 60 AWG copper wire for 200 A rating, 80 AWG copper wire for 400 A rating, 100 AWG copper wire for 600 A rating, and 120 AWG copper wire for 800 A rating.
10 For 600 and 1200 A compression lug kits, see Table 57 on page 54 for additional information.


GENERAL ELECTRICAL NOTES

- DRAWINGS ARE DIAGRAMMATIC & ARE NOT TO BE SCALED. SEE THE ARCHITECTURAL PLANS & FIELD VERIFY CONDITIONS FOR DIMENSIONS.
- ALL ELECTRICAL WORK SHALL COMPLY WITH THE EDITION OF NFPA 70-NATIONAL ELECTRIC CODE (NEC) AS NOTED ON THE CODE SUMMARY SHEET.
- ALL WIRING SHALL BE IN CONDUIT, EXCEPT THAT MC-CABLE MAY BE SUBSTITUTED ONLY AS FOLLOWS:
 - MC-CABLE (MAXIMUM CABLE LENGTH OF 10'-0") MAY BE INSTALLED ONLY FOR BRANCH CIRCUIT WIRING TO LIGHT FIXTURES.
 - MC-CABLE (MAXIMUM CABLE LENGTHS SHOWN ON DETAIL 2/E2) MAY BE INSTALLED ONLY ABOVE SLAB AND ONLY AT LOCATIONS INDICATED ON SHEET E2.
- FEEDER CONDUIT SHALL BE IMC OR RGS ABOVE GRADE & PVC BELOW GRADE WITH IMC OR RGS ELLS & RISERS. INTERIOR BRANCH CIRCUIT CONDUIT SHALL BE ELECTRICAL METALLIC TUBING. EXTERIOR BRANCH CIRCUIT CONDUIT SHALL BE PVC BELOW GRADE WITH IMC OR RIGID GALVANIZED STEEL CONDUIT CONTINUING ABOVE GRADE. (SPEC 26 05 33)
- COORDINATE ALL WORK WITH OTHER TRADES TO AVOID CONFLICTS. COORDINATION DOES NOT MEAN "I WAS HERE FIRST."
- ALL WIRING IN FINISHED SPACES SHALL BE CONCEALED, UNLESS NOTED OTHERWISE.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR INSTALLING A COMPLETE & FUNCTIONAL SYSTEM IN ACCORDANCE WITH THE INTENT OF THE PLANS, WHETHER OR NOT EVERY ELEMENT THEREOF IS SPECIFICALLY CALLED OUT.
- COORDINATE ALL EQUIPMENT ROUGH-IN CONNECTION REQUIREMENTS.
- ALL OUTLET BOXES SHALL BE METALLIC. (SPEC 26 05 34)
- ALL CAULKING ON BUILDING PENETRATIONS SHALL BE ELASTOMERIC POLYURETHANE (NO EXCEPTIONS), EQUAL TO "MULKEM" 116. ANY CONTRACTOR WHO USES SILICONE OR ANY OTHER CAULKING WILL BE REQUIRED TO REMOVE & REPLACE WITH ELASTOMERIC POLYURETHANE.
- RECEPTACLES INSTALLED IN RESTROOMS SHALL BE GFCI TYPE OR SHALL BE PROTECTED BY A GFI DEVICE.
- ALL DEVICES SHALL BE IVORY & SHALL BE EQUAL TO THE FOLLOWING:
 - SINGLE POLE SWITCHES ---
 - THREE-WAY SWITCHES ---
 - DUPLEX RECEPTACLE --- (SPEC 26 27 26)
 - GFCI DUPLEX RECEPTACLE ---
 - ISO. GRD. RECEPTACLES ---
- USE DEVICE PLATES MANUFACTURED BY THE DEVICE MANUFACTURER. (SPEC 26 27 26)
- FEEDER & BRANCH CIRCUIT CONDUCTORS SHALL BE COPPER, STRANDED, 600V THHN/THWN INSULATION. EXCEPTION: WIRE SIZES #10 AWG & SMALLER SHALL BE SOLID. (SPEC 26 05 19)
- CONTRACTOR SHALL PROVIDE A TYPED CIRCUIT DIRECTORY FOR ALL PANELS. (SPEC 26 05 53)
- CONTRACTOR SHALL PROVIDE A ONE(1) YEAR WARRANTY ON ALL WORK PERFORMED.
- CONTRACTOR SHALL PROVIDE NEW WORKING LAMPS IN ALL LIGHT FIXTURES AT JOB COMPLETION.
- CONTRACTOR SHALL COORDINATE WITH & SHALL INCLUDE ALL FEES FOR THE SERVING "ELECTRIC UTILITY CO." TO PROVIDE ELECTRIC SERVICE AS SHOWN. CONTRACTOR SHALL ALSO INCLUDE ALL FEES FOR THE "SERVING PHONE COMPANY" TO INSTALL NO LESS THAN 10 PAIR CABLE TO BUILDING.
- CONTRACTOR SHALL ARRANGE FOR & INCLUDE ALL PERMITS & FEES FOR HIS SCOPE OF WORK.
- CONTROL WIRING BY HVAC CONTRACTOR. FINAL CONNECTIONS BY HVAC CONTRACTOR. SEE SHEET M1.
- APPROVED MANUFACTURERS:
 - PANELBOARDS & SAFETY SWITCHES (DISCONNECTS):
 - "SQUARE D"
 - "G.E."
 - "SEIMENS"
 - "CUTLER-HAMMER"
 - DEVICES:
 - "HUBBELL"
 - "LEVITON"
 - "PASS & SEYMOUR"
 - "HUBBELL"
 - FLOOR BOXES:
 - "STEEL CITY"
 - "APPLETON"
 - "HUBBELL"
- MULTIWIRE BRANCH CIRCUITS WITH A "SHARED NEUTRAL" ARE NOT ALLOWED FOR SINGLE PHASE CIRCUITS.

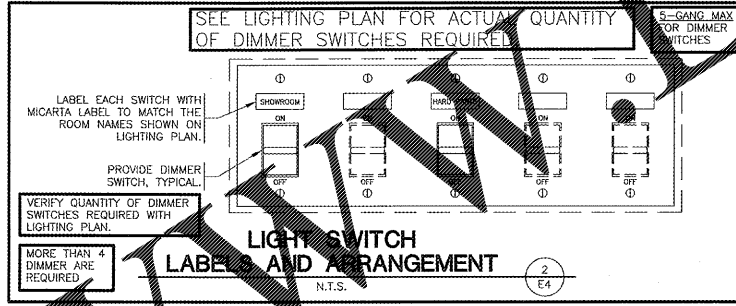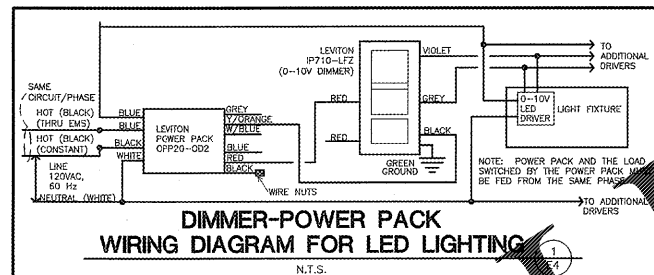

ELECTRICAL SYMBOL LEGEND & ABBREVIATIONS

- ⊠ SINGLE POLE SWITCH
- ⊡ TWO POLE SWITCH
- ⊢ THREE-WAY SWITCH
- ⊣ MOTOR STARTING SWITCH WITH PILOT LIGHT
- ⊤ CLASS 1, DIVISION 1 HAZARDOUS LOCATION RATED SWITCH ASSEMBLY
- ⊥ WALL MOUNTED OCCUPANCY SENSOR EQUAL TO "SENSORSWICH WSX D"
- ⊦ WALL MOUNTED OCCUPANCY SENSOR EQUAL TO "SENSORSWICH WSX 2P FAN-IV" CONTRACTOR SHALL DISABLE MANUAL SWITCHES PER MANUFACTURERS INSTRUCTIONS. SWITCH SHALL BE FULLY AUTOMATIC.
- ⊧ FAN SPEED SWITCH (SUPPLIED BY HVAC CONTRACTOR / INSTALLED BY ELECTRICAL CONTRACTOR)
- ⊨ 0-10V LED DIMMER SWITCH, EQUAL TO "LEVITON, IP710-1FZ". SEE DETAILS THIS SHEET (5-GANG MAX)
- ⊩ LEVITON POWER PACK OP20-002
- ⊪ SINGLE RECEPTACLE
- ⊫ DUPLEX RECEPTACLE
- ⊬ ISOLATED GROUND DUPLEX RECEPTACLE. DEVICES AND COVERPLATE SHALL BE RED. SEE DETAIL 1/E3
- ⊭ DUPLEX RECEPTACLE. DEVICES AND COVERPLATE SHALL BE RED
- ⊮ ISOLATED GROUND DUPLEX RECEPTACLE. DEVICES AND COVERPLATE SHALL BE RED
- ⊯ QUADPLEX RECEPTACLE (TWO DUPLEX RECEPTACLES IN ONE 2-GANG BOX UNDER A SINGLE COVERPLATE)
- ⊰ EXISTING UNPOWERED DUPLEX RECEPTACLE
- ⊱ ISOLATED GROUND QUADPLEX RECEPTACLE (TWO ISO. GRD. DUPLEX RECEPTACLES IN ONE 2-GANG BOX UNDER A SINGLE COVERPLATE. DEVICES AND COVERPLATE SHALL BE RED
- ⊲ DUPLEX RECEPTACLE (CIRCUIT TO BE WIRED THRU OCCUPANCY SENSOR) INSTALL A PERMANENT LABEL ON EACH OUTLET STATING "SENSOR CONTROLLED OUTLET". SEE DETAIL ON SHEET E2
- ⊳ ABOVE-COUNTER GFCI (GROUND FAULT CIRCUIT INTERRUPTING) DUPLEX RECEPTACLE
- ⊴ WEATHER PROOF GFCI (GROUND FAULT CIRCUIT INTERRUPTING) DUPLEX RECEPTACLE. COVER TO PROVIDE WEATHER PROOF PROTECTION WITH CORD AND PLUG IN USE
- ⊵ TELE-POWER POLE
- ⊶ JUNCTION BOX
- ⊷ REMOTE PHOTO CONTROL
- ⊸ COMPUTER DATA OUTLET BOX.
- ⊹ TELEPHONE OUTLET BOX.
- ⊺ TELEPHONE OUTLET FLOOR BOX. SEE DETAIL 4/E2.
- ⊻ 4" SQUARE STEEL BOX MOUNTED FLUSH ON FLOOR W/QUADPLEX RECEPTACLE (SEE ABOVE RECEPTACLE DESCRIPTION). SEE DETAIL 4/E2 FOR INSTALLATION OF BOX.
- ⊼ 4" SQUARE STEEL BOX MOUNTED FLUSH ON FLOOR W/QUADPLEX ISOLATED GROUND RECEPTACLE (SEE ABOVE ISOLATED GROUND RECEPTACLE DESCRIPTION). SEE DETAIL 4/E2 FOR INSTALLATION OF BOX.
- ⊽ 4" SQUARE STEEL BOX MOUNTED FLUSH ON FLOOR W/QUADPLEX ISOLATED GROUND RECEPTACLE (SEE ABOVE ISOLATED GROUND RECEPTACLE DESCRIPTION). SEE DETAIL 4/E2 FOR INSTALLATION OF BOX. DEVICES AND COVERPLATE SHALL BE RED.
- ⊾ 2" x 4" RECTANGULAR STEEL BOX MOUNTED FLUSH ON FLOOR W/DUPLEX RECEPTACLE (SEE ABOVE RECEPTACLE DESCRIPTION). SEE DETAIL 4/E2 FOR INSTALLATION OF BOX
- ⊿ NEMA 15-30R -- SPECIAL RECEPTACLE
- ⓪ MOTOR
- Ⓛ FUSED DISCONNECT (SAFETY) SWITCH W/ SWITCH AMPACITY / FUSE AMPACITY AS INDICATED
- Ⓜ NON-FUSED DISCONNECT (SAFETY) SWITCH
- Ⓨ POWER OR LIGHTING PANEL W/PANEL DESIGNATION SHOWN ON PLAN (SIZES & MOUNTING INDICATED ON PLANS)
- Ⓩ 24 HOUR EGRESS & SECURITY LIGHT, WIRE DIRECT TO ELECTRIC PANEL AHEAD OF ANY LOCAL SWITCHES AND LIGHTING CONTROL PANEL
- ⓐ WALL/CEILING MOUNTED COMBINATION "EXIT/EMERGENCY" SIGN W/SHADING INDICATING FACES
- ⓑ EMERGENCY LIGHTING FIXTURE WITH BATTERY
- ⓓ FEEDING PANEL AND CIRCUIT NUMBER(S)
- ⓔ NOTE: EQUIPMENT GROUND CONDUCTOR NOT SHOWN
- ⓕ CIRCUIT CONDUCTORS
- ⓖ GROUNDING CIRCUIT CONDUCTOR (OR NEUTRAL)
- ⓗ MOTION DETECTOR - SEE EM SHEETS FOR MORE INFORMATION
- ⓘ OCCUPANCY SENSOR EQUAL TO "LEVITON, OSC20-MAW" WITH POWER PACK
- ⓙ LOCATED ABOVE COUNTER
- ⓚ ABOVE FINISHED FLOOR
- ⓛ BLOWER COIL UNIT
- ⓜ CONDENSING UNIT
- ⓝ EXHAUST FAN
- ⓞ ELECTRIC FURNACE
- ⓟ FURN GAS FURNACE
- ⓠ AIR HANDLER
- ⓡ HEAT PUMP UNIT
- ⓢ POWER PACK
- ⓣ PACKAGED ROOFTOP UNIT
- ⓤ INTERMEDIATE METALLIC TUBING
- ⓖ LIGHTING CONTRACTOR
- ⓗ MOTOR STARTING
- ⓙ RED IN COLOR DEVICES & COVERPLATE
- ⓚ MOTOR STARTING W/PILOT LIGHT
- ⓛ NIGHT LIGHT
- ⓜ PHOTOELECTRIC CONTROL
- ⓞ RIGID GALVANIZED STEEL
- ⓟ UN-POWERED OUTLET
- ⓠ TIME SWITCH
- ⓡ WALL OUTLET (46" AFF SEE MOUNTING HEIGHTS)
- ⓣ WEATHERPROOF (ENCLOSURE)
- ⓖ EXPLOSION PROOF ASSEMBLY
- ⓙ GROUND FAULT CIRCUIT INTERRUPT
- ⓜ ELECTRICAL METALLIC TUBING
- ⓞ CEILING MOUNTED

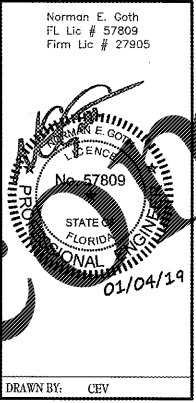

CRAIG A. SCHNEIDER, AIA
ARCHITECT

417.862.9588
417.862.3265
e-mail: architect@esterychneider.com

1730 East Sunshine, Suite 417
Springfield, Missouri 65804

PROJECT:
NEW O'REILLY AUTO PARTS STORE
1345 15TH STREET
PANAMA CITY, FL #1

O'Reilly AUTO PARTS
CORPORATE OFFICES
SPRINGFIELD, MISSOURI 65802
(417) 862-2674 TELEPHONE

COMM # 4275
DATE: 01-04-19
REVISION
DATE:



335 S. JEFFERSON AVE. P: 417-862-2900
SPRINGFIELD, MO 65807 F: 417-862-1188
WWW.SMITHGOTH.COM

E4 of 4