


1 FLOOR PLAN
 A1 1/8" = 1'-0"

#	DOOR PANEL		FRM	TH	HOW SET	REMARKS	KICK	
	W	H					PUSH	PULL
AP3	3'-0"	2'-0"				8" BROWN DAVIS BMT CUSTOM HARDWARE COMP. FINISH		
CB	5'-0"	7'-0"	1 3/4"	A	ALUM	HW148 SEE DETAIL 9/11.1 SEE DETAIL 9/11.2	24"X24"	16"X35"
D1	4'-0"	7'-0"	1 3/4"	C	HM	HW10 SEE DETAIL 9/11.1 SEE DETAIL 9/11.2		
EL	3'-0"	6'-6"	1 3/4"	E	HM	HW10 SEE DETAIL 9/11.1 SEE DETAIL 9/11.2		
OF	3'-0"	6'-8"	1 3/4"	HM	HW12	4" ONE-WAY GLASS. SEE NOTES 10.1 AND 10.2. SEE DETAIL 9/11.1	LOOKSET	16"X34"
P6	3'-0"	6'-6"	1 3/4"	B	HM	SEE DETAIL 15/A8		
P7	3'-0"	7'-0"	1 3/4"	B	HM	SEE NOTES 10.8 & 11.1. SEE DETAIL 9/11.2	24"X24"	16"X35"
PT	3'-0"	7'-0"	1 3/4"	B	HM	BY REF. CO.		
R	3'-0"	7'-0"	1 3/4"	B	HM	BY REF. CO.		
R1	3'-0"	6'-6"	1 3/4"	A	ALUM	BY REF. CO.		
R2	4'-0"	6'-6"	1 3/4"	A	ALUM	BY REF. CO.		
R3	3'-0"	6'-6"	1 3/4"	A	ALUM	BY REF. CO.		
V1	3'-0"	7'-0"	1 3/4"	A	ALUM	NO HOLD OPENS (DBL DOOR)	PUSH BAR	
V2	3'-0"	7'-0"	1 3/4"	A	ALUM	NO HOLD OPENS	PUSH BAR	
V3	3'-0"	7'-0"	1 3/4"	A	ALUM	NO HOLD OPENS	PUSH BAR	
V4	3'-0"	7'-0"	1 3/4"	A	ALUM	NO HOLD OPENS	PUSH BAR	

DOOR NOTES

- DOOR #S SHOWN IN DOOR SCHEDULE ARE TYPICAL FOR WAWA STORES. VERIFY QUANTITIES AND WHICH DOORS ARE REQUIRED AS INDICATED IN FLOOR PLAN.
- SEE STOREFRONT MFR SPECIFICATIONS FOR VESTIBULE DOORS. DOORS ARE TO BE KEYPAD ALIKE WITH THUMB LATCH AND CLOSER AT ALL DOORS.
- ALL EXTERIOR HOLLOW METAL DOORS SHALL BE INSULATED DOORS.
- RUN CONTINUOUS BEAD OF CLEAR SILICONE CAULK AROUND ALL DOOR FRAMES.
- EXIT DOOR LOCKS, IF PROVIDED ON EGRESS DOORS, SHALL NOT REQUIRE THE USE OF A KEY, A TOOL, OR SPECIAL KNOWLEDGE OR EFFORT FOR OPERATION FROM THE EGRESS SIDE IN ACCORDANCE WITH IBC 2009 & 2012 - SECTION 1008.1.9 OR IBC 2015 1010.1.9 (AS APPLICABLE). A LATCH OR OTHER FASTENING DEVICE ON AN EGRESS DOOR SHALL BE PROVIDED WITH A HANDLE, PANIC BAR, OR OTHER SIMPLE TYPE OF RELEASING DEVICE HAVING AN OBVIOUS METHOD OF OPERATION UNDER ALL LIGHTING CONDITIONS. DOORS SHALL BE OPERABLE WITH NO MORE THAN ONE RELEASING OPERATION PER IBC 2009 & 2012 - SECTION 1008.1.9.5 OR IBC 2015 1010.1.9.5 (AS APPLICABLE).
- REFER TO HARDWARE SCHEDULE IN THE SPECIFICATION MANUAL.
- ALL GLAZING IN DOORS & SIDELIGHTS SHALL MEET THE REQUIREMENTS FOR SAFETY GLAZING AS REQUIRED IN IBC 2009, 2012 & 2015 - SECTION 2406.
- HARDWARE HEIGHTS - HANDLES, PULLS, LATCHES, LOCKS, AND OTHER OPERATING DEVICES ON DOORS SHALL BE INSTALLED 34" MINIMUM AND 48" MAXIMUM ABOVE THE FINISHED FLOOR.
- ACROVYN DOORS SHALL BE INSTALLED IN H.M. FRAMES PER SPECIFICATIONS AND TO BE FIELD COVERED WITH ACROVYN COVER.
- ALL FRAMES FOR ACROVYN DOORS SHALL BE CECO DOOR PRODUCTS, NO SUBSTITUTIONS. H.M. FRAMES FOR ACROVYN DOORS SHALL BE ORDERED THRU WILLIAM MCALIFFE, III ACH. SEE SPECIFICATIONS.
- THRESHOLD 'A' NOT TO EXCEED 1/2" HIGH INSTALLED.
- ALL DOORS, INTERIOR AND EXTERIOR SHOULD BE FULLY WELDED-NO K.D. FRAMES. ADD WOOD BLOCKING AROUND THE FRAMES. SEE DETAILS 9 AND 10A/11.2

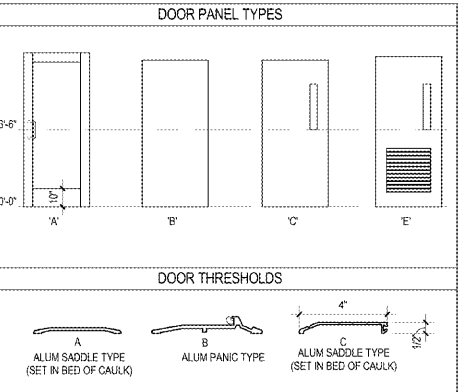

FLOOR PLAN LEGEND

	6" MTL STUDS W/ R-30 BATT INSULATION. FINISH WITH THIN BRICK AND STONE VENEER		DOOR TAG
	3-5/8" MTL STUDS W/ R11 BATT INSULATION. 1/2" GYPSUM BOARD, U.N.O.		BLOCKING IDENTIFICATION. SEE EQ. BLOCKING NOTES
	3-5/8" MTL STUDS W/ 1/2" GYPSUM BOARD, U.N.O.		TACTILE BRAILLE SIGN STATING 'EXIT' COMPLYING WITH ICC/ANSI A117.1
	3-5/8" MTL STUDS W/ 1/2" GYPSUM BOARD AND 1/2" PLYWOOD ON ELECTRICAL ROOM SIDE		FIRE EXTINGUISHER PROVIDE BLOCKING AS REQUIRED & COORDINATE FINAL LOCATION W/ FIRE MARSHAL
	6" MTL STUDS W/ 1/2" GYPSUM BOARD, U.N.O.		
	INSULATED MTL PANELS BY REFRIGERATION COMPANY		
	CONCRETE MASONRY UNIT (CMU)		

GENERAL NOTES

- EXTERIOR DIMENSIONS ARE FROM FACE OF PLYWOOD/CMU STEM WALL. INTERIOR DIMENSIONS ARE FROM FACE OF STUD, UNLESS NOTED OTHERWISE.
- ALL WALLS BEHIND WALK-IN REFRIGERATORS AND FREEZERS SHALL BE 1/2" DUROCK CEMENT BOARD TO HEIGHT OF 11'-0" A.F.F. FASTEN BOARDS TO STUDS @ 8" O.C. EA. WALL DUROCK FASTENERS EMBED ALKALI-RESISTANT TAPE IN THINSET OVER JOINTS.
- STOREFRONT TO BE DRY SET.
- PROVIDE 6" PVC TUBE WITH THREADED CAP, 36" IN LENGTH, MTD VERTICALLY TO WALL WITH METAL STRAPS, IN ELECTRICAL ROOM AS NOTED.

EQUIPMENT BLOCKING

#	ITEM	MAT'L	LOCATION & REMARKS
1	SHELVING @ 3 COMP. SINK	1/2" PLYWD	IN LIEU OF GWB. SEE ELEVATION
2	MOP HOLDER	2" X 6"	5'-8"
3	HAND DRYER	AS PER MFR	
4	HAND WASH SINK	2" X 6"	3'-5"
5	URINAL	AS PER MFR	
6	GRAB BARS	2" X 6"	2'-10" AND VERTICAL
7	MOP SINK SHELF	2" X 6"	6'-6"
8	TRASH BAG HOLDER	2" X 6"	2'-2" AND 4'-0"
9	TOILET PARTITIONS	AS PER MFR	
10	COAT HOOKS	2" X 12"	3'-10"
11	OFFICE SECURITY SHELF	2" X 10"	4'-0" & 5'-0" SEE DETAIL 10A/11
12	LOCKERS	2" X 12"	5'-5"
13	FUEL TANK MONITOR	2" X 12"	5'-5"
14	BEER COOLER SIGN	2" X 6"	8'-8" SEE DETAIL 5A/11
15	BEER COOLER SIGN	2" X 8"	10'-2" SEE DETAIL 16A/11.1
16	FIRE EXTINGUISHER	2" X 6"	3'-5"
17	POWER WASH HOSE HANGER	2" X 6"	3'-5" A.F.F.
18	CSR UNIT	5/8" PLYWD	IN LIEU OF GWB. FLR TO CLG
19	FULL SERVICE CUBBIES	2" X 6" & 2" X 10"	SEE DETAIL 6A/11.1
20	COFFEE AREA CUBBIES	2" X 6" & 2" X 10"	SEE DETAIL 7A/11.1
21	KPS MONITOR	2X8 (VERT.)	2'-6" UP TO 4'-0"
22	GOOSE LAMP SIGN	2" X 6"	8'-0" & 10'-9". RE. ELEVATION 5A/9
23	3 COMPARTMENT SINK	2" X 12"	2'-11" SEE ELEVATION
24	TRASH RECEPTACLE	AS PER MFR	
25	BAR CURTAIN	2" X 12"	ABOVE DOOR. RE. 8M2