


Order Plans

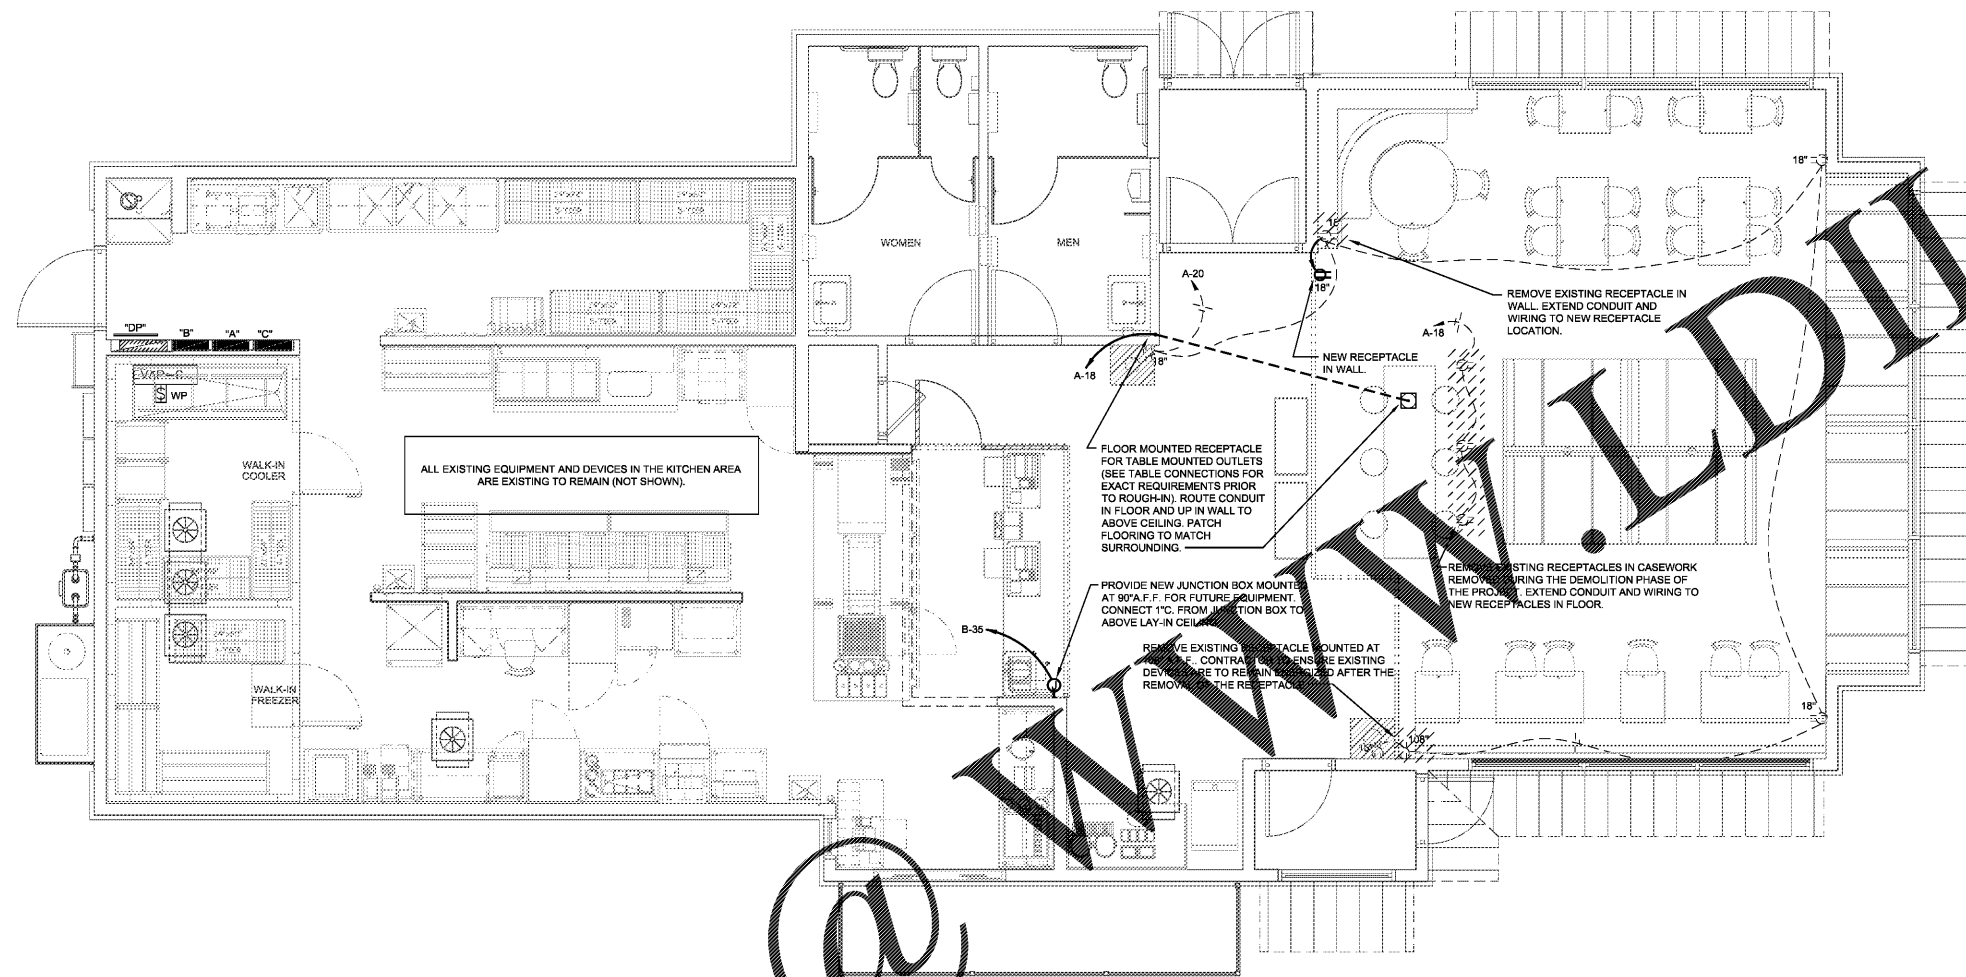

1 ELECTRICAL POWER PLAN & DETAILS
E2 1/4"=1'-0"

NOTE:
ALL DEVICES, WIRING AND CONDUIT ARE EXISTING TO REMAIN UNLESS OTHERWISE INDICATED AS NEW OR RELOCATED.

- GENERAL NOTES:**
- A. VERIFY MOUNTING HEIGHTS OF ALL RECEPTACLES WITH EQUIPMENT SUPPLIED PRIOR TO INSTALLATION.
 - B. ALL EQUIPMENT ELECTRICAL OUTLETS ARE DIMENSIONED TO CENTERLINE OF BOX FROM ABOVE FINISHED FLOOR.
 - C. ELECTRICAL CONTRACTOR TO PROVIDE CORD & PLUG CONNECTIONS FOR EQUIPMENT AS REQUIRED.
 - D. CONTRACTOR TO REMOVE AND REINSTALL ALL SECURITY DEVICES (GLASS BREAK DETECTORS, MOTION SENSORS, CAMERAS, ETC.) IN SAME LOCATION OF NEW CEILING. CONTRACTOR TO TAKE CARE WHILE REMOVING SO NOT TO DAMAGE DEVICE. ANY DAMAGE TO DEVICE DURING THE REMOVAL SHALL BE REPLACED AT CONTRACTOR'S EXPENSE.



REVISIONS:

POWER PLAN
DATE: **E2**
12/19/18
CHECKED: KR



Timothy A. Payne, PE
212 N. McDowell St. Suite 204
Charlotte, NC 28204
(P) 704.334.7563 (F) 704.347.0093
www.shultreg.com
SEC - 18-321

THESE PLANS AND SPECIFICATIONS HAVE BEEN PREPARED BY ME OR UNDER MY SUPERVISION AND TO THE BEST OF MY KNOWLEDGE COMPLY WITH ALL LOCAL, STATE AND FEDERAL REQUIREMENTS.