Door Hardware Schedule

HARDWARE SET	MFG.
HARDWARE SET #1	
PULL / LEVER: EXISTING / MATCH EXISTING	
LOCKSET: RE-KEY MATCH EXISTING CYLINDER	
HINGE: EXISTING	
CLOSER: EXISTING	
FINISH:	
COMMENTS: PUSH BUTTON ACCESS CONTROL TO RELEASE MAG LOCK IN CASE OF EMERGENCY. VERIFY MODEL # w/ MOUNTING LOCATION. VERIFY ELEC. ROMNTS w/ MFR SECURITRON EEB2 OR EEB3N MOTION SENSOR TO RELEASE MAG LOCK ABOVE DOOR.	
HARDWARE SET #2	
PULL / LEVER: 9" BACK TO BACK PULLS	COLUMBIA COMMERCIAL BUILDING
LOCKSET: SCHLAGE CYL. MS-1850S	ADAMS RITE
HINGE: ROLLERS / GUIDES	COLUMBIA
CLOSER: NONE	
FINISH: 26D	
HARDWARE SET #3	
PULL / LEVER: 30" HORIZ PUSH / 9" VERT PULL	COLUMBIA COMMERCIAL BUILDING
LOCKSET: NO STRIKE / NO LOCKSET	
HINGE: FLOOR MTD PVT	DORMA
CLOSER: EXPOSED U1500	DORMA
FINISH: 26D	
HARDWARE SET #4	
PULL / LEVER: 30" HORIZ PUSH / 9" VERT PULL	COLUMBIA COMMERCIAL BUILDING
LOCKSET: SCHLAGE CYL. MS-1850S	ADAMS RITE
HINGE: FLOOR MTD PVT	DORMA
CLOSER: EXPOSED U1500	DORMA
FINISH: 26D	
COMMENTS: NO LOCKSET FOR MULTI STALL RESTROOMS	
HARDWARE SET #5	
PULL / LEVER: LEVER HARDWARE	
LOCKSET: SCHLAGE CYL. MS-1850S	ADAMS RITE
HINGE: MORTISE HINGE	
CLOSER: EXPOSED U1500	DORMA
FINISH: 26D	
HARDWARE SET #6	
PULL / LEVER: PANIC BAR EXIT HARDWARE	
LOCKSET: SCHLAGE CYL. MS-1850S	ADAMS RITE
HINGE: MORTISE HINGE	
CLOSER: EXPOSED U1500	DORMA
FINISH: 26D	
HARDWARE SET #7	
PULL / LEVER: 12" VERTICAL PULL BOTH SIDES	CR LAURENCE
LOCKSET: MS 490 MAG LOCK	SCHLAGE
HINGE: FLOOR MTD PIVOT	DORMA
CLOSER: CONCEALED OVERHEAD RTS-88	DORMA
FINISH: 26D	
COMMENTS: SINGLE ACTION PUSH BUTTON ACCESS CONTROL TO RELEASE MAG LOCK IN CASE OF EMERGENCY. VERIFY MODEL # w/ MOUNTING LOCATION. VERIFY ELECTRICAL ROMNTS w/ MFR SECURITRON EEB2 OR EEB3N. MAG LOCK PROVIDED / INSTALLED BY SECURITY VENDOR.	

Door Schedule

DOOR TAG	ROOM NAME	DOOR TYPE	DOOR HDWR SET	DOOR WIDTH	DOOR HEIGHT	DOOR MAT'L	DOOR FINISH	DOOR RATING	FRAME HEAD	FRAME JAMB	FRAME THRSLD	FRAME MAT'L	FRAME FINISH	REMARKS
A	STOREFRONT	A	1	3'-0"	7'-0"	(E) ALUM	EXG		EXG	EXG	EXG	(E) ALUM	EXG	EXISTING STOREFRONT DOOR BY LANDLORD. PROVIDE NEW HARDWARE AS SCHEDULED IF EXISTING DOES NOT MEET CODE OR IS NOT EQUAL TO WHAT IS SCHEDULED.
A1	LOBBY	A1	7	3'-0"	9'-0"	ALUM / GL	CLEAR ANODIZED / ¼" TEMPERED		C11		A11 / C1	ALUM		SEE FINISH SCHEDULE FOR SIGNAGE INFO & DETAIL ON THIS SHEET FOR MAGNETIC CATCH SPEC. DOOR TO HAVE CARD KEY ACCESS & MAG LOCK w/ PROXIMITY SENSOR RELEASE ON EGRESS SIDE
B	SUITES	B	2	6'-0"	7'-0"	ALUM / GL	CLEAR ANODIZED / ¼" TEMPERED		C9	E9/E11	A9	ALUM	CLEAR ANODIZED	DOOR STOP PLACED TO PREVENT SMASHED FINGERS WHILE OPENING DOORS FROM INSIDE (PLACEMENT @ TOP OF DOOR). 32" MIN CLEAR OPENING
C	LAUNDRY	C	3	3'-0"	7'-0"	HM / GL	CLEAR ANODIZED / ¼" TEMPERED		C7	A7	C1	ALUM		SWING DOOR w/ APPLIED FILM (VERIFY w/ (MSS PM)
C	RESTROOMS	C	4	3'-0"	7'-0"	HM / GL	CLEAR ANODIZED / ¼" TEMPERED		C7	A7	RE: A601	ALUM		SWING DOOR w/ APPLIED FILM (VERIFY w/ (MSS PM)
D	CLOSET	D	5	2'-6"	7'-0"	HM	PT-3		A13	A13		HM	PT-3	PAINT METAL VENT (PT-3)
E	REAR EXIT	E	6	3'-0"	7'-0"	(E) HM	PAINT INTERIOR PT-3		EXG	EXG	EXG	(E) HM	PAINT INTERIOR PT-3	EXISTING DOOR BY LANDLORD. PROVIDE NEW HARDWARE AS SCHEDULED IF EXISTING DOES NOT MEET CODE OR IS NOT EQUAL TO WHAT IS SCHEDULED. PAINT INTERIOR SIDE OF DOOR AND FRAME PT-3.

Door Notes

1. THIS PROJECT SHALL COMPLY WITH ALL FEDERAL AMERICANS WITH DISABILITIES ACT ACCESSIBILITY GUIDELINES AND LOCAL ACCESS CODE REQUIREMENTS.
2. THRESHOLDS SHALL BE NO HIGHER THAN 1/2" ABOVE THE FLOOR. EDGE TO BE BEVELED WITH A SLOPE NO GREATER THAN 1 IN 2.
3. DOOR HARDWARE SHALL BE OF THE LEVER OR PUSH TYPE, MOUNTED 30" TO 44" ABOVE THE FLOOR AND BE OPERABLE WITH A MAXIMUM EFFORT OF 5 LBS. MAX FOR INTERIOR & EXTERIOR DOORS. PRESSURE FIRE DOOR - 15 POUNDS MAX. PRESSURE
4. ACCESSIBLE DOORS MUST BE MINIMUM 3'-0"W X 6'-8"H. MODIFY IF REQUIRED.
5. PROVIDE 18" CLEAR SPACE AT STRIKE/PULL SIDE ON INTERIOR DOORS, AND 12" CLEAR AT STRIKE/PUSH SIDE OF DOORS W/ CLOSERS AND 24" CLEAR AT STRIKE/PULL SIDE ON EXTERIOR DOOR.
6. FLOOR SHALL BE LEVEL THROUGHOUT.
7. CLOSERS: FURNISHED AND INSTALLED BY GENERAL CONTRACTOR. DOOR CLOSERS TO BE MOUNTED ON SWING SIDE OF DOORS. DOOR CLOSERS TO HAVE A MAXIMUM OPENING FORCE OF 5 LBS (INTERIOR & EXTERIOR DOORS) PRESSURE, FIRE DOOR - 15 POUNDS MAX. PRESSURE THE SWEEP PERIOD OF THE CLOSER SHALL BE ADJUSTED SO THAT FROM AN OPEN POSITION OF 110 DEGREES MIN., THE DOOR SHALL TAKE AT LEAST 3 SECONDS TO MOVE TO A POINT 3 IN. FROM THE LATCH, MEASURED TO THE LEADING EDGE OF THE DOOR.
8. GENERAL CONTRACTOR SHALL PROVIDE KICKPLATES ON BACK OF HOUSE DOORS AS INDICATED IN DOOR SCHEDULE. VERIFY TYPE AND STYLE WITH OWNER TO MATCH FRAME FINISH 12" X 34".
9. CONTRACTOR SHALL VERIFY WITH SUPPLIER THAT ALL HARDWARE MEETS ADAAG REQUIREMENTS.
10. ALL DOOR HINGES TO BE STEEL BALL BEARING, FULL MORTISE TYPE.
11. ALL METAL DOOR FRAMES TO BE PROVIDED WITH SILENCERS.
12. ALL INTERIOR DOORS TO BE PROVIDED WITH COMMERCIAL GRADE WALL OR FLOOR STOPS.
13. GENERAL CONTRACTOR TO SUBMIT TYPE-WRITTEN SHOP DRAWINGS AND PRODUCT LITERATURE FOR ALL DOORS AND HARDWARE SPECIFIED.
14. GENERAL CONTRACTOR SHALL ENSURE ALL EXISTING DOORS TO REMAIN TO BE IN GOOD OPERATING ORDER AND TO MEET ALL LOCAL BUILDING CODES AND ADAAG REQUIREMENTS. GENERAL CONTRACTOR TO RESTORE DOORS AND HARDWARE TO "LIKE NEW" CONDITION. G.C. TO PROVIDE NEW HARDWARE.
15. EXTERIOR HINGES TO HAVE NON-REMOVEABLE PINS.
16. ALL RATED DOORS TO BE SUPPLIED WITH THRESHOLDS AND SMOKE SEAL PER SPECIFICATIONS AND CODE.
17. EQUIVALENT HARDWARE MUST BE APPROVED BY THE PROJECT MANAGER.
18. REFER TO SHEET G-003 FOR ACCESSIBILITY CLEARANCES AT DOORS.
19. MAGNETIC LOCKING DEVICES FOR DOORS ARE PROVIDED/INSTALLED BY SECURITY (ACCESS CONTROL) VENDOR.

Accessibility Sign

9"x9" w/ SS STEEL STANDOFFS FURNISHED & INSTALLED BY GC. SEE RESPONSIBILITY SCHEDULES

ALL SIGNAGE SHALL CONFORM WITH ADA ACCESSIBILITY GUIDELINES:
1. LETTERS & NUMERALS MUST BE RAISED 1/32" FROM SIGN SURFACE
2. CHARACTER HEIGHT MUST BE AT LEAST 5/8" BUT NOT EXCEED 2".
3. TYPE STYLE FOR LETTERS AND NUMBERS SHALL BE SANS SERIF OR SIMPLE SERIF.
4. WORDS AND NUMBERS MUST BE CONVERTED INTO GRADE 2 BRAILLE, AND BE APPLIED TO SIGN.
5. PICTOGRAMS SHALL BE ACCOMPANIED BY THE EQUIVALENT VERBAL DESCRIPTION PLACED DIRECTLY BELOW PICTOGRAM.

Door Types



DOOR TYPE 'A'
EXISTING STOREFRONT DOOR



DOOR TYPE 'A1'
SINGLE SWING DOOR, COLUMBIA 3090 HERCULITE DOOR w/ SIDELITE. CONT. TOP & BOTTOM RAILS. RAIL TO HAVE CYLINTER



DOOR TYPE 'B'
SLIDING DOUBLE DOOR, COLUMBIA 3090 MALL SLIDE w/ OFFSET PULLS



DOOR TYPE 'C'
SINGLE DOOR, COLUMBIA 3090 MEDIUM STYLE DOOR w/ 10" BOTTOM



DOOR TYPE 'D'
HOLLOW METAL DOOR WITH LOUVER



DOOR TYPE 'E'
EXISTING HOLLOW METAL SERVICE DOOR

Tactile Exit Sign





E9 Left Jamb Detail
SCALE: 3" = 1'-0"



E11 Right Jamb Detail/ Pull Handle
SCALE: 3" = 1'-0"

E13 Vinyl Signage Pack
SCALE: 3" = 1'-0"



C1 Transition Detail
SCALE: FULL



NOTE: TACTILE EXIT SIGNS SHOULD BE ADJACENT TO THE LATCH SIDE OF THE DOOR AND TO THE RIGHT SIDE OF THE DOUBLE DOORS.

TACTILE EXIT SIGNS (RAISED LETTERS AND BRAILLE) ARE REQUIRED AT ALL EXIT PASSAGEWAY AND EXIT DISCHARGES AS REQUIRED BY THE FOLLOWING CODE:

IBC 1011.3 TACTILE SIGN STATING EXIT AND COMPLYING WITH ICC A117.1 SHALL BE PROVIDED ADJACENT TO EACH DOOR TO AN EGRESS STAIRWAY AND EXIT.

IBC 1110.3 OTHER SIGNS. SIGNAGE INDICATING SPECIAL ACCESSIBILITY PROVISIONS SHALL BE PROVIDED AS SHOWN.
ATEACH DOOR TO AN EGRESS STAIRWAY, EXIT PASSAGEWAY AND EXIT DISCHARGE, SIGNAGE SHALL BE PROVIDED IN ACCORDANCE WITH SECTION 1011.3

ANSI 703.3.2 DEPTH. TACTILE CHARACTERS SHALL BE RAISED 1/32 INCH (0.8 MM) MINIMUM ABOVE THEIR BACKGROUND.

ANSI 703.3.4 STYLE. CHARACTERS SHALL BE SANS SERIF. CHARACTERS SHALL NOT BE ITALIC, OBLIQUE, SCRIPT, HIGHLY DECORATIVE, OR OF OTHER USUAL FORMS.

ANSI 703.3.5 CHARACTER HEIGHT. THE UPPERCASE LETTER "I" SHALL BE USED TO DETERMINE THE ALLOWABLE HEIGHT OF ALL CHARACTERS OF A FONT. THE HEIGHT OF THE UPPERCASE LETTER "I" OF THE FONT, MEASURED VERTICALLY FROM THE BASELINE OF THE CHARACTER, SHALL BE 5/8 INCH (16 MM).

ANSI 703.3.10 HEIGHT ABOVE FLOOR. TACTILE CHARACTERS SHALL BE 40 INCHES (1220 MM) MINIMUM ABOVE THE FLOOR, MEASURED TO THE BASELINE OF THE LOWEST TACTILE CHARACTER AND 60 INCHES (1525 MM) MAXIMUM ABOVE THE FLOOR, MEASURED TO THE BASELINE OF THE HIGHEST TACTILE

ANSI 703.3.11 LOCATION. WHERE A TACTILE SIGN IS PROVIDED AT A DOOR, THE SIGN SHALL BE ALONGSIDE THE DOOR AT THE LATCH SIDE. WHERE A TACTILE SIGN IS PROVIDED AT A DOUBLE DOORS WITH ONE ACTIVE LEAF, THE SIGN SHALL BE LOCATED ON THE INACTIVE LEAF. WHERE A TACTILE SIGN IS PROVIDED AT DOUBLE DOORS WITH TWO ACTIVE LEAVES, THE SIGN SHALL BE TO THE RIGHT HAND DOOR. WHERE THERE IS NO WALL SPACE ON THE LATCH SIDE OF A SINGLE DOOR, OR TO THE RIGHT SIDE OF DOUBLE DOORS, SIGNS SHALL BE ON THE NEAREST ADJACENT WALL. SIGNS CONTAINING TACTILE CHARACTERS SHALL BE LOCATED SO THAT A CLEAR FLOOR AREA 18 INCHES (455 MM) MINIMUM BY 18 INCHES (455 MM) MINIMUM, CENTERED ON THE TACTILE CHARACTERS, IS PROVIDED BEYOND THE ARC OF ANY DOOR SWING BETWEEN THE CLOSED POSITION AND 45 DEGREE OPEN POSITION.

A5 Tactile Exit Sign Detail
SCALE: 3" = 1'-0"



C7 Head Detail
SCALE: 3" = 1'-0"



C9 Head Detail
SCALE: 3" = 1'-0"



C11 Head Detail
SCALE: 3" = 1'-0"



C13 Head Detail
SCALE: 3" = 1'-0"



A7 Jamb Detail
SCALE: 3" = 1'-0"



A9 Sill Detail
SCALE: 3" = 1'-0"



A11 Sill Detail
SCALE: 3" = 1'-0"

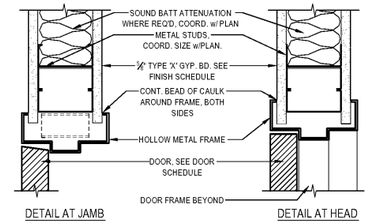

A13 Head / Jamb Detail
SCALE: 3" = 1'-0"

Order Plans @ WWW.LDLine.com

FRCH DESIGN WORLDWIDE
312 Elm Street Suite 600
Cincinnati, OH 45202
513 241 5000
www.frch.com

MY SALON Suite

ISSUE INFORMATION

REVISIONS

FRCH Nelco Architecture, Inc.

PROJECT INFORMATION

Marketplace Center MSS #5158

1948 Old Fort Pkwy
Murfreesboro, TN 37129

PROJECT #:
035986.000

SHEET INFORMATION

Door Schedule, Door Details, & Transition Details

DRAWN BY: KRP

REVIEWED BY: SA / RR

SCALE: As Noted

AUTHORIZED FOR: Bid/Permit/LL

A-601

© This drawing, symbol or otherwise, is the copyrighted property of Nelco Architecture, Inc. The drawing may not be used, reproduced or copied without the permission of Nelco Architecture, Inc.

USER: KPOHLGEERS PLOTTED: 6/5/2015 - 6:39 PM P:\035000\035986.000\Revit-mf\Doc\MSS 5158 Murfreesboro TN CD\A601 DoorSchedule.dwg LAYOUT: A601