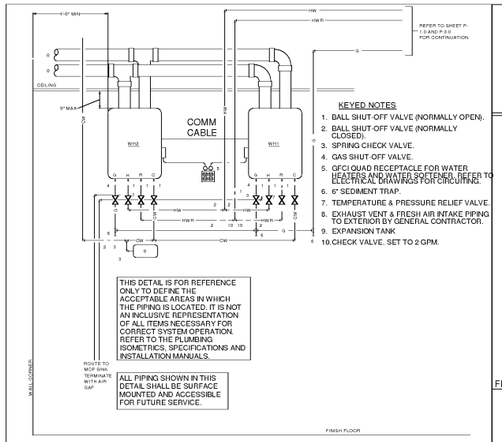

22 34 00.00 FUEL-FIRED TANKLESS WATER HEATER DETAIL

SCALE: NONE

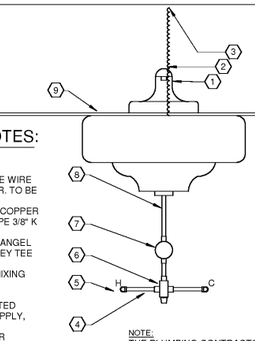

NOTE:
THE PLUMBING CONTRACTOR SHALL NOT PROVIDE (REINFORCED FLEXIBLE PLASTIC TUBE SUPPLIES AND/OR CORRUGATED FLEXIBLE STEEL TUBE SUPPLIESWITH REINFORCED BRAID.)

224000.00-52 - LAVATORY WITH AUTOMATIC FAUCET

SCALE: NONE

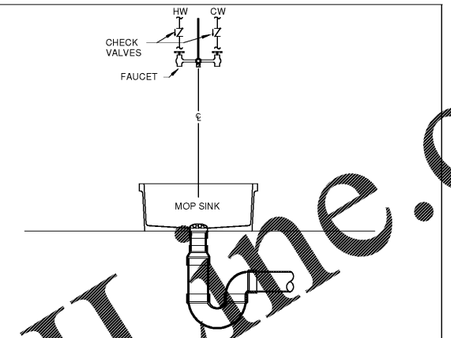

NOTES:
1. SEAL TOP OF SINK TO WALL USING A CONTINUOUS BEAD OF SILICONE CAULKING, WHEREVER SINK ABUTS WALL. AT SOLID WALLS APPLICATION PROVIDE SURFACE MOUNT WATER SUPPLY LINES. WHEN POSSIBLE ROUTE WATER SUPPLY LINES INSIDE INTERIOR STUD WALLS.
3. INCLUDE MOP HANGER, HOSE & HOSE BRACKET, WALL AND BUMPER GUARDS.

224000.00-03 - MOP SINK DETAIL

SCALE: NONE

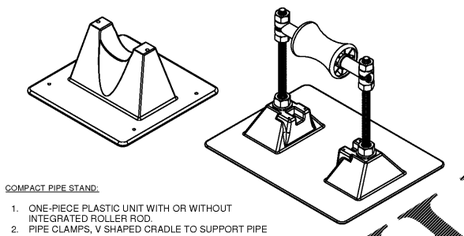

COMPACT PIPE STAND:

1. ONE-PIECE PLASTIC UNIT WITH OR WITHOUT INTEGRATED ROLLER ROD.
2. PIPE CLAMPS, V SHAPED CRADLE TO SUPPORT PIPE FOR FLOOR OR ROOF.
3. INSTALLATIONS WITHOUT MEMBRANE PENETRATION.
4. PIPESTANDS SHALL BE SPACED NO MORE THAN 10' ON CENTER.
5. USE MIRO SUPPORT PAD UNDER ALL PIPESTANDS.

HIGH-TYPE, SINGLE-PIPE STAND:

1. DESCRIPTION: ASSEMBLY OF BASE, VERTICAL AND HORIZONTAL MEMBERS, AND PIPE SUPPORT, FOR FLOOR AND ROOF INSTALLATIONS WITHOUT MEMBRANE PENETRATION.
2. BASE: PLASTIC OR STAINLESS STEEL.
3. VERTICAL MEMBERS: TWO OR MORE CADMIUM-PLATED-STEEL OR STAINLESS-STEEL, CONTINUAOUS-THREAD RODS.
4. HORIZONTAL MEMBERS: CADMIUM-PLATED-STEEL OR STAINLESS-STEEL ROD WITH PLASTIC OR STAINLESS-STEEL, ROLLER TYPE PIPE SUPPORT.

224000.00-12 - GAS PIPE ROOF SUPPORT DETAIL

SCALE: NONE

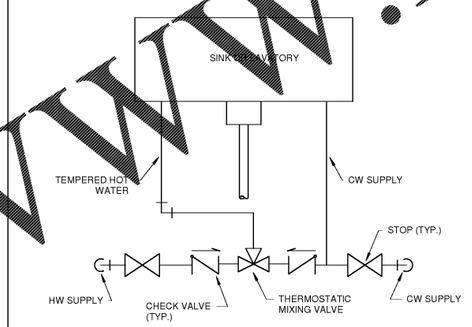

223001.00-01 - THERMOSTATIC MIXING VALVE TMV DETAIL

SCALE: NONE

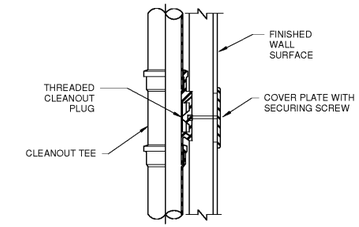

221319.00-05 - WALL CLEANOUT DETAIL

SCALE: NONE





KEYED NOTES:
1. SHEET LEAD FLASHING MOP IN WITH ROOFING MATERIAL.
2. TURN LEAD DOWN INTO STACK.
3. VANDAL PROOF VENT CAP AS REQUIRED.
4. MINIMUM 12".
5. ROOFING SYSTEM..
6. SLEEVE THROUGH ROOFING SYSTEM AS REQUIRED.
7. INCREASER WHEN REQUIRED.
8. VENT STACK.
9. VENT STACK EXTENSION.
10. CAULK WATERTIGHT WITH LEAD AND OAKUM.
11. SHEET LEAD FLASHING CLAMPED INTO FLASHING SLEEVE.
12. FILL IN ABOVE SLEEVE AND MOP IN ROOFING IN A WATERTIGHT MANNER.
13. OPTIONAL CLAMPING COLLAR.
14. MANUFACTURED STACK FLASHING SLEEVE ANCHORED IN PLACE.

221313.00-40 - VENT THRU ROOF

SCALE: NONE

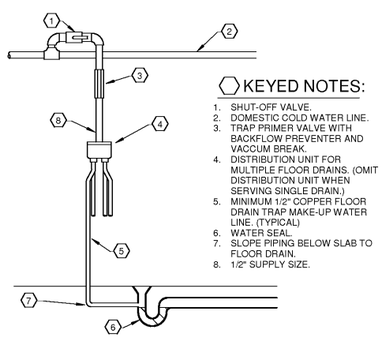

NOTE: TRAP PRIMER LINE SHALL NOT EXCEED 20 FT.

221119.00-34 - TRAP PRIMER DETAIL

SCALE: NONE

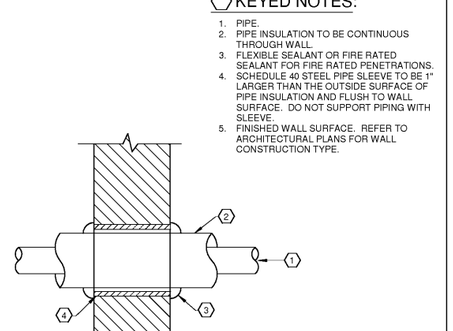

220517.00-02 - INTERIOR WALL PENETRATION

SCALE: NONE

KLH ENGINEERS
MECHANICAL ELECTRICAL ENGINEERS
WWW.KLHENGRS.COM
ALEXANDRIA PIKE, SUITE
11 HIGHLAND, KENTUCKY 41075
800-359-
859-441-8050
859-441-8058 FAX

MY SALON Suite

ISSUE INFORMATION

1.10.2019

REVISIONS

FRCH / ARCHITECTURE, INC., P.C.

PROJECT INFORMATION

Marketplace Center
MSS #5158
1948 Old Fort Pkwy
Murfreesboro, TN 37129

PROJECT #:
20994

SHEET INFORMATION

PLUMBING DETAILS

DRAWN BY:
DMT

REVIEWED BY:
MCD

SCALE:
As Noted

AUTHORIZED FOR:
Bid/Permit/LL

P-5.0

© 2017 - This drawing, plotted or not, is the copyrighted property of FRCH Design Worldwide and FRCH Architecture, Inc., P.C. The drawing may not be used, reproduced or copied without the permission of FRCH Design Worldwide or FRCH Architecture, Inc., P.C.

Order Plans @ WWW.LDLine.com