NOTE:
CONTRACT DRAWINGS SHALL NOT BE USED FOR SHOP DRAWINGS

NOTE:
MECHANICAL CONTR. SHALL VERIFY & COORDINATE SIZE, WEIGHT AND LOCATION OF ALL MECHANICAL UNITS WITH TRUSS FABRICATOR PRIOR TO TRUSS FABRICATION. MECH. CONTRACTOR SHALL VERIFY AND COORDINATE MAGNITUDE AND LOCATION OF POINT LOADS PRIOR TO JOIST FABRICATION.

NOTE:
ALL HARDWARE (BOLTS, HANGERS, STRAPS, ETC.) REQUIRED FOR CONNECTIONS BETWEEN PRE-ENGINEERED TRUSSES SHALL BE DESIGNED AND SPECIFIED BY THE TRUSS DESIGN ENGINEER.

NOTE:
TRUSSES SHALL BE DESIGNED FOR ALL ADDITIONAL LOADS SHOWN ON FRAMING PLANS AND PROVIDE ADDITIONAL TRUSSES IF REQ'D

PONDING NOTE:
TRUSS SUPPLIER SHALL DESIGN TRUSSES FOR 4" OF PONDING AT ROOF DRAINS

NOTE:
MECHANICAL CONTR. SHALL VERIFY & COORDINATE SIZE, WEIGHT AND LOCATION OF ALL MECHANICAL UNITS WITH TRUSS FABRICATOR PRIOR TO TRUSS FABRICATION. MECH. CONTRACTOR SHALL VERIFY AND COORDINATE MAGNITUDE AND LOCATION OF POINT LOADS PRIOR TO JOIST FABRICATION.

NOTE:
PRE-ENGINEERED METAL PLATE CONNECTED WOOD TRUSSES SHALL BE BRACED IN ACCORDANCE WITH TRUSS PLATE INSTITUTE'S "BUILDING COMPONENT SAFETY INFORMATION BOOKLET, BCSI 1-03" AND RELATED SUMMARY SHEETS.

PREFABRICATED AWNING NOTE:
ATTACH PREFABRICATED CANOPY w/ ⅜"Ø THROUGH BOLTS ALONG TOP AND BOTTOM OF AWNING FRAME AT 32" oc MAX. TO 2x6 BLOCKING

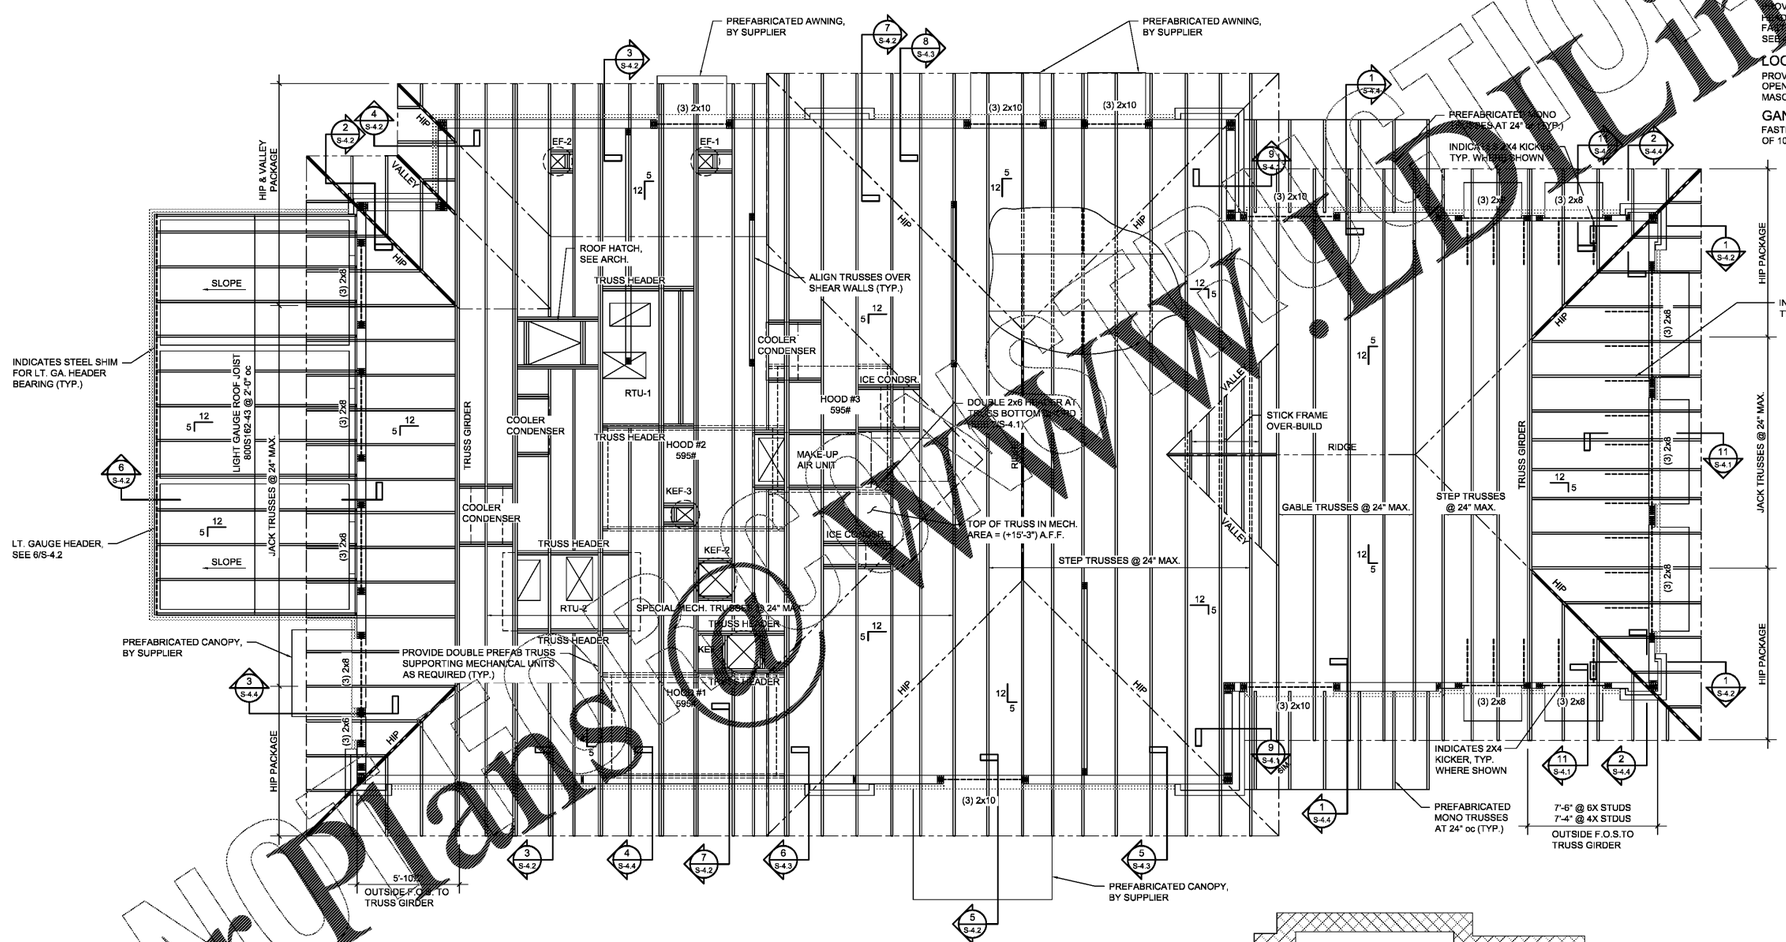

1 S-1.1 ROOF FRAMING PLAN

SCALE: 1/4"=1'-0"

NOTES:

1. ALL ELEVATIONS REFERENCED FROM FIN. F.L. (0-0)
2. TRUSS BEARING - (+13'-3") A.F.F. TYPICAL AT ALL LOAD BEARING WALLS.
3. CONTRACT DRAWINGS SHALL NOT BE USED FOR SHOP DRAWINGS.
4. SEE SHEET S-0.1 FOR GENERAL NOTES.

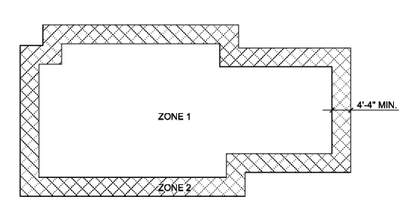

2 S-1.1 ROOF NET UPLIFT PLAN

NOT TO SCALE

ZONE 1 = -10.0 PSF
ZONE 2 = -15.0 PSF

MICROLAM HEADER NOTE:
PROVIDE (1) PIECES OF ½" PLYWOOD FILLER BETWEEN MICROLAM HEADER MEMBERS TO ACHIEVE 5½" WALL THICKNESS. GLUE AND FASTEN MEMBERS w/ (2) ROWS OF 10d NAILS @ 12" oc. SEE 8/S-4.2 FOR HEADER BEARING CONNECTION.

2X SAWN LUMBER HEADER:
PROVIDE (2) PIECES OF ½" PLYWOOD FILLER BETWEEN 2X HEADER MEMBERS TO ACHIEVE 5½" WALL THICKNESS. FASTEN 2X MEMBERS w/ (2) ROWS OF 10d NAILS @ 12" oc. SEE 8/S-4.4 FOR HEADER BEARING CONNECTION.

2X SAWN LUMBER HEADER:
PROVIDE (1) PIECE OF ½" PLYWOOD FILLER BETWEEN 2X HEADER MEMBERS TO ACHIEVE 3½" WALL THICKNESS. FASTEN 2X MEMBERS w/ (2) ROWS OF 10d NAILS @ 12" oc. SEE 8/S-4.3 FOR HEADER BEARING CONNECTION.

LOOSE BRICK LINTEL:
PROVIDE LOOSE L5x5x5/16 BRICK SHELF OVER MASONRY OPENINGS. PROVIDE 8" MINIMUM BEARING OVER SOLID MASONRY EACH END. (TYPICAL UNLESS NOTED OTERWISE)

GANG STUD NOTE:
FASTEN GANGED 2X WALL STUDS w/ (1) ROW OF 10d NAILS @ 12" oc (TYP.)

ARP ENGINEERING
CONSULTING ENGINEERS
202 EAST FRANKLIN STREET, SUITE A
PO BOX 587 • MONROE • NC 28111
(704) 225-0079
GA COA PEF004471

THE ARCHITECT/ENGINEER DOES NOT DEFINE THE SCOPE OF INDIVIDUAL TRADES, SUBCONTRACTORS, MATERIAL SUPPLIERS, OR VENDORS. ANY SHEET NUMBERING SYSTEM USED WHICH IDENTIFIES DISCIPLINES IS SOLELY TO SEPARATE ARCHITECT'S AND ENGINEER'S SCOPE; IT DOES NOT DEFINE A SUBCONTRACTOR'S SCOPE OF WORK. ANY DISCREPANCIES BETWEEN DRAWINGS, SPECIFICATIONS, CODES OR CONSTRUCTION SEQUENCING SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT PRIOR TO PROCEEDING. NO CONSIDERATION WILL BE GIVEN TO REQUESTS FOR CHANGE ORDERS FOR FAILURE TO OBTAIN AND REVIEW THE COMPLETE SET OF CONSTRUCTION DOCUMENTS, OR FOR FAILURE TO SEEK INTERPRETATION FROM ARCHITECT FOR DISCREPANCIES.

ESD
architecture • interior design
421 Penman Street, Suite 200, Charlotte, NC 28203
Email: esd@esdarch.com • Phone: 704-373-1900

PRELIMINARY
NOT FOR CONSTRUCTION

BOJANGLES' 14 RESTAURANT
HUDSON BRIDGE ROAD
AT WILLIS DRIVE
STOCKBRIDGE, GEORGIA

ISSUE DATE: 1-9-2019
REVISION 1:
REVISION 2:
REVISION 3:
REVISION 4:
PROJECT #: 18-164-000
CONTENT:

PROJECT ARCHITECT: ECE
DRAWN BY: LDA/DAP
CADD FILE NAME: 18-164-000 Bojangles

THIS DRAWING AND THE DESIGN SHOWN ARE THE PROPERTY OF BOJANGLE'S RESTAURANT'S INC. THE REPRODUCTION, OR USE OF THIS DRAWING WITHOUT THEIR WRITTEN CONSENT IS PROHIBITED, ANY INFRINGEMENT IS SUBJECT TO LEGAL ACTION.

Sheet
S-2.1

Order Plans @ www.PLANSONLINE.com