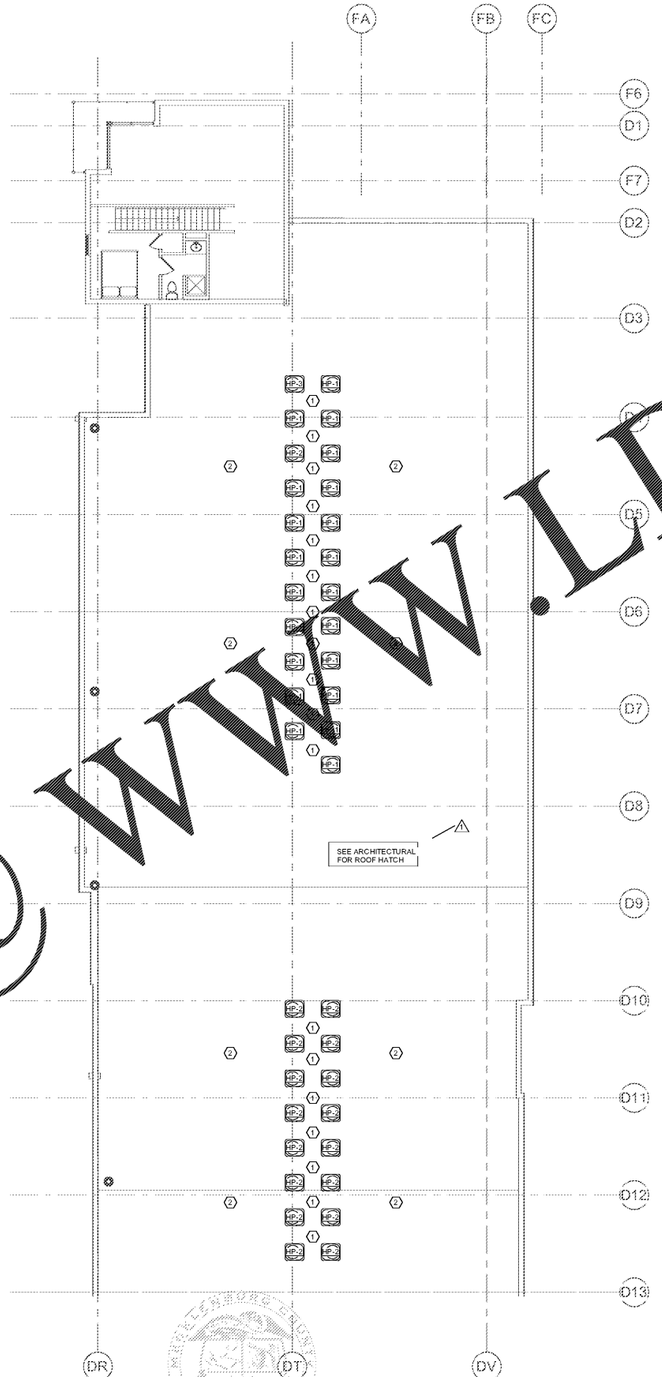

KEY NOTES TO PLAN:

1. ROUTE REFRIGERANT PIPING ACROSS ROOF AND DOWN IN MECHANICAL DOGHOUSES TO RESPECTIVE AIR HANDLING UNIT CLOSETS ON FLOORS BELOW. OFFSET PIPING AS REQUIRED IN CEILING SPACE OF TOP FLOOR TO REACH CLOSET. INSULATION ON ROOF SHALL BE PAINTED WITH UV RESISTANT PAINT.
2. APPROXIMATE LOCATION OF REFRIGERANT PIPING DOGHOUSE. COORDINATE WITH GC IN FIELD.

1 M105-D-a ROOF PLAN - BUILDING D - MECHANICAL - SEGMENT A

SCALE 1/8" = 1'-0"

ODELL

800 W. Hill Street
Third Floor
Charlotte, NC 28208
(T) 704-414-1000 (F) 704-414-1111
www.odell.com

CHARLOTTE, NC RICHMOND, VA

CONSULTANT

NORTH CAROLINA PROFESSIONAL SEAL 34702 ENGINEER SCOTT R. CAMPAGNA 10/19/16

NoDa Philemon Road Community

PHILEMON ROAD
CHARLOTTE, NORTH CAROLINA

NODA

TRUE

REVISION	DATE	DESCRIPTION
1	10/19/2016	ADDENDUM 1 - CODE COMMENTS
ADDENDA OR MODIFICATION		
CD	08/17/2016	CONTRACT DOCUMENTS
ISSUE	DATE	DESCRIPTION
FULL SET ISSUES		

PROJECT NO:	4068-001
P.I.C.	JIM SYNDER
P MGR.	CAROLYN ENTZMINGER
P ARCH.	
DESIGN BY	BRAD BARTHOLOMEW
JOB CAPTAIN	
DRAWN BY	Author
CHECKED BY	Checker

ODELL ASSOCIATES INC © 2016

SHEET TITLE

BUILDING D - ROOF PLAN - SEGMENT A - MECHANICAL

McVEIGH & MANGUM ENGINEERING INC
1610 East Moorhead Street, Suite 100
Charlotte, North Carolina 28207
Ph: (704) 347-9035 Fax: (704) 347-9036
email: mail@McVeighMangum.com
Firm License No.: C-3591
Eng. of Record: Scott C. Campagna License No.:34702

SHEET IDENTIFIER

M105-D-a

Order Plans @ WWW.LDILine.com