

STAGING AREA LIFE SAFETY NOTES:




STORAGE ARRANGEMENTS AND FLAMMABLE AND COMBUSTIBLE LIQUID QUANTITIES WILL BE STORED SUCH THAT IN RACK SPRINKLERS WILL NOT BE REQUIRED PER NFPA 1, NFPA 101, OR NFPA 30.


TOTAL CLASS I, II, III LIQUIDS STORAGE WILL BE APPROXIMATELY 3,500 GALLONS. MINIMUM AISLE WIDTHS WILL BE 4'-0". STORAGE OF LIQUIDS WILL BE IN RACKS WITH MAXIMUM STORAGE HEIGHT OF 12'-0". FLAMMABLE AND COMBUSTIBLE LIQUIDS OF GREATER THAN ONE GALLON WILL BE STORED IN METAL PRESSURE RELIEVING CONTAINERS.

EXIT REQUIREMENTS


TRAVEL DISTANCE TO EXIT - MAX ALLOWED = 200'
 ACTUAL = 122'-10" MAX.
 EXITS REQUIRED = 1
 DISTANCE BETWEEN EXITS -
 - REQUIRED (1/2 DIAGONAL) = 107'-8"/2 = 53'-10"
 ACTUAL = 80'-7"
 EXIT WIDTH (0.2/PER OCCUPANT)
 REQUIRED:
 48x0.2" = 9.6"
 50% THRU FRONT = 4.8"
 PROVIDED:
 SALES (1) 72'-68"
 (1) 3'-54"
 STORAGE (2) 3'-18"
 THRU FRONT = 68"

LEGEND

-  36" WIDE EGRESS PATH (UNDER 50)
-  EGRESS TRAVEL PATH
-  T.E.S. TACTILE EXIT SIGN - SEE DETAIL 4/A401

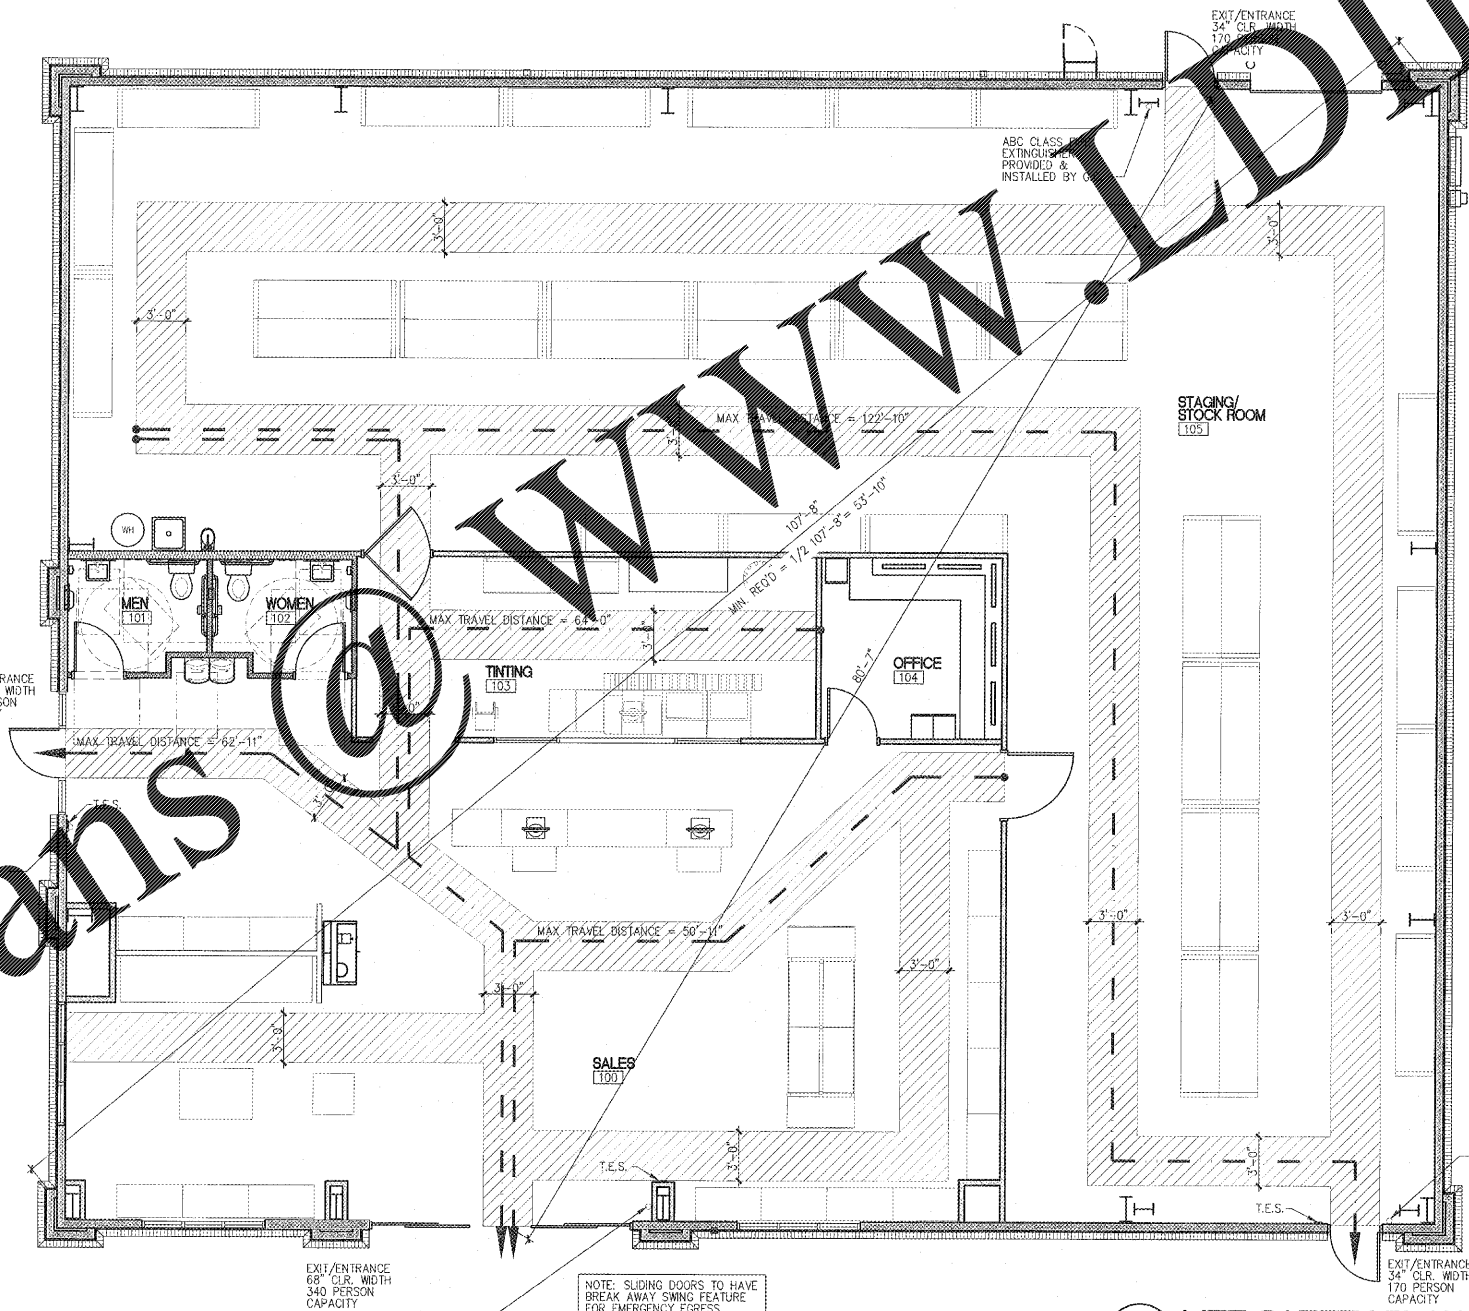

1 LIFE SAFETY PLAN
 G101 SCALE: 3/16" = 1'-0"



PROJECT: **SHERWIN WILLIAMS**
 1980 GADSDEN HIGHWAY
 TRUSSVILLE, AL 35235
 DRAWING: **LIFE SAFETY PLAN**

Revisions	
REVISION DATE	

PROJECT DATE
 1/17/2019
 Drawn By
 MTP
 Checked By
 TD

Sheet No.
G101

Order Plans @ www.LDOnline.com