

5 SECTION THRU OVERFLOW SCUPPER  
A161 SCALE: 1 1/2" = 1'-0"

4 SCUPPER/COLLECTOR PLAN  
A161 SCALE: 1 1/2" = 1'-0"

3 SECTION THRU SCUPPER/COLLECTOR  
A161 SCALE: 1 1/2" = 1'-0"

2 CONDUIT PENETRATION DETAIL  
A161 SCALE: 1" = 1'-0"

WALL TYPE LEGEND

- 6" METAL STUD EXTERIOR WALL - 5/8" OSB SHEATHING ON EXTERIOR FACE OF STUDS - REFER TO EXTERIOR ELEVATIONS FOR FINISH
- HARDICAST STUCCO WITH BRICK VENEER WAINSOOT BELOW
- METAL STUD FRAMING - SEE GENERAL FINISH NOTES ON SHEET A131
- SOUND ATTENUATION

DIMENSION NOTES


- 3'-0" TO FACE OF STUD
- 3'-0" MIN. MINIMUM DIMENSION ALLOWED (MAY BE MODIFIED)
- 3'-0" MAX. MAXIMUM DIMENSION ALLOWED (MAY BE LESS)
- 3'-0" EXACT DISTANCE BETWEEN FINISHED SURFACES (ALL DIMENSIONS TO FACE OF FRAMING UNLESS OTHERWISE NOTED)
- 3'-0" TARGET DIMENSION WHICH MAY NOT BE ACHIEVED IN FIELD - BE AWARE OF POSSIBLE CHANGE
- ALWAYS ON THESE FINISH SURFACES

GENERAL NOTES

- G.C. TO COORDINATE ALL ROOF PENETRATIONS WITH MECHANICAL AND PLUMBING CONTRACTOR.

CONSTRUCTION NOTES

- MECHANICAL HVAC UNIT - RE: MECH DWGS. FOR EXACT LOCATION. PROVIDE SECONDARY FRAMING UNDER CURBS AND AROUND OPENING - COORDINATE WITH STEEL BUILDING MANUFACTURER.
- PLUMBING VENT - RE: PLUMBING DWGS
- EXTERIOR WALL SIGNAGE TO BE PROVIDED & INSTALLED BY OWNERS NATIONAL SIGN VENDOR. EC TO COORDINATE WITH SIGN VENDOR AND PROVIDE ELECTRICAL SUPPLY AT SIGN LOCATIONS AS REQUIRED. SEE ELECT. FOR J-BOX LOCATIONS.
- METAL SNAP-ON COMPRESSION EDGE SEE DRAWING A303 FOR DETAILS.
- LINE OF CANOPY BELOW - PROVIDED AND INSTALLED BY SIGNAGE NATIONAL VENDOR.
- EXTERIOR ROOFTOP ACCESS LADDER REFER TO DETAIL 1/A303.
- METAL SCUPPER AND DOWNSPOUT PROVIDED AND INSTALLED BY EXCEPTIONAL METALS. SEE DETAIL 3&4/A161-TIE INTO STORM WATER - SEE CIVIL DRAWINGS.
- ROOF INSULATION AS REQUIRED, PROVIDED BY CHIEF BUILDING UNDER GC CONTRACT PER LOCAL ENERGY CODE - SEE DRAWING TI FOR FURTHER INFORMATION.
- EXTERIOR DECORATIVE LIGHT FIXTURE - SEE ELECTRICAL DRAWINGS.
- GUTTER SYSTEM BY CHIEF BUILDINGS, PROVIDED AND INSTALLED BY G.C. G.C. SHALL INSTALL RIGID INSULATION TO SLOPE TOWARDS DOWNSPOUTS. INSTALL EPDM ROOFING MEMBRANE OVER INSULATION AND BEHIND ADJACENT FINISHES 12" MINIMUM - INSULATION TO SLOPE 1/2" PER FOOT MIN TO SCUPPERS.
- FULLY WELDED 8"x8" SCUPPER OPENINGS TO DOWNSPOUTS AND OVERFLOWS, PAINT - TO BE FULLY WATERPROOF.
- 24 GAUGE GALVALUME ROOF PANES BY CHIEF BUILDINGS SYSTEMS - PROVIDED AND INSTALLED BY G.C.
- NOT USED.
- RESTROOM EXHAUST - REFER TO MECHANICAL DRAWINGS
- METAL OVERFLOW SCUPPER WITH 2" DECORATIVE FLANGE - SEE DETAIL 5/A161.
- HIGHER PARAPET - REFER TO EXTERIOR ELEVATIONS AND WALL SECTIONS.
- HIGHER "TOWER" - REFER TO EXTERIOR ELEVATIONS AND WALL SECTIONS.
- NOT USED.
- GAS PIPING TO ROUTE THROUGH PARAPET WALL - REFER TO PLUMBING DRAWINGS.

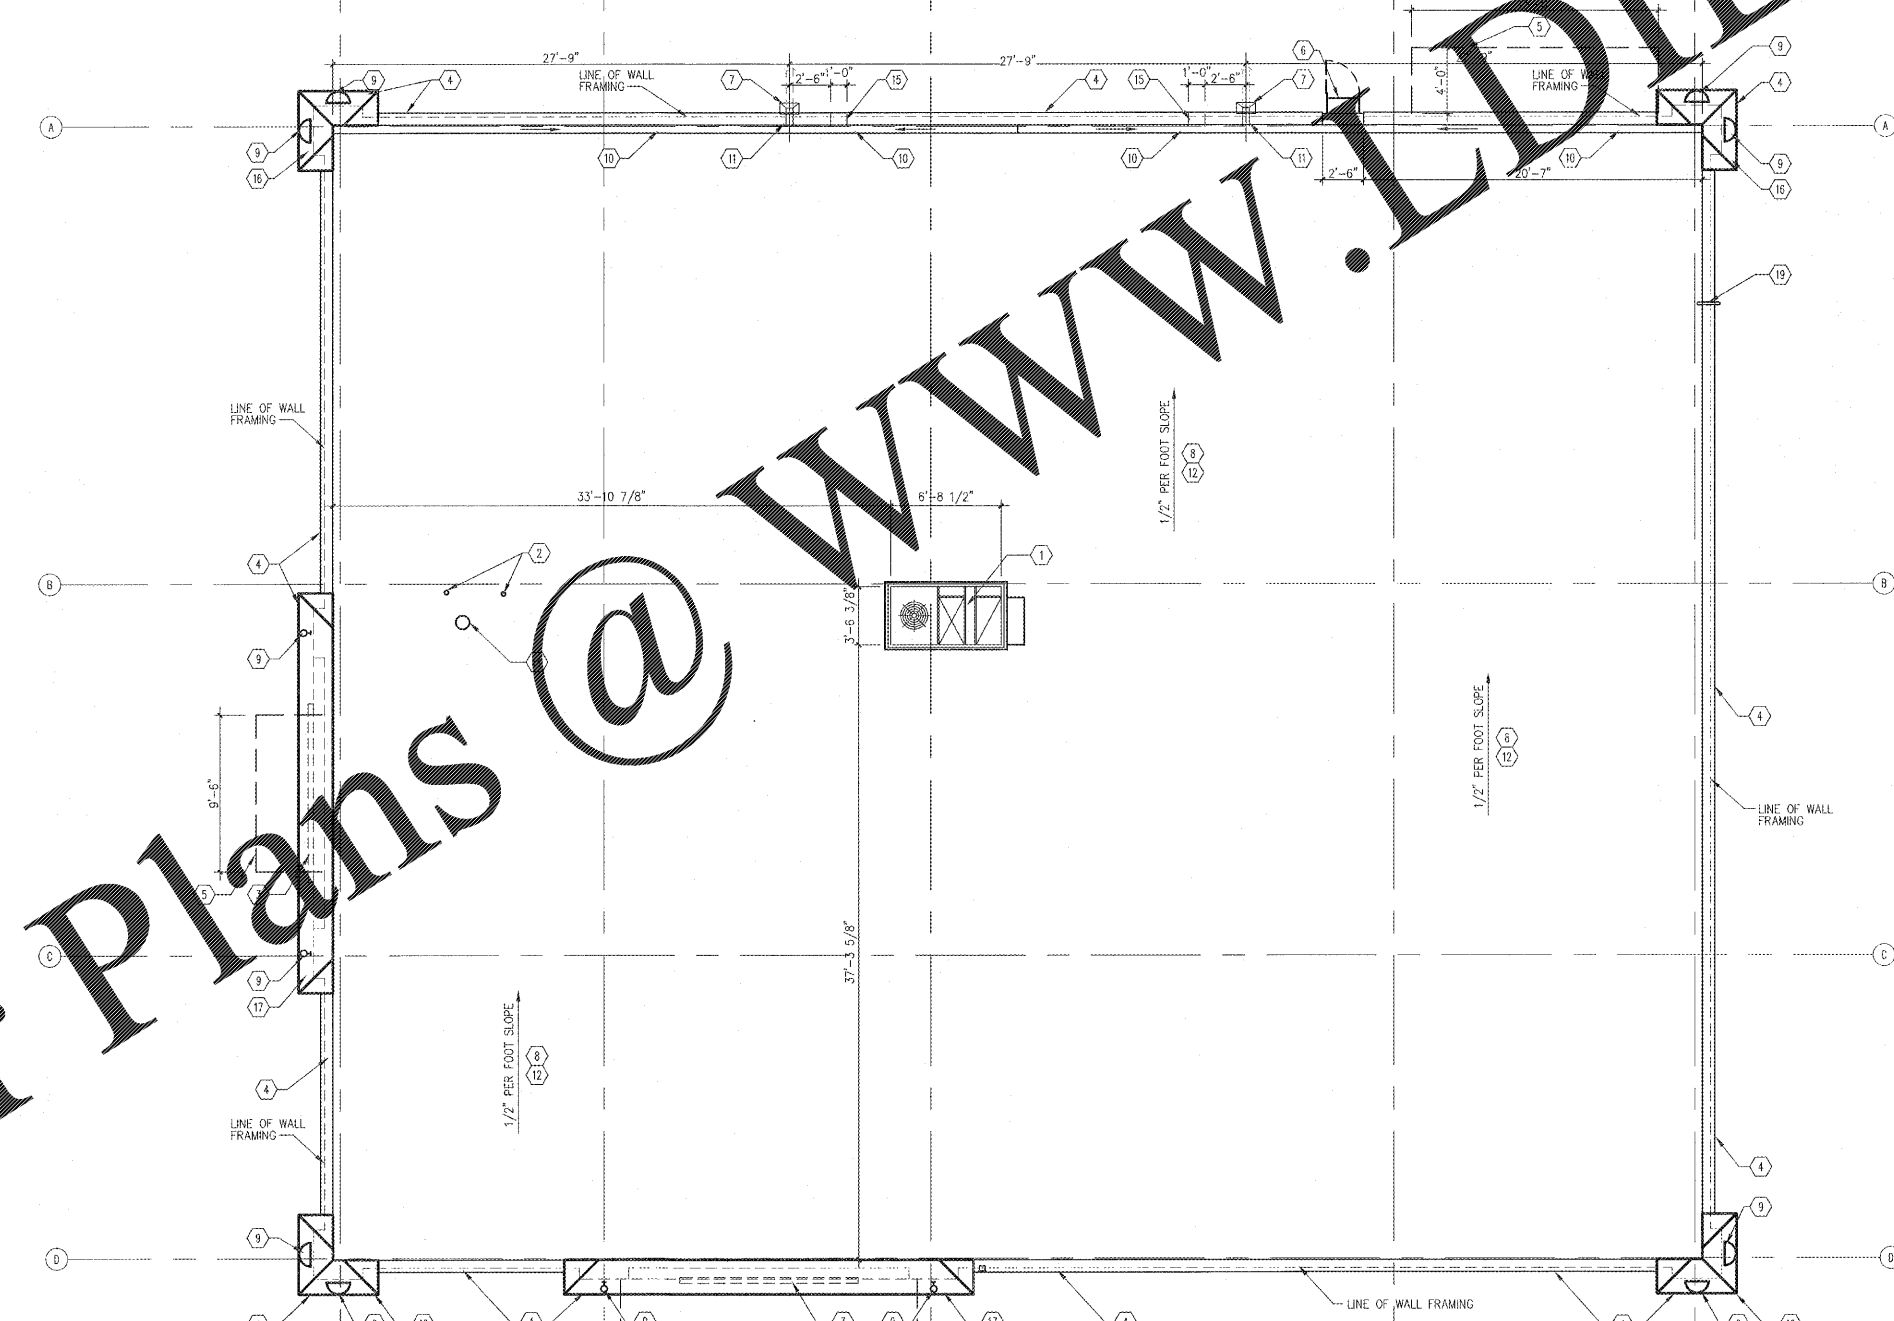

1 ROOF PLAN  
A161 SCALE: 1/4" = 1'-0"

Order Plans @

WWW.LDOnline.com

PROJECT: SHERWIN WILLIAMS  
1980 GADSDEN HIGHWAY  
TRUSSVILLE, AL 35225

DRAWING: ROOF PLAN

Revisions

REVISION DATE	
PROJECT DATE	1/17/2019
Drawn By	MTP
Checked By	TD
Sheet No.	A161