

**KEYNOTES**


- (1) A CONTINUOUS WATERPROOF MEMBRANE TO BE INSTALLED ON WALLS, 1'-6" ABOVE FLOOR ON OUTER/EXPOSED SURFACE OF WALL SHEATHING & AT 4'-0" OUT FROM WALL. FILL ALL GAPS LARGER THAN 1/4" USE 2" FIBERGLASS MESH TAPE ON ALL CORNERS, COVES IN PLANE SUBSTRATE CHANGES & JOINTS. REFER TO A601 FOR SPEC AND MANUFACTURER'S APPLICATION INSTRUCTIONS FOR MORE INFO
- (2) FINISH ON COUNTERTOP WALL SHALL BE FRP ON KITCHEN SIDE
- (3) NO STAINLESS STEEL BEHIND HOOD
- (4) CONTINUE TILE WAINSCOT UP TO 7'-11 1/2" A.F.F. (10 TILES ABOVE THE TYP TILE WAINSCOT). CONTINUED TILE SHALL BE CT-1 (SEE DETAIL 1/3/A602).
- (5) FRP TO STOP 8 - 12" PAST EDGE OF WALK IN COOLER
- (6) EXTEND SST CAP TURN DOWN WALL TO TOP OF BASE TILE. SEE DETAIL 2/A602.
- (7) CONTINUE STANDARD DINING ROOM WALL FINISH ON ALL SIDES OF WALL ABOVE COUNTERTOP.
- (8) CONTINUE STAINLESS STEEL FINISH ON ALL SIDES OF WALL ABOVE COUNTERTOP.
- (9) SEE 12/A602 FOR FINISHES

**FINISH NOTES**


1. FOR TYP TILE WALL FINISH ELEVATION SEE DETAIL 1 ON SHEET A5-01.
2. FLOORING INSTALLER SEE DETAIL 3 ON SHEET A6-01.
3. FOR DOOR FINISH SEE DOOR SCHEDULE ON SHEET A8-01.
4. OWNER TO SUPPLY ALL TILE. GC TO ORDER ALL TILE. GC TO SUPPLY MORTAR, ADHESIVE, CORNERS AND GROUT. GC TO INSPECT ALL TILES AND REJECT DAMAGED OR SUBSTANDARD TILES PRIOR TO INSTALLATION.
5. CABINETRY TO BE SET AFTER TILE INSTALLATION.
6. PROVIDE GROUT JOINT OF 3/16" MAX. DEVIATION OF TILE AND GROUT LINE OF 1/4" PER 4'.
7. FOR ALL TILE AND/OR VINYL BASE INSTALLATIONS AT CASEWORK MECHANICALLY SAND AND SCARIFY WOOD SUBSTRATE TO COMPLETELY REMOVE ALL FINISH.
8. ALL TILE TO BE INSTALLED PER TILE COUNCIL OF AMERICA STANDARDS.
9. EXPOSED EDGES OF TILE, TITILE WAINSCOT, TO BE BULLNOSE. NO OUTSIDE GROUT CORNERS OR RAW TILE EDGES ARE ALLOWED.
10. GC TO SUPPLY STAINLESS STEEL OUTSIDE CORNERS, CG-1, TO TILE WAINSCOT IN ALL PUBLIC AREAS. REFER TO FINISH SCHEDULE FOR OUTSIDE CORNER SPEC.
11. GC TO SUPPLY STAINLESS STEEL OUTSIDE CORNERS, CG-2, FROM TILE BASE TO CEILING, U.N.O. IN ALL PRIVATE AREAS. REFER TO FINISH SCHEDULE FOR OUTSIDE CORNER SPEC.
12. REMOVAL OF EXCESS GROUT WILL BE DONE WITH WATER. THE USE OF SULFURIC OR MURIATIC ACID IS PROHIBITED. IF THESE ACIDS ARE USED, THE INSTALLER WILL BE REQUIRED TO REMOVE THE ACID AND RESTORE THE GROUT AT THEIR EXPENSE.
13. REFER TO INTERIOR ELEVATIONS FOR MORE FINISH INFO.
14. REFER TO FINISH SCHEDULE ON A9-01.
15. TILE BASE AND THRESHOLD GROUT JOINTS TO ALIGN WITH TILE FLOOR GROUT JOINTS.
16. ALL DRYWALL JOINTS LARGER THAN 1/4" TO BE TAPED & MORTARED. ALL CHANGES IN PLANE TO BE TAPED WITH DRYWALL MESH JOINT TAPE. 2 COATS MORTAR- COAT 1 WITH MESH TAPE. COAT 2: FINISH COAT, SAND SMOOTH.
17. ALL SANDED GROUT FLOOR TILE INSTALLATIONS ARE TO BE SEALED WITH A PENETRATING SEALER - AQUA MIX SEALERS CHOICE OR APPROVED EQUAL.

**LEGEND**

- [Symbol] WATERPROOF MEMBRANE SEE KEYNOTE 1 FOR SPEC & DETAILS
- [Symbol] FULL HEIGHT WALL FINISHES
- [Symbol] PARTIAL HEIGHT WALL FINISHES
- [Symbol] OUTSIDE CORNER GUARD

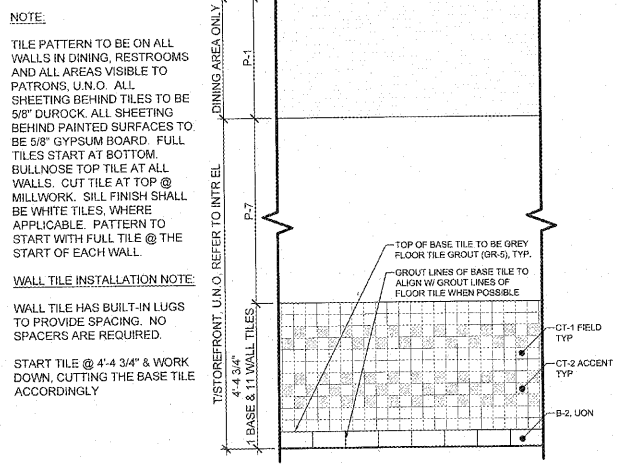

**2 TYPICAL WALL FINISH**  
A201 SCALE: 1/4" = 1'-0"

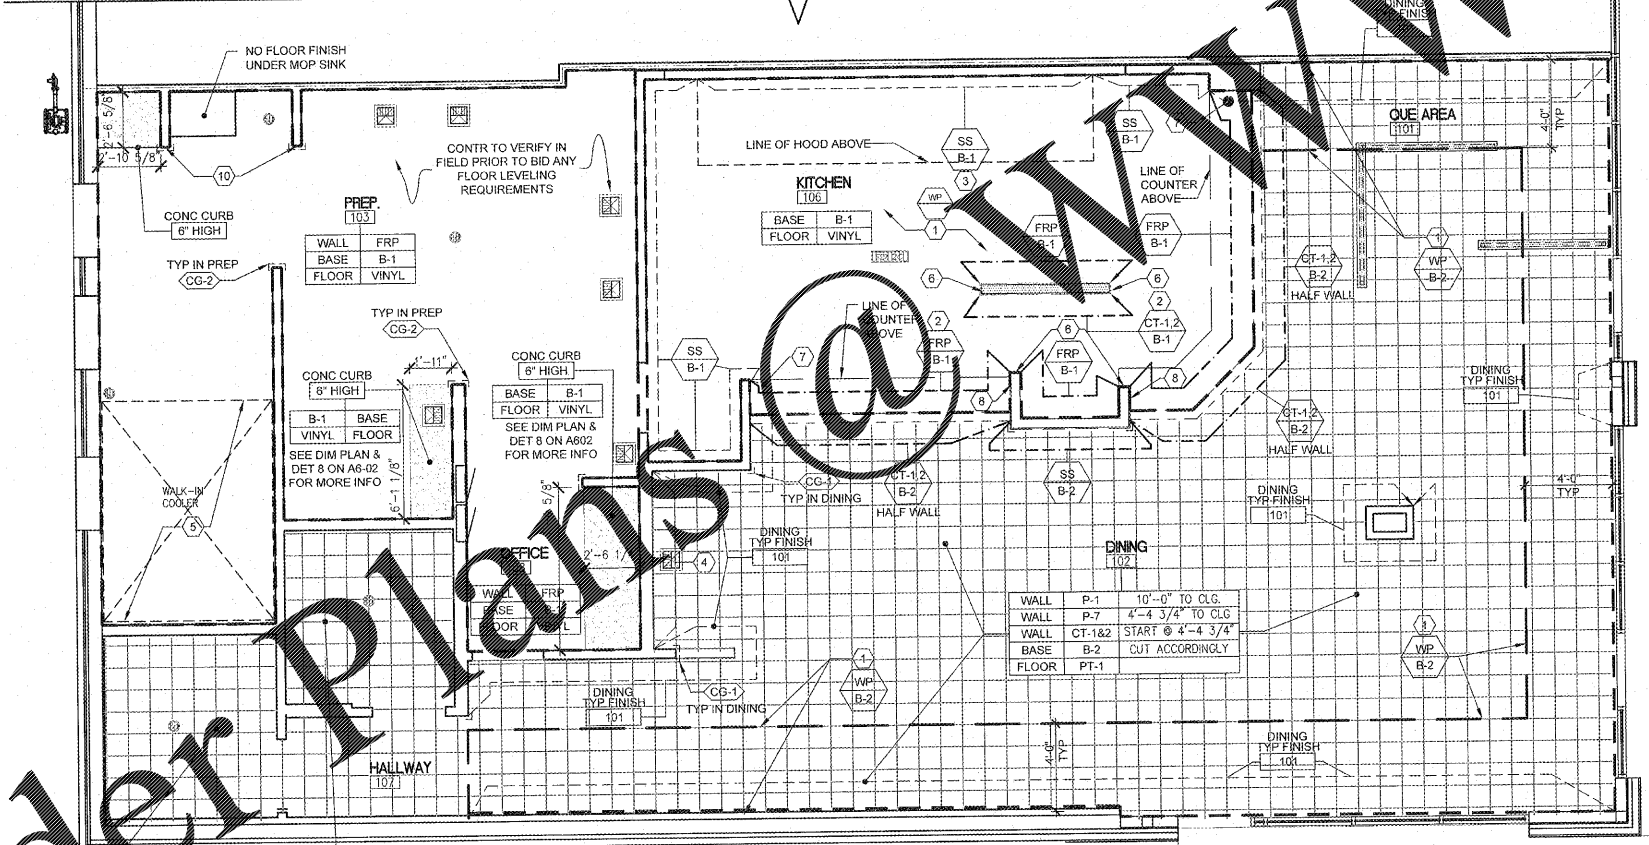

**1 FINISH FLOOR PLAN**  
A201 SCALE: 1/4" = 1'-0"

ARCHITECTS & ENGINEERS  
3005 Carverton Mill Blvd, Suite 150, Marietta, GA 30066  
Ph: 678 544 7251 Fax: 678 544 8393  
A Division of LHRT Associates



PROJECT: FIVE GUYS BURGERS & FRIES  
600 CRANE CREEK DRIVE  
AUGUSTA, GA, 30907  
DRAWING: FLOOR AND WALL FINISH PLAN

Revisions	
REVISION DATE	
PROJECT DATE	12.3.18
Drawn By	LW
Checked By	TA/DMM
Sheet No.	A201

Order Plans @ [www.LDILine.com](http://www.LDILine.com)