




GENERAL NOTES:

- SEE SHEET P101 FOR ALL GENERAL NOTES.
- TYPICAL VENT THRU-ROOF DETAIL 16/P801.
- ALL PLUMBING VENTS AND MECHANICAL EXHAUST OUTLETS SHALL BE INSTALLED 10" (MIN.) FROM ANY BUILDING FRESH AIR INTAKE.
- ALL PENETRATIONS THRU ROOF SHALL BE BY LANDLORDS. CONTR. AS PER ROOF MFR.'S STANDARD DETAILS.
- DO NOT SCALE DRAWING.
- ALL PLUMBING VENT OUTLETS THROUGH ROOF SHALL TERMINATE BELOW VISIBLE SIGHT GROUND.
- G.C. SHALL PROVIDE WATER HEATER CURB AND BRACING. SEE ARCHITECTURAL DRAWING.

CONSTRUCTION NOTES:

- P.C. SHALL PROVIDE/INSTALL SHUT-OFF VALVE, COCK, REGULATOR AND DRIP LEG TO EACH GAS CONNECTION.
- GAS PIPING ROUTE TO WATER HEATER AND KITCHEN EQUIPMENT. SEE DETAIL 6/P801.
- OFFSET FLUE PIPING TO 10'-0" AWAY FROM FRESH AIR INTAKE. SEE DETAIL 2/P801 FOR CONTINUATION/INSTALL PER MANUFACTURERS RECOMMENDATIONS.
- P.C. SHALL ROUTE ALL CONDENSATE DRAIN PIPING TO SPLASH BLOCK ON ROOF. TERMINATE INDIRE. WITH 1/2" GAP TWICE THE DIAMETER OF DRAIN PIPE (MIN.). SEE DETAIL 7/P810.
- SANITARY VENT TO BE A MINIMUM OF 10'-0" FROM ANY FRESH AIR INTAKE. FIELD COORDINATE.
- SEE HOOD SHEETS FOR ROUTING OF COPPER PIPING TO BELOW ROOF DECK.

GENERAL:
1. P.C. SHALL ROUTE VENT SYSTEM TO ROOF AND INSTALL PER MANUFACTURERS RECOMMENDATIONS. FLUE PIPING SHALL NOT EXHAUST WITHIN 10'-0" FROM ANY FRESH AIR INTAKE. NECESSARY OFFSETS TO BE AS REQUIRED PER MANUFACTURERS RECOMMENDATION.

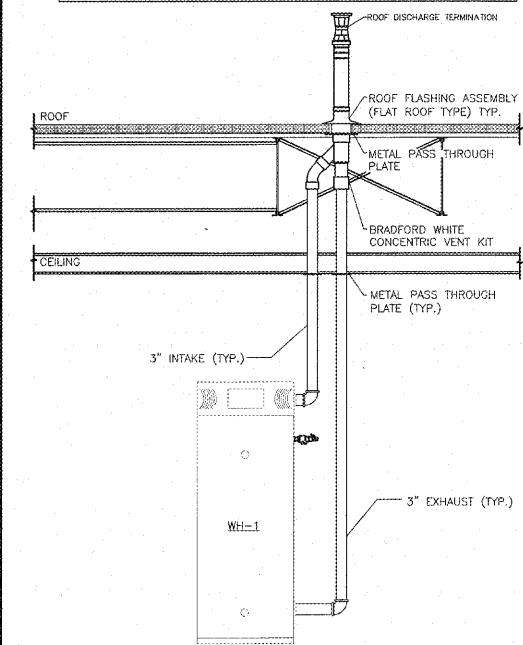


2
P401
WATER HEATER FLUE PIPING DETAIL
SCALE: NONE

IF ANY DISCREPANCIES ARE FOUND ON THE PLANS, THE PLUMBING CONTRACTOR SHALL BID THE MORE CONSERVATIVE SPECIFICATION AND CALL ENGINEER FOR CLARIFICATION.

PRIOR TO SUBMITTING BID, CONTRACTOR SHALL VISIT SITE TO EXAMINE SITE CONDITIONS. CONTRACTOR SHALL EXAMINE EXISTING CONDITIONS AND REUSE AND RECONNECT TO EXISTING SERVICE WHERE POSSIBLE. ALL REUSED PIPING AND EQUIPMENT MUST COMPLY WITH STATE AND LOCAL PLUMBING CODE.

WHILE EVERY ATTEMPT HAS BEEN MADE IN THE PREPARATION OF THIS PLAN TO AVOID MISTAKES, THE DESIGNER AND COMPANY CANNOT GUARANTEE AGAINST ERROR OR UNFORESEEN FIELD CONDITIONS. THE CONTRACTOR OR BUILDER MUST CHECK ALL DIMENSIONS, DETAILS AND REPORT ANY DISCREPANCIES.

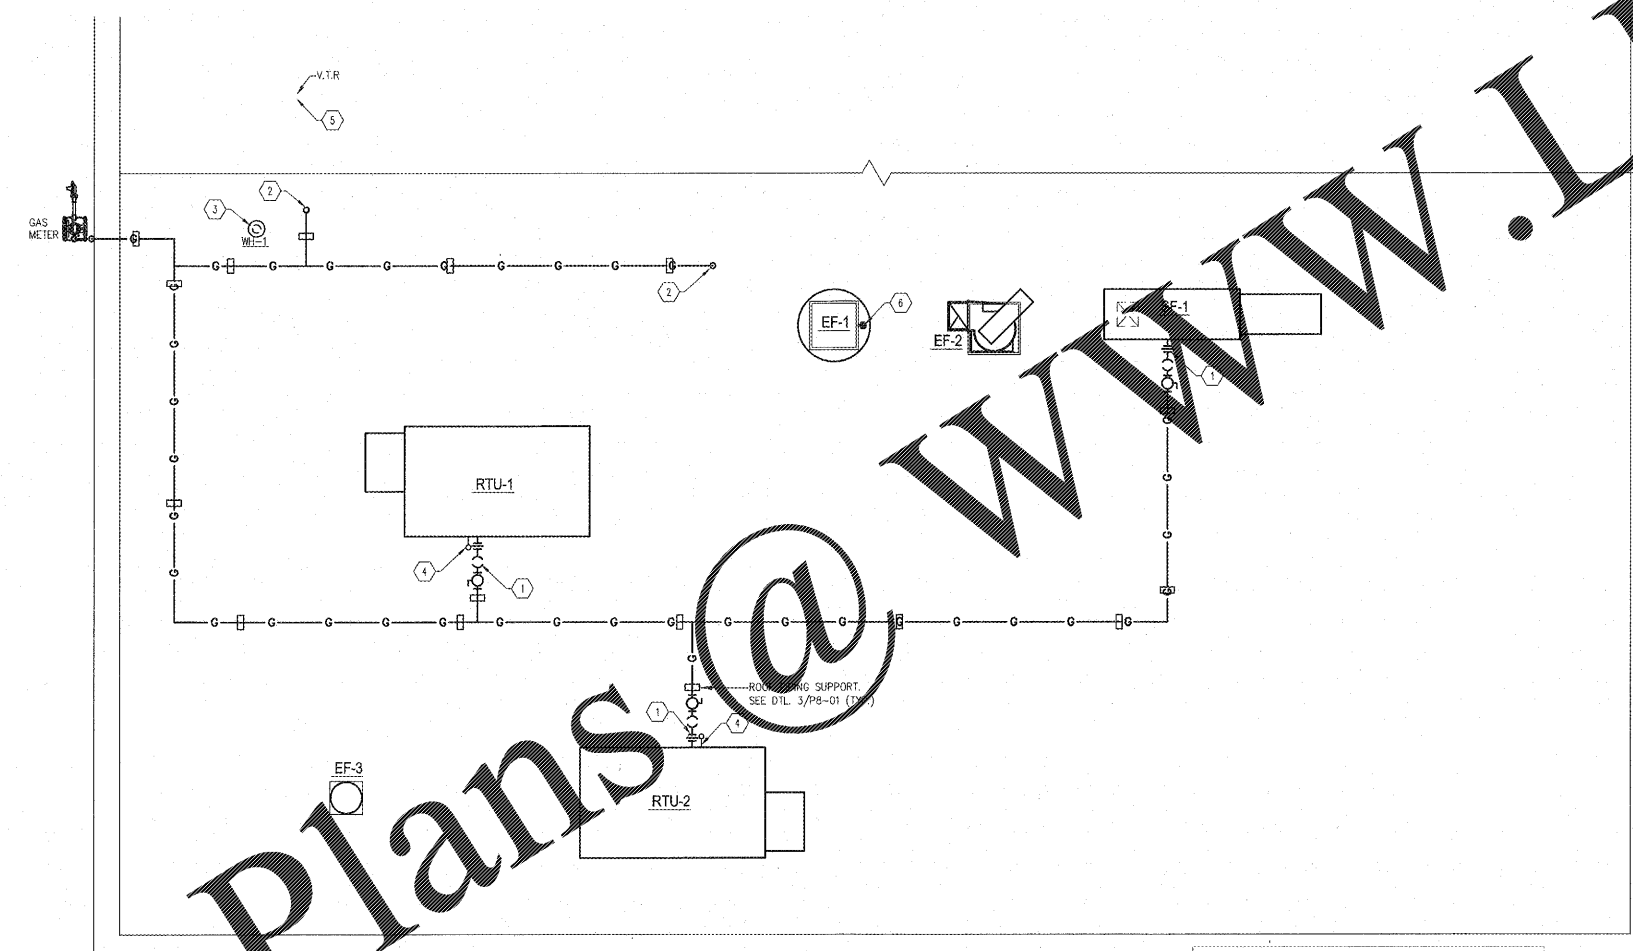

P
P401
PLUMBING ROOF PLAN
SCALE: 1/4" = 1'-0"

PROJECT: FIVE GUYS BURGERS & FRIES

630 CRANE CREEK DRIVE
AUGUSTA, GA, 30907

DRAWING: PLUMBING ROOF PLAN

Revisions

REVISION DATE

PROJECT DATE
12.3.18

Drawn By
SCP

Checked By
SDS

Sheet No.

P401

Order Plans @ www.LDOnline.com