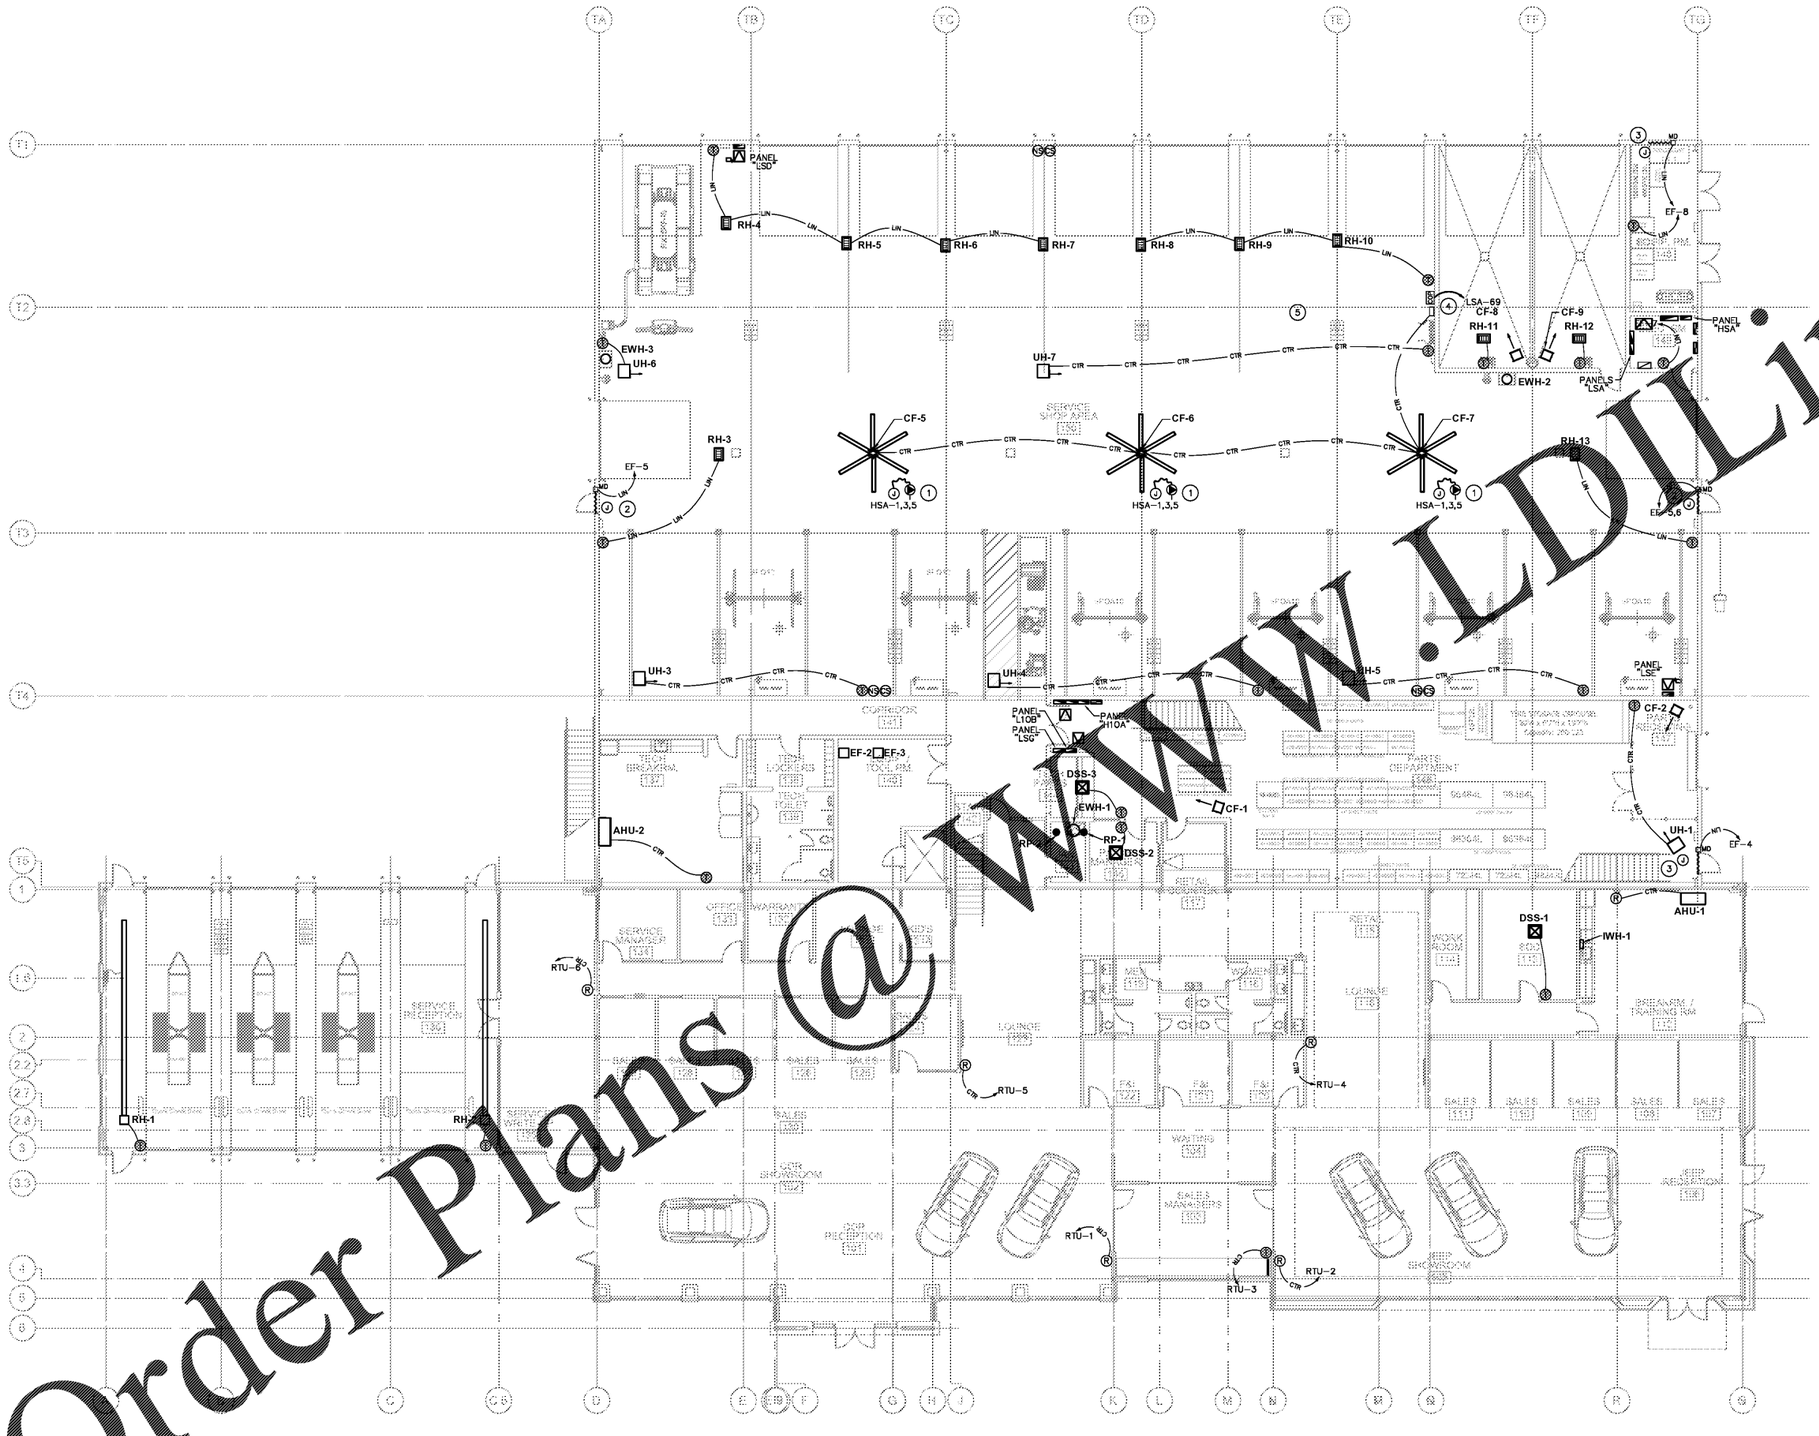

KEY NOTES

1. PROVIDE "PLUG AND CORD" CONNECTION TO LOW SPEED HIGH VOLUME FAN. COORDINATE WITH MANUFACTURER FOR CONNECTION REQUIREMENTS. PROVIDE CONNECTION TO FAN CONTROL PANEL ON WALL FOR OPERATION.
2. PROVIDE ELECTRICAL CONNECTION TO DAMPER. PROVIDE INTERCONNECTION OF DEVICES AS REQUIRED TO CO PANEL AND CONNECT FOR OPERATION.
3. PROVIDE ELECTRICAL CONNECTION TO DAMPER AS REQUIRED AND CONNECT FOR OPERATION.
4. PROVIDE ELECTRICAL CONNECTION TO CARBON MONOXIDE PANEL / SENSOR. COORDINATE EXACT REQUIREMENTS WITH MECHANICAL AND/OR SYSTEM SUPPLIER.

GENERAL MECHANICAL POWER NOTE

REFER TO SHEET E7.1, MECHANICAL EQUIPMENT-ELECTRICAL SCHEDULE, FOR POWER REQUIREMENTS TO ALL MECHANICAL EQUIPMENT / MOTORIZED DAMPERS INDICATED ON THIS SHEET.

1 E4.1 **FIRST FLOOR MECHANICAL POWER PLAN**
3/32"=1'-0"

PROMUS
SCOTT MERIWETHER, P.E.
GEORGIA LICENSE #30780
518 BLACK CANYON PARK
CANTON, GA 30114
PROJECT MANAGER: GEORGE DAVIDOV
PHONE 678.246.5146

GEORGIA REGISTERED PROFESSIONAL ENGINEER SCOTT MERIWETHER
SEAL

REVISION	DATE

ELLSWORTH ARCHITECTS
3136 LANIER DRIVE
ATLANTA, GEORGIA 30319
PHONE: 404.949.9351

PRO BUILDING SYSTEMS
DESIGN BUILD CONTRACTORS
3678 North Peachtree Road
Atlanta, Georgia 30341
(770) 455-1791 / Fax 455-4123
www.probldgsystems.com

GINN CHRYLSER - DODGE - RAM AND JEEP
I-20 ACCESS ROAD
COVINGTON GEORGIA 30040

DATE: 11.06.2018
SCALE: AS SHOWN
BY: GD
JOB ID:

MECHANICAL POWER PLAN
DRAWING TITLE

E4.1

SHEET 8 OF 14

Order Plans @ WWW.LDLine.com