



NO.	REVISIONS

VENDOR BID DATA:

- ① CASE COLORS PER KROGER PROJECT MANAGER
- ② NOT USED
- ③ VENDOR SHALL REVIEW COMPRESSOR SELECTIONS STATED ON THE REFRIGERATION DRAWING. ANY DEVIATION FROM THIS DATA MUST BE APPROVED BY THE KROGER CO. VENDOR SHALL PROVIDE LINE SIZING
- ④ MATERIALS SHALL BE ORDERED AND PURCHASED SEPARATELY BY THE KROGER PROJECT MANAGER
- ⑤ ALL REMOTE GLASS DOOR AND MULTI-CRACK REFRIGERATORS TO BE SUPPLIED BY OEM UNLESS NOTED OTHERWISE
- ⑥ CASE END GUARDS SUPPLIED BY MANUFACTURER
- ⑦ NOT USED
- ⑧ NOT USED
- ⑨ NOT USED
- ⑩ SUPPLY DOWNWARD TILT SHELVES FOR FROZEN BAKERY IN GLASS DOOR REFRIGERATOR
- ⑪ NOT USED
- ⑫ NOT USED
- ⑬ ALL FOUR AND FIVE CRACK MEDIUM TEMPERATURE CASES TO HAVE APPROVED ENDS UNLESS NOTED OTHERWISE
- ⑭ NOT USED
- ⑮ NOT USED

REFRIGERATION INSTALLER NOTES:

- ① SUGGESTED LOCATIONS OF PVC RISERS FOR THE ROUTING OF REFRIGERATION LINES SHOWN ON PLAN. ALTERNATE ROUTING MAY BE REQUIRED. FIELD CONDITIONS TO BE VERIFIED FOR CONFLICTS AND THE FEASIBILITY OF UTILIZING EXISTING ROUTING. CARE SHOULD BE TAKEN TO AVOID THE ROUTING OF LINES TO AVOID INTERFERENCE WITH EXISTING UTILITIES. REFRIGERATION LINES SHALL BE PROTECTED AS HIGH AS PRACTICALLY FEASIBLE.
- ② NOT USED
- ③ INSTALL SELF-CONTAINED EQUIPMENT
- ④ NOT USED
- ⑤ INSTALL CASE END GUARDS SUPPLIED BY MANUFACTURER
- ⑥ NOT USED
- ⑦ NOT USED
- ⑧ NOT USED
- ⑨ NOT USED
- ⑩ NOT USED
- ⑪ NOT USED
- ⑫ NOT USED
- ⑬ SYSTEM REFRIGERATION PIPING TO BE SHIPPED AS PER PRACTICALITY. IT IS THE PIPING INSTALLER'S RESPONSIBILITY TO REPLACE EXISTING PIPING AND INSULATION AS REQUIRED TO CONFORM TO THE REFRIGERATION CONDENSING EQUIPMENT MANUFACTURER'S RECOMMENDATIONS FOR THE REFRIGERATION LOAD SERVED.
- ⑭ NOT USED
- ⑮ NOT USED
- ⑯ SUGGESTED LOCATION OF REFRIGERATION PIPING RISER. SEE RISD-3 & RISD-3/A.

CONTROL NOTE:

— ANY NEW GFCIT CONTROL REQUIRED TO ACCOMPLISH REMODEL TO BE USED AND PROVIDED BY REFRIGERATION INSTALLER. SUITABILITY OF REMAINING EXISTING CONTROLS FOR PROPOSED SYSTEMS TO BE DETERMINED BY REFRIGERATION INSTALLER. RESET VALVE PRESSURE SWITCHES AND OPERATOR WHEN NEW LOADS OFFER FROM EXISTING CONTROLS TO BE INSTALLED IN ACCESSIBLE LOCATIONS PROTECTED FROM DAMAGE.

SHEET INDEX:

RELI	THIS SHEET REFRIGERATION EQUIPMENT PLAN
RELI	REFRIGERATION STANDARD DETAILS
RELI	REFRIGERATION EQUIPMENT SCHEDULE


LEGEND:

TS	TEMPERATURE SENSOR
TR	DEPRIST TERMINATION THERMOSTAT

CURRENT PLAN DATE: 2/20/2019
ORIGINAL PLAN DATE: 12/14/2018

OWNER	D. GRESSMANN	CHECKED
REVISION	DC 2/20/2019	

ISSUE DATE: MARCH 04, 2019
PROJECT NO.: 219206
SHEET NUMBER: **R1.1**

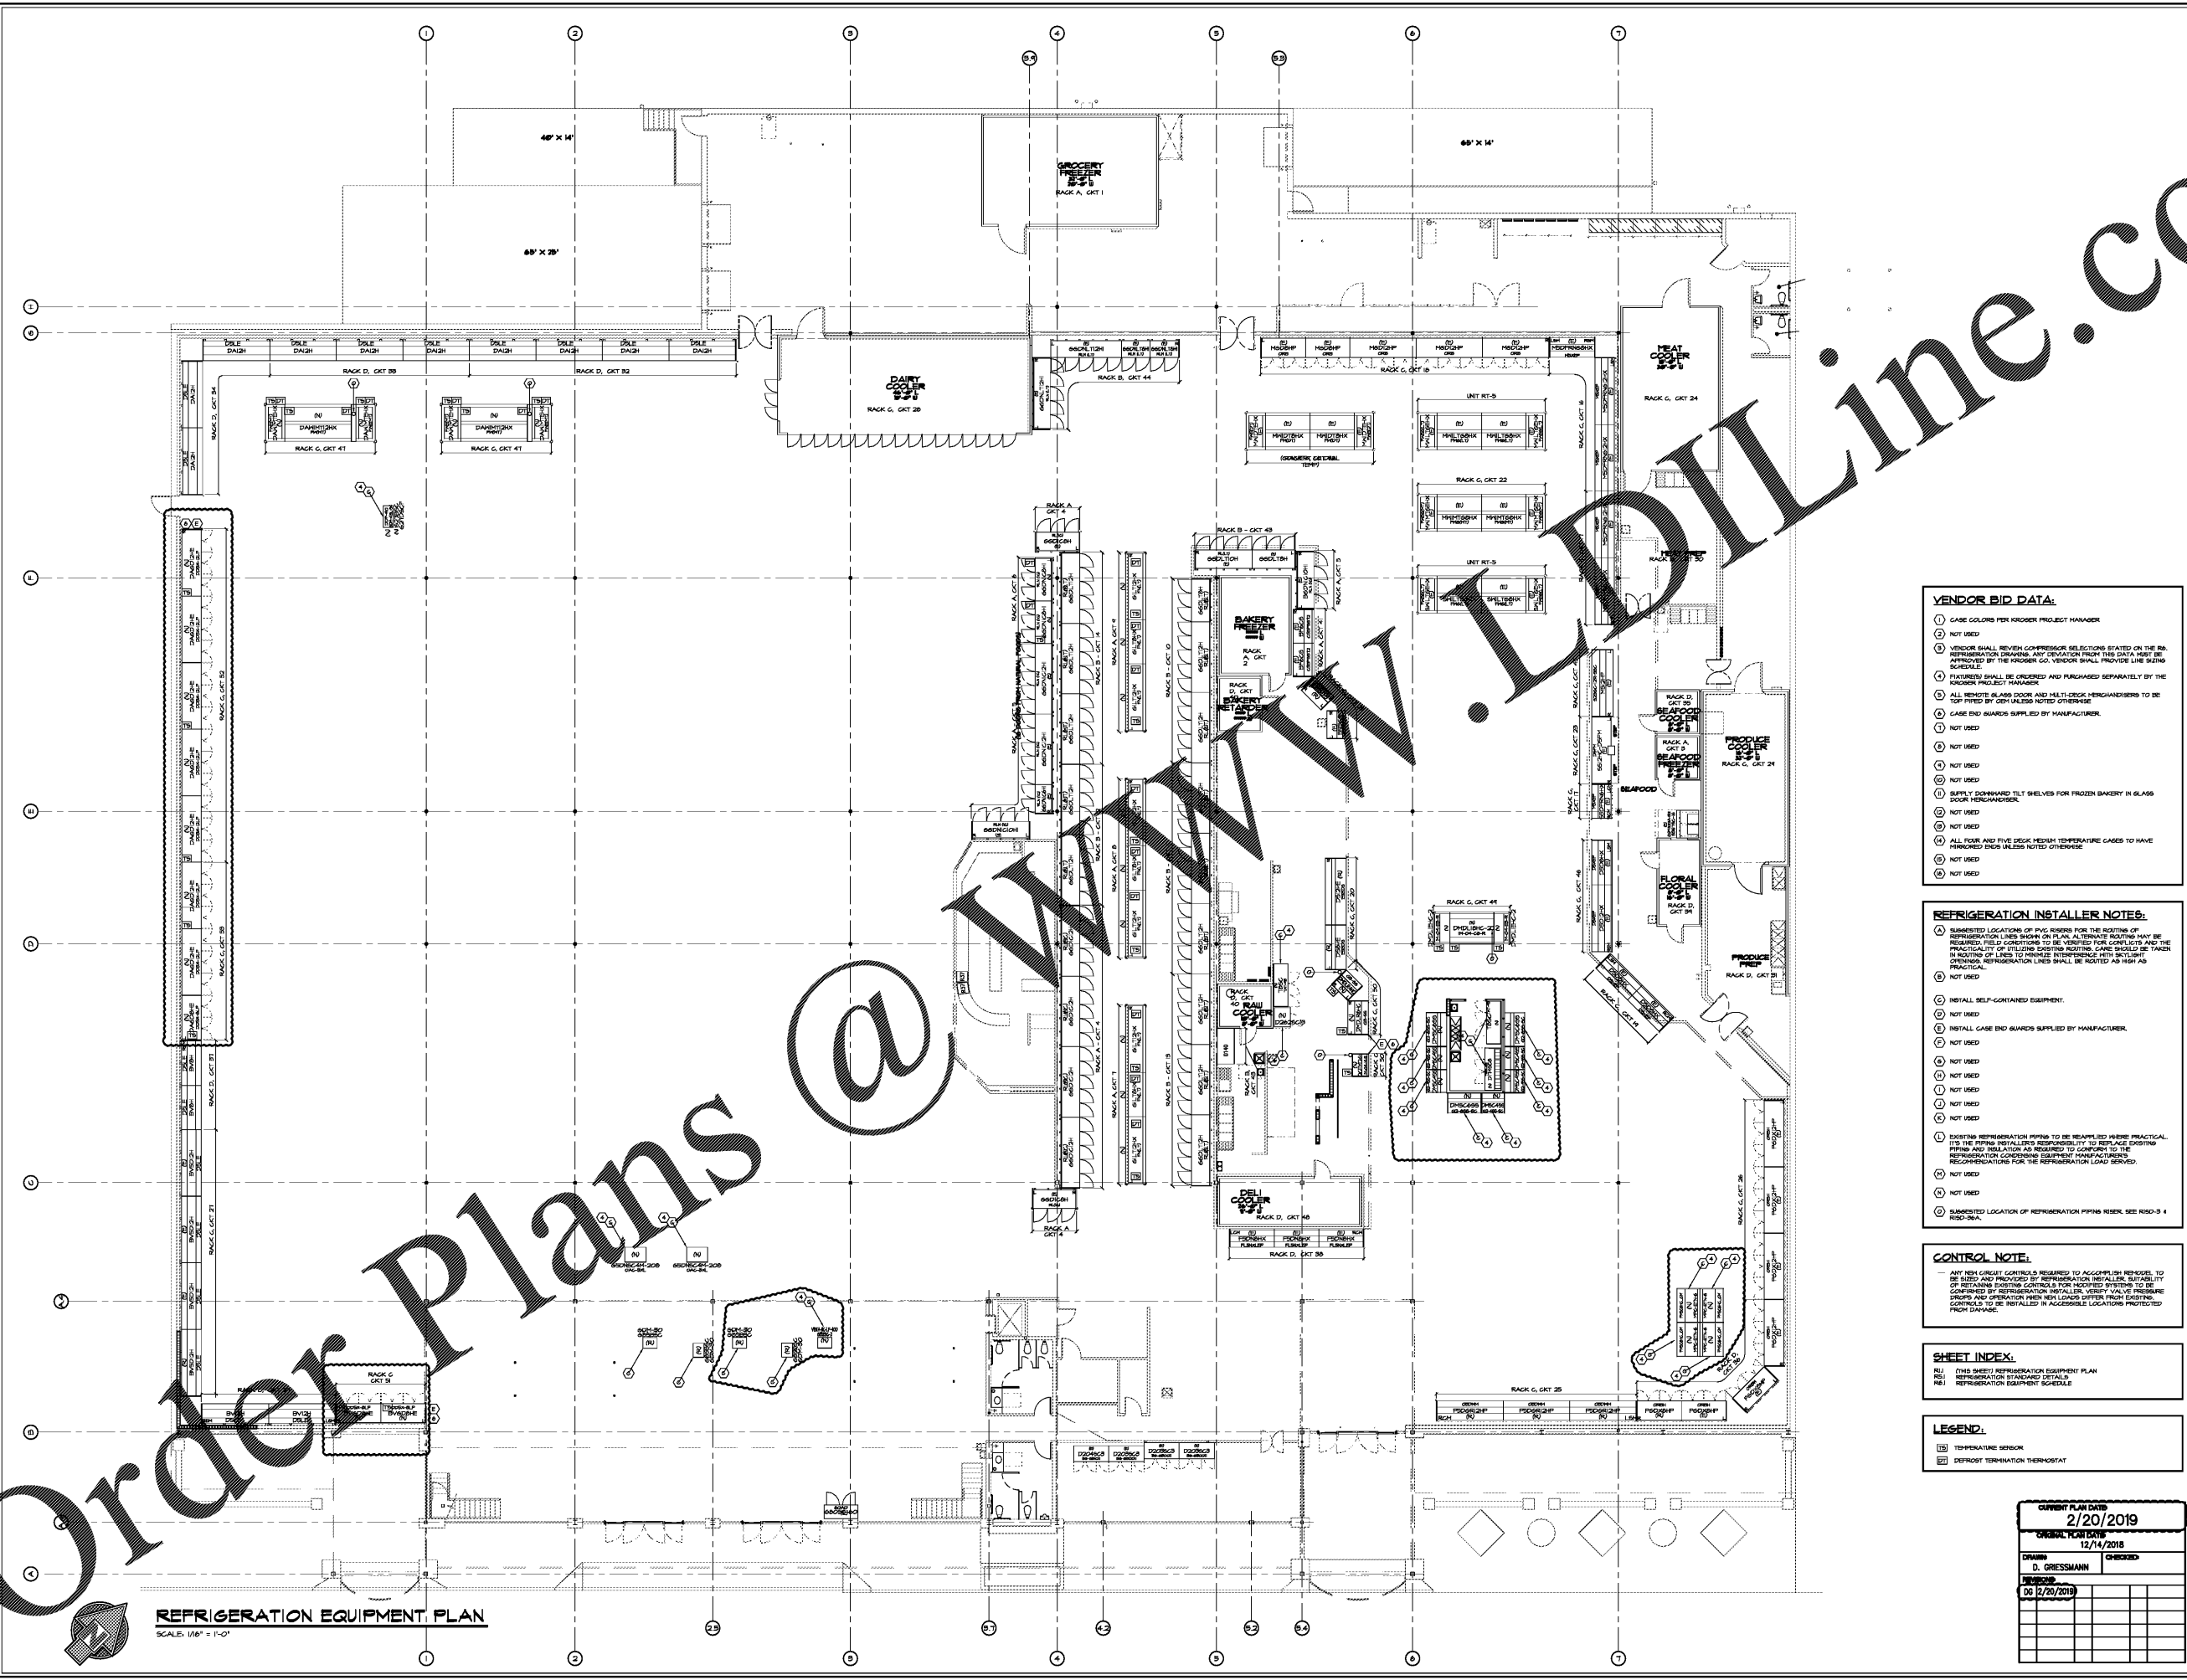

Order Plans @ www.dollah-ewers.com

REFRIGERATION EQUIPMENT PLAN
SCALE: 1/8" = 1'-0"