

**SITE CONSTRUCTION POLLUTION NOTES**

- CONSTRUCTION WASTES INCLUDES DEMOLITION RUBBLE, PACKAGING MATERIALS, SCRAP BUILDING SUPPLIES, ETC. CONTRACTOR SHALL SELECT A DESIGNATED WASTE COLLECTION AREA AND PROVIDE IDS FOR WASTE CONTAINERS. CONSTRUCTION WASTES SHALL BE REMOVED ON A CONSISTENT SCHEDULE.
- PESTICIDES SHALL BE STORED IN A DRY, COVERED AREA. CONTRACTOR SHALL PROVIDE CURBS, DIKES, OR BERMS SURROUNDING STORAGE AREAS. APPLICATION RATES SHALL BE FOLLOWED STRICTLY.
- FERTILIZER AND DETERGENT APPLICATIONS ARE TO BE LIMITED TO THE MINIMUM NEEDED. CONTRACTOR SHALL NOT DISCHARGE WASH WATER INTO THE STORM WATER SYSTEM.
- PETROLEUM PRODUCTS INCLUDE OIL, GASOLINE, LUBRICANTS, AND ASPHALTIC SUBSTANCES AND SHALL BE STORED IN COVERED AREAS PROTECTED BY DIKES. CONTRACTOR SHALL HAVE EQUIPMENT TO CONTAIN AND CLEAN UP PETROLEUM SPILLS IN FUEL STORAGE AREAS OR MAINTENANCE AND FUELING VEHICLES.
- SANITARY AND SEPTIC WASTES INCLUDE ON-SITE SANITARY FACILITIES. LOCATION OF THESE FACILITIES SHALL BE OUT OF HIGH FLOW AREAS. REGULAR SERVICING BY A QUALIFIED DOMESTIC WASTE HAULER IS REQUIRED. PROPOSED SANITARY SEWER WILL TIE INTO AN EXISTING COUNTY SYSTEM.
- CONTRACTOR SHALL STORE AND HANDLE MATERIALS TO PREVENT SPILLS. IF A SPILL OCCURS, CONTACT TO STORM WATER SHALL BE MINIMIZED.
- PRIOR TO MOBILIZATION, THE CONTRACTOR SHALL SUBMIT PROPOSED LOCATIONS OF ANY POTENTIAL POLLUTANT TO THE ENGINEER FOR APPROVAL.
- WASTE MATERIALS SHALL NOT BE DISCHARGED TO WATERS OF THE STATE, EXCEPT AS AUTHORIZED BY A SECTION 404 PERMIT.

**SITE MAINTENANCE NOTES:**

- THE DESIGN PROFESSIONAL WHO PREPARED E.S. & P.C. PLAN SHALL INSPECT THE INSTALLATION OF THE INITIAL SEDIMENT STORAGE REQUIREMENTS AND PERIMETER CONTROL BMP'S WITHIN 7 DAYS AFTER INSTALLATION.
- ANY AMENDMENTS AND/OR REVISIONS TO THE E.S. & P.C. PLANS WHICH WILL HAVE A SIGNIFICANT EFFECT ON BMP'S WITH HYDRAULIC COMPONENTS MUST BE CERTIFIED BY THE DESIGN PROFESSIONAL.
- WASTE MATERIALS SHALL NOT BE DISCHARGED TO WATERS OF THE STATE, EXCEPT AS AUTHORIZED BY A SECTION 404 PERMIT.
- THE ESCAPE OF SEDIMENT FROM THE SITE SHALL BE PREVENTED BY THE INSTALLATION OF EROSION SEDIMENT CONTROL MEASURES AND PRACTICES PRIOR TO, OR CONCURRENT WITH LAND-DISTURBING ACTIVITIES.
- EROSION CONTROL MEASURES WILL BE MAINTAINED AT ALL TIMES. IF FULL IMPLEMENTATION OF THE APPROVED PLAN DOES NOT PROVIDE FOR EFFECTIVE EROSION CONTROL, ADDITIONAL EROSION AND SEDIMENT CONTROL MEASURES SHALL BE IMPLEMENTED TO CONTROL OR TREAT SEDIMENT SOURCE.
- ANY DISTURBED AREA LEFT EXPOSED FOR A PERIOD GREATER THAN 14 DAYS SHALL BE STABILIZED WITH MULCH OR TEMPORARY SEEDING.
- DEVELOPERS AND/OR CONTRACTORS ARE RESPONSIBLE TO REMOVE OR CLEAN OUT ANY SILT, DIRT, MUD OR ANY OTHER TYPE OF DEBRIS THAT COMES OFF THEIR SITE AND FINDS ITS WAY INTO A PRIVATE POND, ONTO PRIVATE PROPERTY, INTO A COUNTY OWNED POND OR COUNTY OWNED PROPERTY TO INCLUDE RIGHTS-OF-WAY.
- THE CONTRACTOR SHALL COMPLY WITH THE "GEORGIA MANUAL FOR ON-SITE SEWAGE MANAGEMENT SYSTEMS" FOR WASTE DISPOSAL, SANITARY SEWER AND SEPTIC TANK INCLUDING ALL TEMPORARY MEASURES DURING CONSTRUCTION AND AFTER CONSTRUCTION ACTIVITIES HAVE BEEN COMPLETED.

**FUGITIVE DUST CONTROL NOTES**

GA. RULE 391-3-1-.02 - (N) - FUGITIVE DUST CONTROL

- ALL PERSONS RESPONSIBLE FOR ANY OPERATION, PROCESS, HANDLING, TRANSPORTATION OR STORAGE FACILITY WHICH MAY RESULT IN FUGITIVE DUST SHALL TAKE ALL REASONABLE PRECAUTIONS TO PREVENT SUCH DUST FROM BECOMING AIRBORNE. SOME REASONABLE PRECAUTIONS WHICH COULD BE TAKEN TO PREVENT DUST FROM BECOMING AIRBORNE INCLUDE, BUT ARE NOT LIMITED TO, THE FOLLOWING:
  - USE, WHERE POSSIBLE, OF WATER OR CHEMICALS FOR CONTROL OF DUST IN THE DEMOLITION OF EXISTING BUILDINGS OR STRUCTURES, CONSTRUCTION OPERATIONS, THE GRADING OF ROADS OR THE CLEARING OF LAND;
  - APPLICATION OF ASPHALT, OIL, WATER, OR SILT CHEMICALS ON DIRT ROADS, MATERIALS STOCKPILES, AND OTHER SURFACES WHICH CAN GIVE RISE TO AIRBORNE DUSTS;
  - INSTALLATION AND USE OF HOODS, FANS, AND FABRIC FILTERS TO ENCLOSE AND VENT THE HANDLING OF DUSTY MATERIALS. ADEQUATE CONTAINMENT METHODS SHOULD BE EMPLOYED DURING SANDBLASTING OR OTHER SIMILAR OPERATIONS;
  - COVERING, AT ALL TIMES, WHEN IN MOTION, OPEN BODIED TRUCKS, TRAILERS, AND MATERIALS LIKE TO GIVE RISE TO AIRBORNE DUSTS;
  - THE PERCENT REMOVAL OF EARTH OR OTHER MATERIAL FROM PAVED SURFACES ONTO WHICH EARTH OR OTHER MATERIAL HAS BEEN DEPOSITED.
- THE PERCENT OPACITY FROM ANY FUGITIVE DUST SOURCE LISTED IN PARAGRAPH (2)(N)1. ABOVE SHALL NOT EQUAL OR EXCEED 10 PERCENT.

**LAND GRADING FOR MINIMIZING EROSION**

- ONLY DISTURB, CLEAR, OR GRADE AREAS NECESSARY FOR CONSTRUCTION. FLAG OR OTHERWISE DELINEATE AREAS NOT TO BE DISTURBED. EXCLUDE VEHICLES AND CONSTRUCTION EQUIPMENT FROM THESE AREAS TO PRESERVE ALL GRADED OR DISTURBED AREAS INCLUDING SLOPES SHALL BE PROTECTED DURING CLEARING AND CONSTRUCTION IN ACCORDANCE WITH THE APPROVED EROSION AND SEDIMENT CONTROL PLAN UNTIL THEY ARE PERMANENTLY STABILIZED.
- ALL SEDIMENT CONTROL MEASURES SHALL BE CONSTRUCTED AND MAINTAINED IN ACCORDANCE WITH THE APPROVED EROSION AND SEDIMENT CONTROL PLAN AND ACCORDING TO THE STANDARDS AND SPECIFICATIONS FOR THE APPROPRIATE EROSION CONTROL PRACTICES.
- IF TOPSOIL IS REQUIRED FOR THE ESTABLISHMENT OF VEGETATION, IT SHALL BE STOCKPILED IN THE AMOUNT NECESSARY TO COMPLETE FINISHED GRADING AND PROTECTED FROM EROSION DURING THE INTERIM.
- AREAS TO BE FILLED SHALL BE CLEARED, GRUBBED TO REMOVE TREES, VEGETATION, ROOTS AND OTHER OBJECTIONABLE MATERIAL, AND STRIPPED OF TOPSOIL.
- AREAS TO RECEIVE TOPSOIL SHALL BE SCARIFIED TO A MINIMUM DEPTH OF 3 INCHES (76 MM) PRIOR TO PLACEMENT OF TOPSOIL.
- ALL FILLS SHALL BE COMPACTED AS REQUIRED BY BUILDING STANDARDS TO REDUCE EROSION, SLIPPAGE, SETTLEMENT, SUBSIDENCE AND OTHER RELATED PROBLEMS. FILL INTENDED TO SUPPORT BUILDINGS, STRUCTURES, CONDUITS, ETC., SHALL BE COMPACTED IN ACCORDANCE WITH LOCAL REQUIREMENTS OR CODES.
- THE OUTER FACE OF THE FILL SLOPE SHOULD BE ALLOWED TO STAY LOOSE, NOT ROLLED, COMPACTED, OR BLADED SMOOTH. A BULLDOZER MAY RUN UP AND DOWN THE FILL SLOPE SO THE DOZER TREADS (CLEAT TRACKS) CREATE GROOVES PERPENDICULAR TO THE SLOPE. IF THE SOIL IS NOT TOO MOIST, EXCESSIVE COMPACTION WILL NOT OCCUR.
- ALL FILL SHALL BE PLACED AND COMPACTED IN LAYERS NOT TO EXCEED 8 INCHES (0.2 M) PER LIFT.
- USE SLOPE BREAKS, SUCH AS DIVERSIONS, BENCHES, OR CONTOUR FURROWS AS APPROPRIATE, TO REDUCE THE LENGTH OF CUT-AND-FILL SLOPES TO LIMIT SHEET AND RILL EROSION AND PREVENT GULLY EROSION.
- THE FINISHED CUT-AND-FILL SLOPES, WHICH ARE TO BE VEGETATED WITH GRASS AND LEGUMES, SHOULD NOT BE STEEPER THAN 2:1.
- SLOPES TO BE MAINTAINED BY TRACTOR OR OTHER EQUIPMENT SHOULD NOT BE STEEPER THAN 3:1.
- SLOPES IN EXCESS OF 2:1 MAY REQUIRE HYDROSEEDING, HYDROMULCHING, TACTIFYING, AND/OR "PUNCHING-IN" STRAW, BIOENGINEERING TECHNIQUES, OR RETAINING WALLS.
- ROUGHEN THE SURFACE OF ALL SLOPES DURING THE CONSTRUCTION OPERATION TO RETAIN WATER, INCREASE INFILTRATION, AND FACILITATE VEGETATION ESTABLISHMENT.
- SEEPS OR SPRINGS ENCOUNTERED DURING CONSTRUCTION SHALL BE HANDLED IN ACCORDANCE WITH APPROVED METHODS.
- STABILIZE ALL GRADED AREAS WITH VEGETATION, CRUSHED STONE, RIPRAP, OR OTHER GROUND COVER AS SOON AS GRADING IS COMPLETED OR IF WORK IS INTERRUPTED FOR 21 WORKING DAYS OR MORE.
- USE MULCH TO STABILIZE AREAS TEMPORARILY WHERE FINAL GRADING MUST BE DELAYED.
- STOCKPILES, BORROW AREAS AND SPOIL AREAS SHALL BE SHOWN ON THE PLANS AND SHALL BE STABILIZED TO PREVENT EROSION AND SEDIMENTATION.

**SPILL RESPONSE PLAN**

THE GOAL OF THE SPILL RESPONSE PLAN IS TO REDUCE SAFETY, HEALTH, AND ENVIRONMENTAL RISKS ASSOCIATED WITH A HAZARDOUS SUBSTANCE INCIDENT. IN THE EVENT OF A SPILL, THE FOLLOWING ACTIONS SHOULD BE IMPLEMENTED:


- SECURE AND EVACUATE THE AREA - KEEP UNAUTHORIZED PERSONS OUT OF THE AREA.
- REPORT THE SPILL -
- ALL SPILLS > 5 GALLONS MUST BE IMMEDIATELY REPORTED TO THE FIRE DEPARTMENT AT 911.
- SPILLS THAT ARE < 5 GALLONS MUST BE REPORTED IF THE SPILL ENTERS A STORM DRAIN, CREEK, LAKE, OR OTHER BODY OF WATER, OR CANNOT BE SAFELY CONTAINED AND CLEANED UP BY ORGANIZATION PERSONNEL.
- PROVIDE ANY PERTINENT INFORMATION, INCLUDING:
  - SUBSTANCE SPILLED
  - LOCATION OF SPILL
  - NATURE AND EXTENT OF INJURIES
  - EXTENT TO WHICH SPILL TRAVELED
  - ESTIMATED AMOUNT SPILLED
  - TIME SPILL OCCURRED
- PROTECT YOURSELF - DONN APPROPRIATE PROTECTIVE EQUIPMENT, SUCH AS:
  - PROTECTIVE GOGGLES
  - PROTECTIVE APRON
  - LEATHER GLOVES
  - IMPERMEABLE RUBBER GLOVES
  - RESPIRATORS
- STOP THE FLOW - STOP OR SLOW FLOW OF HAZARDOUS SUBSTANCE IF IT CAN BE DONE SAFELY.
  - PLUG OR PATCH PUNCTURED CONTAINER(S)
  - RIGHT OVERTURNED OR TIPPED CONTAINER(S)
  - CLOSE APPROPRIATE VALVE(S)
- CONTAIN THE SPILL - THE SPILLED SUBSTANCE SHOULD BE CONTAINED WITHIN THE IMMEDIATE AREA. PREVENT FLOW TOWARDS DRAINAGE DITCHES, AND SEWER SYSTEMS IF IT CAN BE DONE SAFELY.
  - PLACE NONREACTIVE ABSORBENT MATERIAL SUCH AS SAND, EARTH, STRAW, VERMICULITE, ABSORBENT PILLOWS OR BOOMS ON THE SPILL.
  - BLOCK THE SPILL FROM ENTERING STORM DRAINS OR SEWERS BY CONSTRUCTING A DIKE AROUND ALL POINTS OF ENTRY.
  - IF THE SPILL IS ON THE GROUND, CLEAN UP IMMEDIATELY BY DIGGING UP THE CONTAMINATED SOIL, PLACING IT IN PROPER CONTAINERS, AND DISPOSING OF IT PROPERLY.

**DUST CONTROL BY IRRIGATION**

- THE CONTRACTOR SHALL CONDUCT OPERATIONS AND MAINTAIN THE PROJECT SITE SO AS TO MINIMIZE THE CREATION AND DISPERSION OF DUST. DUST CONTROL SHALL BE USED THROUGHOUT THE WORK AT THE SITE.
- THE CONTRACTOR MUST PROVIDE CLEAN WATER, FREE FROM SALT, OIL AND OTHER DELETERIOUS MATERIALS TO BE USED FOR ON-SITE DUST CONTROL.
- THE CONTRACTOR SHALL SUPPLY WATER SPRAYING EQUIPMENT CAPABLE OF ACCESSING ALL WORK AREAS.
- THE CONTRACTOR SHALL IMPLEMENT STRICT DUST CONTROL MEASURES DURING ACTIVE CONSTRUCTION PERIODS ON-SITE. THESE CONTROL MEASURES WILL GENERALLY CONSIST OF WATER APPLICATIONS THAT SHALL BE APPLIED A MINIMUM OF ONCE PER DAY DURING DRY WEATHER OR MORE OFTEN AS REQUIRED TO PREVENT DUST EMISSIONS.
- FOR WATER APPLICATION TO UNDISTURBED OIL SURFACES, THE CONTRACTOR SHALL:
  - APPLY WATER WITH EQUIPMENT CONSISTING OF TANK, SPRAY BAR, PUMP DISCHARGE PRESSURE GAUGE
  - ARRANGE SPRAY BAR HEIGHT, NOZZLE SPACING AND SPRAY PATTERN TO PROVIDE COMPLETE COVERAGE OF GROUND WATER.
  - DISPERSE WATER THROUGH NOZZLES ON SPRAY BAR AT 20 PSI MINIMUM. KEEP AREAS DAMP WITHOUT CREATING NUISANCE CONDITIONS SUCH AS PONDING.
- FOR WATER APPLICATION TO SOIL SURFACES DURING DEMOLITION AND/OR EXCAVATION, THE CONTRACTOR SHALL:
  - APPLY WATER WITH EQUIPMENT CONSISTING OF A TANK, PUMP WITH DISCHARGE GAUGE, HOSES AND MIST NOZZLES.
  - LOCATE TANK AND SPRAYING EQUIPMENT SO THAT THE ENTIRE EXCAVATION AREA CAN BE MISTED WITHOUT INTERFERING WITH DEMOLITION AND/OR EXCAVATION EQUIPMENT OR OPERATIONS.
  - KEEP AREAS DAMP WITHOUT CREATING NUISANCE CONDITIONS SUCH AS PONDING.
  - APPLY WATER SPRAY IN A MANNER TO PREVENT MOVEMENT OF SPRAY BEYOND CONSTRUCTION BOUNDARIES.
- CONTRACTOR SHALL REFER TO "MANUAL FOR EROSION AND SEDIMENT CONTROL IN GEORGIA" LATEST EDITION FOR ADDITIONAL INFORMATION ON TEMPORARY AND PERMANENT DUST CONTROL BMP'S.



**TOPSOILING**

- DETERMINE WHETHER THE QUALITY AND QUANTITY OF AVAILABLE TOPSOIL JUSTIFIES SELECTIVE HANDLING.
- SOILS OF THE TEXTURAL CLASS OF LOAM, SANDY LOAM, AND SILT LOAM ARE BEST. SANDY CLAY LOAM, SILTY CLAY LOAM, CLAY LOAM AND LOAMY SAND ARE FAIR. DO NOT USE HEAVY CLAY & ORGANIC SOILS SUCH AS PEAT OR MUCK AS TOPSOIL.
- STRIP TOPSOIL ONLY FROM THOSE AREAS THAT WILL BE DISTURBED BY EXCAVATION, FILLING, ROAD BUILDING, OR COMPACTING BY EQUIPMENT. A 4-6 INCHES (0.1-0.2 M) STRIPPING DEPTH IS COMMON, BUT DEPTH VARIES DEPENDING ON THE SITE.
- DETERMINE DEPTH OF STRIPPING BY TAKING SOIL CORES AT SEVERAL LOCATIONS WITHIN EACH AREA TO BE STRIPPED. TOPSOIL DEPTH GENERALLY VARIES ALONG A GRADIENT FROM HILL TOP TO TOE OF THE SLOPE.
- PUT SEDIMENT BASINS, DIVERSIONS, AND OTHER CONTROLS INTO PLACE BEFORE STRIPPING.
- SELECT STOCKPILE LOCATION TO AVOID SLOPES, NATURAL DRAINAGE WAYS, AND TRAFFIC ROUTES. ON LARGE SITES, RE-SPREADING IS EASIER AND MORE ECONOMICAL WHEN TOPSOIL IS ECONOMICALLY WHEN TOPSOIL IS STOCKPILED IN SMALL PILES LOCATED NEAR AREAS WHERE THEY WILL BE USED.
- USE SILT FENCES OR OTHER BARRIERS WHERE NECESSARY TO RETAIN SEDIMENT.
- PROTECT TOPSOIL STOCKPILES BY TEMPORARILY SEEDING AND/OR MULCHING AS SOON AS POSSIBLE TO ASSURE THE STORED MATERIAL IS NOT EXPOSED AND ALLOWED TO ERODE.
- IF STOCKPILES WILL NOT BE USED WITHIN 12 MONTHS THEY MUST BE STABILIZED WITH PERMANENT VEGETATION TO CONTROL EROSION AND WEED GROWTH.
- BEFORE SPREADING TOPSOIL, ESTABLISH EROSION AND SEDIMENTATION CONTROL PRACTICES SUCH AS DIVERSIONS, BERMS, DIKES, WATERWAYS AND SEDIMENT BASINS.
- WHERE THE PH OF THE EXISTING SUBSOIL IS 6.0 OR LESS, OR THE SOIL IS COMPOSED OF HEAVY CLAYS, INCORPORATE AGRICULTURAL LIMESTONE IN AMOUNTS RECOMMENDED BY SOIL TESTS OR SUBSTITUTED FOR THE SEEDING MIXTURE TO BE USED. INCORPORATE LIME TO A DEPTH OF AT LEAST 6 INCHES (150 MM) BY DISKING.
- IMMEDIATELY PRIOR TO SPREADING THE TOPSOIL, LOOSEN THE SUBGRADE BY DISKING OR SCARIFYING TO A DEPTH OF AT LEAST 3 INCHES (76 MM), TO ENSURE BONDING OF THE TOPSOIL AND SUBSOIL. IF NO AMENDMENTS HAVE BEEN INCORPORATED, LOOSEN THE SOIL TO A DEPTH OF AT LEAST 6 INCHES (0.15 M) BEFORE SPREADING TOPSOIL.
- UNIFORMLY DISTRIBUTE TOPSOIL TO A MINIMUM COMPACTED DEPTH OF 2 INCHES (50 MM) ON 3:1 SLOPES AND 4 INCHES (0.1 M) ON FLATTER SLOPES.
- DO NOT SPREAD TOPSOIL WHEN IT IS FROZEN, MUDDY, OR WHEN THE SUBGRADE IS WET OR FROZEN.
- CORRECT ANY IRREGULARITIES IN THE SURFACE THAT RESULT FROM TOPSOILING OR OTHER OPERATIONS TO PREVENT THE FORMATION OF DEPRESSIONS OR OTHER POCKETS.
- COMPACT THE TOPSOIL ENOUGH TO ENSURE GOOD CONTACT WITH THE UNDERLYING SOIL, BUT AVOID EXCESSIVE COMPACTION, AS IT DECREASES RUNOFF AND INHIBITS SEED GERMINATION. LIGHT PACKING WITH A ROLLER IS RECOMMENDED WHEN HIGH MAINTENANCE TURF IS TO BE ESTABLISHED.
- ON SLOPES AND AREAS THAT WILL NOT BE MOVED, THE SURFACE MAY BE LEFT ROUGH AFTER SPREADING TOPSOIL. A RAKE MAY BE USED TO PREVENT PONDING AT THE INTERFACE BETWEEN THE TOPSOIL AND SUBSOIL.

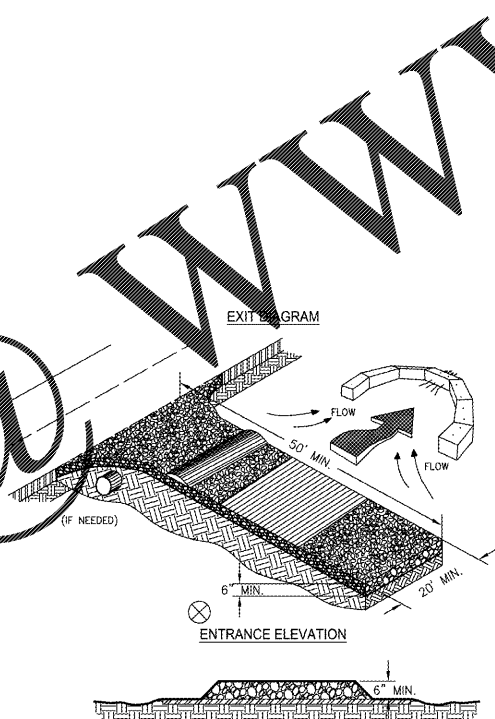

- NOTES:**
- AVOID LOCATING ON STEEP SLOPES OR AT CURVES ON PUBLIC ROADS.
  - REMOVE ALL VEGETATION AND OTHER UNSUITABLE MATERIAL FROM THE FOUNDATION AREA, GRADE, AND CROWN FOR POSITIVE DRAINAGE.
  - AGGREGATE SIZE SHALL BE IN ACCORDANCE WITH NATIONAL STONE ASSOCIATION R-2 (1.5"-3.5" STONE).
  - GRAVEL PAD SHALL HAVE A MINIMUM THICKNESS OF 6".
  - PAD WIDTH SHALL BE EQUAL FULL WIDTH AT ALL POINTS OF VEHICULAR EGRESS, BUT NO LESS THAN 20'.
  - A DIVERSION RIDGE SHOULD BE CONSTRUCTED WHEN GRADE TOWARD PAVED AREA IS GREATER THAN 2%.
  - INSTALL PIPE UNDER THE ENTRANCE IF NEEDED TO MAINTAIN DRAINAGE DITCHES.
  - WHEN WASHING IS REQUIRED, IT SHOULD BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE THAT DRAINS INTO AN APPROVED SEDIMENT TRAP OR SEDIMENT BASIN (DIVERT ALL SURFACE RUNOFF AND DRAINAGE FROM THE ENTRANCE TO A SEDIMENT CONTROL DEVICE).
  - WASHRACKS AND/OR TIRE WASHERS MAY BE REQUIRED DEPENDING ON SCALE AND CIRCUMSTANCE. IF NECESSARY, WASHRACK DESIGN MAY CONSIST OF ANY MATERIAL SUITABLE FOR TRUCK TRAFFIC THAT REMOVE MUD AND DIRT.
  - MAINTAIN AREA IN A WAY THAT PREVENTS TRACKING AND/OR FLOW OF MUD ONTO PUBLIC RIGHTS-OF-WAYS. THIS MAY REQUIRE TOP DRESSING, REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT.

**Crushed Stone Construction Exit**

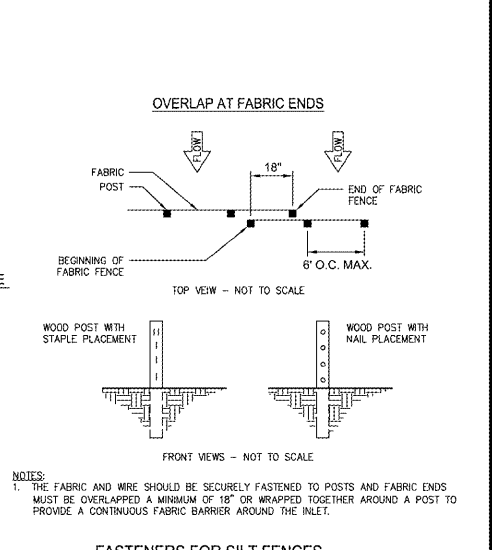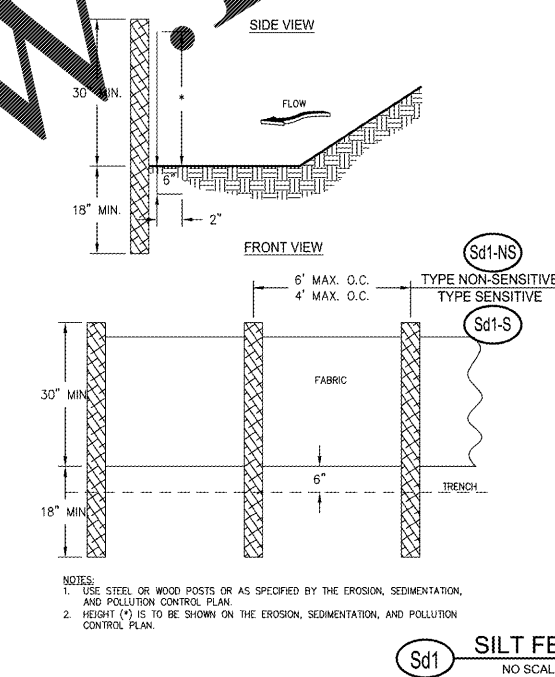

- NOTES:**
- THE FABRIC AND WIRE SHOULD BE SECURELY FASTENED TO POSTS AND FABRIC ENDS MUST BE OVERLAPPED A MINIMUM OF 18" OR WRAPPED TOGETHER AROUND A POST TO PROVIDE A CONTINUOUS FABRIC BARRIER AROUND THE INLET.

**JJA**  
 ARCHITECTS, ENGINEERS, PLANNERS & INTERIORS  
 JOHN L. JOHNSON, L.L.C. & JOHN R. JOHNSON & ASSOCIATES, P.C.  
 AUGUSTA, GA • MT. PLEASANT, SC  
 TEL: (706) 724-2756 • TEL: (843) 619-4656  
 FAX: (706) 724-3935  
 WWW.THEJAGROUP.COM

CLIENT: AUGUSTA, GA  
 535 TELFAIR STREET, AUGUSTA, GA 30901  
 PROJECT NAME:  
 PROJECT LOCATION:  
 2820 OLD HIGHWAY 1, HEPHIZIBAH, GEORGIA 30815

NO.	DESCRIPTION	DATE	BY
0	ISSUED FOR BID	12/21/18	DRWN

NO.	DESCRIPTION	DATE	BY
0	ISSUED FOR BID	12/21/18	DRWN

PROJECT NO: 3042.1604  
 DRAWN BY: DRWN  
 CHECKED BY: CHK  
 DATE: 8/10/18  
 SHEET TITLE:  
**E.S.P.C. NOTES & DETAILS - 1 OF 5**  
 SCALE: AS NOTED  
 DRAWING NO. C-504  
 REV. 0

**GSWCC** Georgia Society of Water Conservation Engineers  
 WILLIAM T. BUCHANAN  
 Level II Certified Design Professional  
 CERTIFICATION NUMBER: 0900065516  
 EXPIRES: 1/25/2021