

Order Plans

WWW.DIEM.COM

**GENERAL NOTES**

- SEE SHEET E0.1 FOR PROJECT ELECTRICAL GENERAL NOTES AND LEGEND.
- SEE SHEET E8.2.4 FOR LIGHT FIXTURE SCHEDULE.
- SEE SHEET E8.2.4 FOR LIGHTING CONTACTOR SCHEDULE. REFER TO ESD-13 FOR LIGHTING CONTACTOR WIRING DIAGRAM.
- ALL ELECTRICAL CONDUITS IN SALES AREA DESCENDING FROM ROOF FRAMING SHALL BE COORDINATED AND GROUPED WITH MECHANICAL PIPES.
- COORDINATE AND VERIFY FINAL LOCATIONS, POSITIONS AND MOUNTING DETAILS OF ALL FIXTURES WITH OTHER TRADES INCLUDING BUT NOT LIMITED TO: CEILING, MILLWORK, TRELLIS, SHELVING, HVAC, ETC.
- THE QUIESCENT SENSING DEVICE LOCATIONS SHALL HAVE PRIORITY OVER THE INTERIOR LIGHTING PATTERN. WHERE INTERFERENCE OCCURS, ELECTRICAL CONTRACTOR SHOULD ADJUST THE LIGHTING PATTERN AS NEEDED TO ACCOMMODATE THE REQUIREMENTS OF THE QUIESCENT SENSING DEVICES. CONTRACTOR TO COORDINATE ALL ADJUSTMENTS WITH THE QUIESCENT INSTALLATION REPRESENTATIVE AND THE KROGER PROJECT MANAGER.
- REFER TO ESD-53 FOR LIGHTING CONTROLS.
- SEE ESD-51 FOR MOUNTING FIXTURES IN OPEN STRUCTURE BEAMS.
- ALL LAMPS IN OPEN FIXTURES OVER OPEN PRODUCT CASES, ISLAND, CHEF, SOUP/SALAD ISLANDS MUST BE PROVIDED WITH TUBE SHROUDS OR LAMPS.
- LIGHTING FIXTURES WITH TWO BALLASTS SHALL HAVE BOTH BALLASTS WIRED TOGETHER IF FIXTURE IS CIRCUITED TO ONLY ONE CIRCUIT.
- MINIMUM BRANCH CIRCUIT WIRE SIZE SHALL BE #12. INCREASE WIRE SIZE AS REQUIRED TO PROVIDE A 1.5% VOLTAGE DROP TO THE EQUIPMENT OR LAST DEVICE IN THE CIRCUIT. INCREASED WIRE SIZE WILL NOT FIT IN THE TRUNKS OR LUGS OF THE EQUIPMENT OR DEVICE. PROVIDE PICTALS TO REDUCE TO #12. PROVIDE ANY JUNCTION BOXES AS REQUIRED.
- EXIT LIGHTS ARE PHOTOLUMINESCENT TYPE FURNISHED AND INSTALLED BY THE GENERAL CONTRACTOR. NO POWER CONNECTION REQUIRED.
- ALL LIGHTS FIXTURES IN THE SALES AREA ARE TYPE "B10" U.O.I. REFER TO DETAIL #01 ON SHEET E5.2 FOR WIRING OF "B10" FIXTURES.

**KEYNOTES**


- RUN CONDUITS FOR LIGHTING CIRCUITS OUTSIDE OF THE COOLER OR PREP AREA, ABOVE THE INSULATED PANEL CEILING AND STUB DOWN THROUGH PANEL INTO TOP OF LIGHT FIXTURES. SEE ESD-26.
- INTERLOCK NEW RESTROOM LIGHT FIXTURES WITH EXHAUST FAN. REFER TO DETAIL #02 ON SHEET E5.2.1.
- MOMENTARY OVERRIDE SWITCH TO CONTROL CLICKLIST LIGHTS. PROVIDE CONTACTOR C38 IN CEILING SPACE ABOVE.
- MOMENTARY OVERRIDE SWITCH TO CONTROL PHARMACY LIGHTS. PROVIDE CONTACTOR C39 IN CEILING SPACE ABOVE.
- LIGHT MOUNTED AT JOISTS ABOVE COOLER. REFER TO DETAIL #03 ON SHEET E5.2 FOR SIMILAR INSTALLATION.
- PROVIDE SWITCH ADJACENT TO TOP OF LADDER. REFER TO DETAIL #03 ON SHEET E5.2 FOR SIMILAR INSTALLATION.
- PROVIDE SWITCH AT IDF CABINET. REFER TO DETAIL #03 ON SHEET E5.2 FOR SIMILAR INSTALLATION.
- SEE ASD-62A FOR DOUBLE DOCK LIGHT MOUNTING DETAIL. SEE SHEET E1.3.1 FOR DOCK LIGHT RECEPTACLE AND CIRCUITING INFORMATION.
- INSTALL MOTION SENSOR TO REFRIGERATION CASE(S). CASE LIGHTS CIRCUITS TO BE CONTROLLED BY SENSOR. REFER TO ESD-1 FOR ADDITIONAL INFORMATION. OCCUPANCY SENSOR CONTROLS CASE(S) INDICATED BY DIRECTIONAL ARROWS. REFER TO SHEET E1.3.3 FOR LIGHTING CIRCUIT.
- WIRE THE BALLASTS TOGETHER IN ALL "B2" TYPE FIXTURES IN VESTIBULE.
- REFER TO DETAIL #06 ON SHEET E5.2.1 FOR MOUNTING DETAIL OF NN13E FIXTURE.
- DISCONNECT EXISTING NORMAL LIGHT FIXTURES FROM PANEL "LD" (TO BE REMOVED DURING DEMOLITION). CONNECT FIXTURES TO NEW PANEL LC23. MODIFY EXISTING WIRING AS NECESSARY.
- DISCONNECT EXISTING EMERGENCY LIGHT FIXTURES FROM PANEL "LA" (TO BE REMOVED DURING DEMOLITION). CONNECT FIXTURE TO HEM-19. MODIFY EXISTING WIRING AS NECESSARY.
- DISCONNECT EXISTING NORMAL LIGHT FIXTURES FROM PANEL "LD" (TO BE REMOVED DURING DEMOLITION). CONNECT FIXTURE TO NEW PANEL HEM-19. MODIFY EXISTING WIRING AS NECESSARY.
- EXTERIOR WALL PACK SHOWN FOR COORDINATION PURPOSES ONLY. REFER TO SITE ELECTRICAL PLAN ON SHEET E1.6 FOR FIXTURE TYPE AND CIRCUITING.
- PHOTO LUMINESCENT EXIT SIGN BY GENERAL CONTRACTOR - REFER TO SPECIFICATIONS



**KROGER**  
STORE #473

2013 UNIVERSITY AVENUE  
OXFORD, MISSISSIPPI 38655

A DEVELOPMENT OF  
THE KROGER COMPANY




**naos**  
Naos Design Group Of Mississippi, PLLC.

MARC BREETZ  
ARCHITECT

645 Lakeland East Drive  
Suite 101  
Flowood, Mississippi 39232  
(p) 303.759.5777  
(f) 720.360.4281

ARCHITECT OF RECORD



**CDS**  
COMMERCIAL DESIGN SYSTEMS, INC.

13825 SW GALLEREA DRIVE  
SHERWOOD, OREGON 97140  
503.855.7000 (P) 503.855.8922

INTERIOR DECOR



**Pickering**  
Pickering Firm, Inc.  
Architecture - Engineering  
Planning - Surveying

6775 Lenox Center Court, Suite 300  
Memphis, TN 38115  
901.726.8816

ENGINEER OF RECORD:  
STRUCTURAL  
MECHANICAL  
ELECTRICAL  
CIVIL ENGINEER



**VSOFT**  
INFRASTRUCTURE

11280 CHESTER ROAD  
CINCINNATI, OH 45246  
T: 513-990-3819  
LOW VOLTAGE




**telgian**  
TELGIAN CORPORATION  
10230 SOUTH 60TH PLACE  
SUITE 100  
PHOENIX, AZ 85044  
T: (677) 836-4426  
HTTP://WWW.TELGIAN.COM  
FIRE PROTECTION

**ISSUE LOG**

NO.	REV.	DESCRIPTION	DATE
1	-	PERMIT SET	12/06/18
2	-	BID SET	03/21/19

JOB: 2019041 SCALE: AS SHOWN  
SHEET NO.

**E1.1.1**  
PARTIAL LIGHTING PLAN WEST

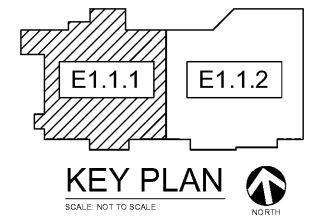

01 PARTIAL LIGHTING PLAN WEST  
SCALE: 3/32" = 1'-0"

