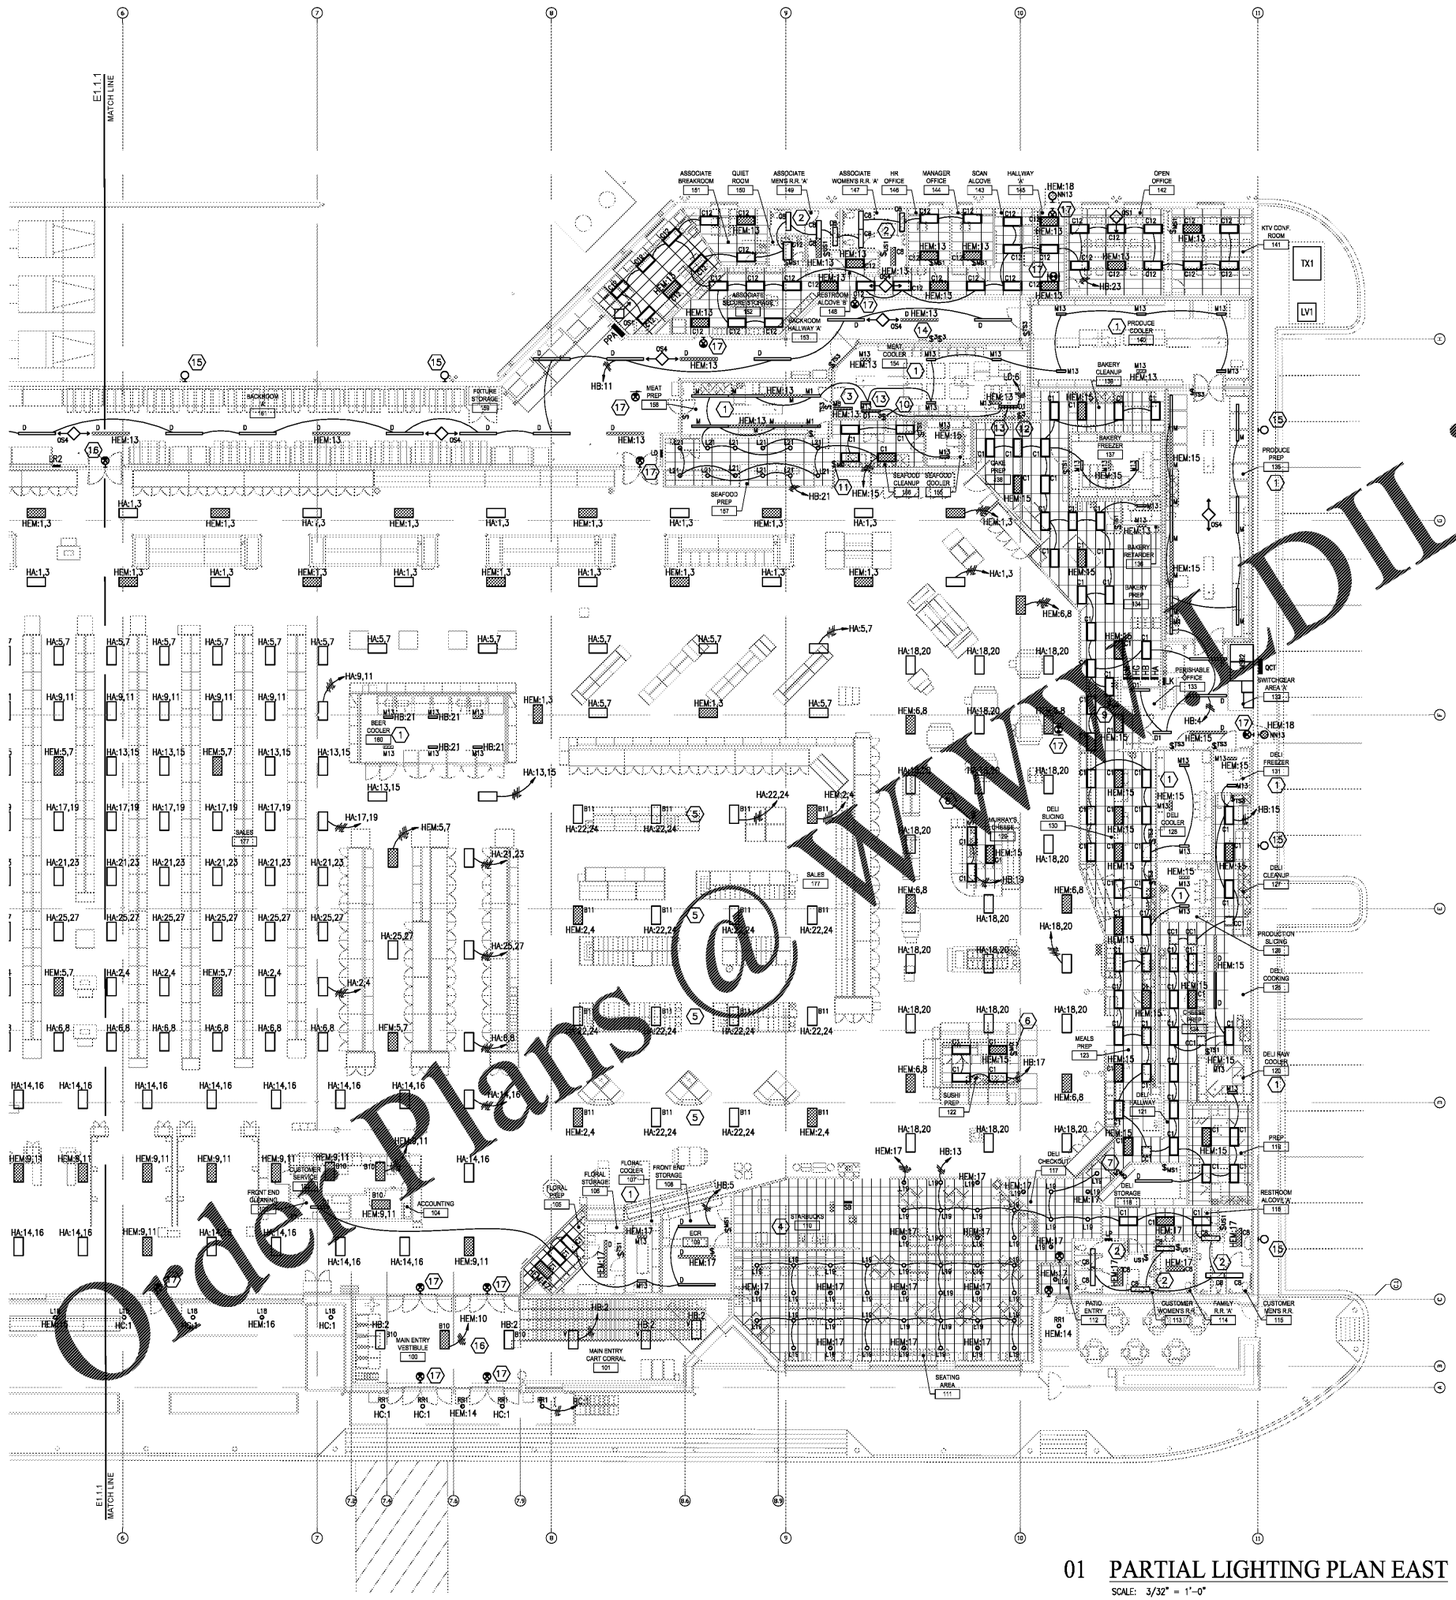

01 PARTIAL LIGHTING PLAN EAST

SCALE: 3/32" = 1'-0"

GENERAL NOTES

1. SEE SHEET E0.1 FOR PROJECT ELECTRICAL GENERAL NOTES AND LEGEND.
2. SEE SHEET E6.2.4 FOR LIGHT FIXTURE SCHEDULE.
3. SEE SHEET E6.2.4 FOR LIGHTING CONTACTOR SCHEDULE. REFER TO ESD-13 FOR LIGHTING CONTACTOR WIRING DIAGRAM.
4. ALL ELECTRICAL CONDUITS IN SALES AREA DESCENDING FROM ROOF FRAMING SHALL BE COORDINATED AND GROUPED WITH MECHANICAL PIPES.
5. COORDINATE AND VERIFY FINAL LOCATIONS, POSITIONS AND MOUNTING DETAILS OF ALL FIXTURES WITH OTHER TRADES INCLUDING BUT NOT LIMITED TO: CEILING, MILLWORK, TRELLIS, SHELVING, HVAC, ETC.
6. THE QUEVISION SENSING DEVICE LOCATIONS SHALL HAVE PRIORITY OVER THE INTERIOR LIGHTING PATTERN. WHERE INTERFERENCE OCCURS, ELECTRICAL CONTRACTOR SHOULD ADJUST THE LIGHTING PATTERN AS NEEDED TO ACCOMMODATE THE REQUIREMENTS OF THE QUEVISION SENSING DEVICES. CONTRACTOR TO COORDINATE ALL ADJUSTMENTS WITH THE QUEVISION INSTALLATION REPRESENTATIVE AND THE KROGER PROJECT MANAGER.
7. REFER TO ESD-53 FOR LIGHTING CONTROLS.
8. SEE ESD-51 FOR MOUNTING FIXTURES IN OPEN STRUCTURED AREAS.
9. ALL LAMPS IN OPEN FIXTURES OVER OPEN PRODUCE CASES, DELI, CHEESE, SOUP/SALAD ISLANDS MUST BE PROVIDED WITH TUBE GUARDS OR LAMPS.
10. LIGHTING FIXTURES WITH TWO BALLASTS SHALL HAVE BOTH BALLASTS REWIRED TOGETHER IF FIXTURE IS CIRCUITED TO ONLY ONE CIRCUIT.
11. MINIMUM BRANCH CIRCUIT WIRE SIZE SHALL BE #12. INCREASE WIRE SIZE AS REQUIRED TO PROVIDE A 1.5 PERCENT VOLTAGE DROP TO THE EQUIPMENT OR LAST DEVICE ON THE CIRCUIT. IF INCREASED WIRE SIZE WILL NOT FIT IN THE TERMINALS OR LUGS OF THE EQUIPMENT OR DEVICE, PROVIDE PIGTAILS TO REDUCE TO #12. PROVIDE ANY JUNCTION BOXES AS REQUIRED.
12. ALL EXIT SIGNS ARE PHOTOLUMINESCENT TYPE FURNISHED AND INSTALLED BY THE GENERAL CONTRACTOR. NO POWER CONNECTION REQUIRED.
13. ALL LIGHTS FIXTURES IN THE SALES AREA ARE TYPE "B10" U.O.I. REFER TO DETAIL #01 ON SHEET E5.2 FOR WIRING OF "B10" FIXTURES.

KEYNOTES

1. RUN CONDUITS FOR LIGHTING CIRCUITS OUTSIDE OF THE COOLER OR PREP AREA, ABOVE THE INSULATED PANEL CEILING AND STUB DOWN THROUGH PANEL INTO TOP OF LIGHT FIXTURES. SEE ESD-26.
2. INTERLOCK NEW RESTROOM LIGHT FIXTURES WITH EXHAUST FAN. REFER TO DETAIL #02 ON SHEET E5.2.1.
3. MOUNT NEW "M8" TYPE FIXTURE ABOVE GRINDER. COORDINATE FINAL LOCATION WITH PROJECT MANAGER.
4. LIGHTING IN THIS AREA TO BE PROVIDED BY TENANT BUT INSTALLED BY GENERAL CONTRACTOR. SEE STARBUCK'S DRAWINGS AND LIGHTING FIXTURE SCHEDULE ON SHEET E6.2.4.
5. REFER TO DETAIL #02 ON SHEET E5.2 FOR WIRING OF "B4" FIXTURES.
6. MOMENTARY OVERRIDE SWITCH TO CONTROL SUSHI LIGHTS. CONNECT THROUGH CONTACTOR C5.
7. MOMENTARY OVERRIDE SWITCH TO CONTROL DELI PREP LIGHTS. CONNECT THROUGH CONTACTOR C6.
8. MOMENTARY OVERRIDE SWITCH TO CONTROL MURRAY CHEESE LIGHTS. CONNECT THROUGH CONTACTOR C16.
9. MOMENTARY OVERRIDE SWITCH TO CONTROL BAKERY PREP LIGHTS. CONNECT THROUGH CONTACTOR C17.
10. PROVIDE SWITCH AT IDF CABINET. REFER TO DETAIL #03 ON SHEET E5.2 FOR SIMILAR INSTALLATION.
11. MOMENTARY OVERRIDE SWITCH TO CONTROL SEAFOOD PREP LIGHTS. PROVIDE CONTACTOR C26 IN CEILING SPACE ABOVE.
12. PROVIDE SWITCH AT ROOF HATCH. REFER TO DETAIL #03 ON SHEET E5.2 FOR SIMILAR INSTALLATION.
13. LIGHT MOUNTED AT JOISTS ABOVE COOLER. REFER TO DETAIL #03 ON SHEET E5.2 FOR SIMILAR INSTALLATION.
14. PROVIDE 2 SWITCHES ADJACENT TO TOP OF LADDER: 1 FOR THE IDF CABINET LIGHT FIXTURE AND 1 FOR THE ROOF HATCH FIXTURE. LABEL EACH SWITCH ACCORDINGLY. REFER TO DETAIL #03 ON SHEET E5.2 FOR SIMILAR INSTALLATION.
15. EXTERIOR WALL PACK SHOWN FOR COORDINATION PURPOSES ONLY. REFER TO SITE ELECTRICAL PLAN ON SHEET E1.6 FOR FIXTURE TYPE AND CIRCUITING.
16. WIRE THE BALLASTS TOGETHER IN ALL "B2" TYPE FIXTURES IN VESTIBULE.
17. PHOTO LUMINESCENT EXIT SIGN BY GENERAL CONTRACTOR – REFER TO SPECIFICATIONS

Order Plans @ WWW.DILine.com



KEY PLAN

SCALE: NOT TO SCALE

NORTH

KROGER
STORE #473
2013 UNIVERSITY AVENUE
OXFORD, MISSISSIPPI 38655
A DEVELOPMENT OF THE KROGER COMPANY

naos
Naos Design Group Of Mississippi, PLLC.
MARC BREETZ, ARCHITECT
645 Lakeland East Drive
Suite 101
Flowood, Mississippi 39232
(p) 303.759.5777
(f) 720.360.4281
ARCHITECT OF RECORD

CDS
COMMERCIAL DESIGN SYSTEMS, INC.
13825 SW GALBREATH DRIVE
SHERWOOD, OREGON 97140
503.885.7000 (F)503.625.8002
INTERIOR DECOR

Pickering
Pickering Firm, Inc.
Architecture - Engineering
Planning - Surveying
6775 Lenox Center Court, Suite 300
Memphis, TN 38115
901.726.0810
ENGINEER OF RECORD:
STRUCTURAL
MECHANICAL
ELECTRICAL
CIVIL ENGINEER

V-SOFT INFRASTRUCTURE
11280 CHESTER ROAD
CINCINNATI, OH 45246
T: 513-326-3819
LOW VOLTAGE

telgian
TELGIAN CORPORATION
10230 SOUTH 50TH PLACE
SUITE 100
PHOENIX, AZ 85044
T: (877) 835-4426
HTTP://WWW.TELGIAN.COM
FIRE PROTECTION

ISSUE LOG

NO.	REV.	DESCRIPTION	DATE
1		PERMIT SET	12/20/18
2		BID SET	03/21/19

JOB	SCALE
2019041	AS SHOWN

SHEET NO.

E1.1.2

PARTIAL LIGHTING PLAN EAST

COPYRIGHT © 2019 NAOS DESIGN GROUP OF MISSISSIPPI, PLLC. THESE DRAWINGS, OR PARTS THEREOF, MAY NOT BE REPRODUCED IN ANY FORM BY ANY METHOD, FOR ANY PURPOSE, WITHOUT PRIOR WRITTEN CONSENT FROM NAOS.