

THIS DOCUMENT IS NOT  
FOR REGULATORY  
APPROVAL, PERMITTING,  
OR CONSTRUCTION.


FOR  
INFORMATION  
ONLY

A WITHIN THE WALLS REMODEL FOR:  
**KROGER STORE # 478 - MARIETTA - GA**  
3162 JOHNSON FERRY RD.,  
MARIETTA, GA 30062




NO. 0418 REVISIONS  
PROJECT NO: 2019 0125  
DATE: 03/18/2019

**EM5.3**  
ENERGY MANAGEMENT  
DETAILS  
CHECKED: DS DRAWN: VLD

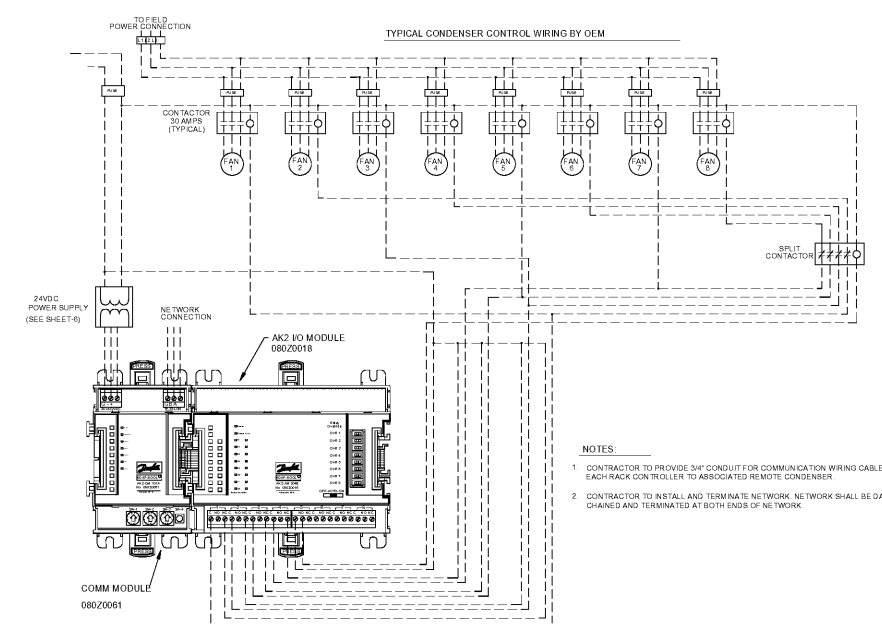


- NOTES:**
- CONTRACTOR TO PROVIDE 3/4" CONDUIT FOR COMMUNICATION WIRING CABLE FROM EACH RACK CONTROLLER TO ASSOCIATED REMOTE CONDENSER.
  - CONTRACTOR TO INSTALL AND TERMINATE NETWORK NETWORK SHALL BE DAISY CHAINED AND TERMINATED AT BOTH ENDS OF NETWORK.


CONTROL SYSTEM - CONDENSER CONTROL TERMINATION  
DATE: 09/27/11  
SCALE: NONE  
DRAWN: EMS-7

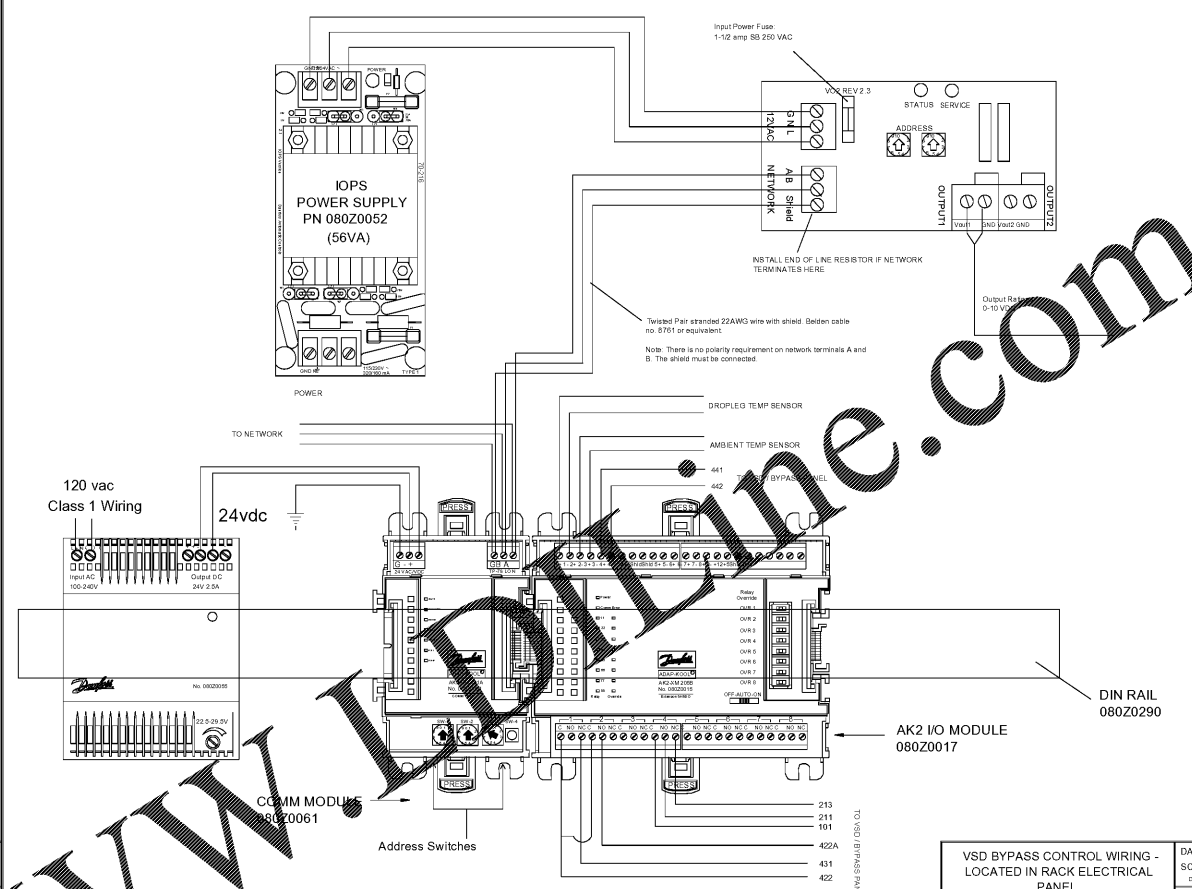

VSD BYPASS CONTROL WIRING - LOCATED IN RACK ELECTRICAL PANEL  
DATE: 09/27/11  
SCALE: NONE  
DRAWN: EMS-8

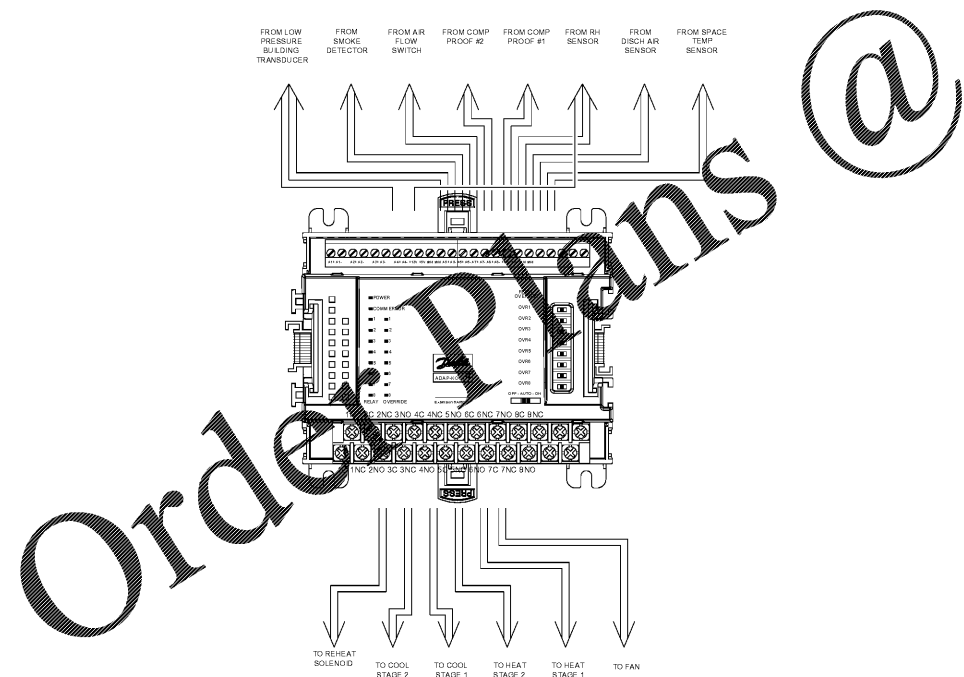

AK-SC 255 CONTROL SYSTEM - TYPICAL COMBO BOARD  
DATE: 09/27/11  
SCALE: NONE  
DRAWN: EMS-9

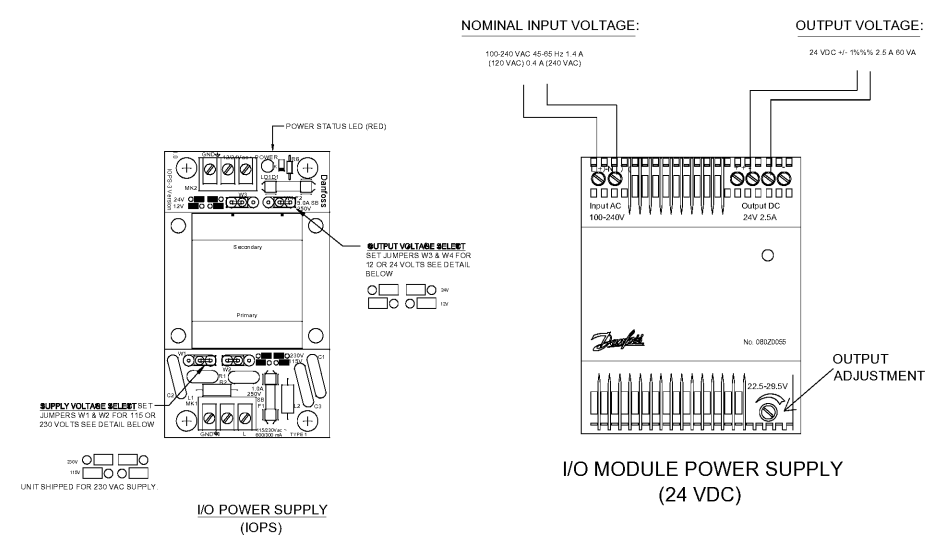

**ATTENTION ENERGY MANAGEMENT CONTRACTOR:**  
THIS DRAWING REPRESENTS A TYPICAL STORE AND SERVES AS A TEMPLATE FOR DEVELOPING JOB SPECIFIC DRAWINGS. YOUR DRAWINGS SHALL REFLECT THE DESIGN REQUIREMENTS FOR YOUR SPECIFIC STORE, AND SHALL USE THE LAYOUT ESTABLISHED BY THIS TEMPLATE. USE OF THE TEMPLATE IS NECESSARY TO SUPPORT THE DESIGN AND PROCUREMENT SYSTEMS WITH THE KROGER COMPANY. REFER TO EM SERIES SHEETS FOR STORE SPECIFIC CONTROL POINT CONNECTIONS.

AK-SC 255 CONTROL SYSTEM - CARD POWER WIRING  
DATE: 09/27/11  
SCALE: NONE  
DRAWN: EMS-10