


2 CURRENT LIMITER PANEL DETAIL
SCALE: NONE

GENERAL NOTES

- A. REFER TO ARCHITECTURAL RCP DRAWINGS FOR EXACT LOCATIONS OF LIGHTING.
- B. COORDINATE AUTOMATIC SHUTOFF HOURS WITH OWNER. SEE SHEET E500 FOR FIXTURE SCHEDULE, LCP SCHEDULE, CHELSEA DIGITAL SWITCH DIAGRAM AND LCP SPECIFICATION.
- C. TENANT IS RESPONSIBLE FOR ALL EMERGENCY EGRESS LIGHTING AT FRONT OF SPACE.

LIGHTING PLAN KEYNOTES

1. FIXTURE DESIGNATE AS EMERGENCY, EXIT AND NIGHT LIGHTING ("NL") SHALL NOT BE SWITCHED.
2. EXHAUST FAN TO BE POWERED FROM RESTROOM LIGHTS, AND CONTROLLED VIA OCCUPANCY SENSOR/SWITCH.
3. PROVIDE JUNCTION BOX WITH DISCONNECT SWITCH AT STOREFRONT FOR CONNECTION TO STORE FRONT SIGN. VERIFY EXACT LOCATION OF JUNCTION BOX IN FIELD WITH SIGN SUPPLIER.
4. STOREFRONT TRACK LIGHTING TO BE MOUNTED AT A HEIGHT NOT VISIBLE FROM THE EXTERIOR. COORDINATE WITH ARCHITECT PRIOR TO INSTALLATION. STOREFRONT TRACK LIGHTING TO BE CONTROLLED VIA TIME CLOCK.
5. CHELSEA DIGITAL PUSHBUTTON. ALL STORE LIGHTING TO BE SWITCHED FROM THIS LOCATION. SEE SHEET E500 FOR SCHEDULE AND ADDITIONAL INFORMATION.
6. INSTALL WATTS STOPPER DT-335 DUAL TECHNOLOGY CEILING MOUNTED OCCUPANCY SENSOR. PROVIDE ADDITIONAL WIRING AND COMPONENTS AS REQUIRED. COORDINATE ALL REQUIREMENTS WITH MANUFACTURER. PROPOSED SUBSTITUTIONS MUST BE SUBMITTED AND APPROVED BY LBI MANAGER AT TIME OF BID.
7. INSTALL DUAL TECHNOLOGY WALL MOUNTED OCCUPANCY SENSOR: INFRARED AND ULTRASONIC SENSOR LUTRON: MS-A202. PROVIDE ADDITIONAL WIRING AS REQUIRED. COORDINATE ALL REQUIREMENTS WITH MANUFACTURER. PROPOSED SUBSTITUTIONS MUST BE SUBMITTED AND APPROVED BY LBI MANAGER AT TIME OF BID.
8. FURNISH AND INSTALL LC&D BLUE BOX LTD LIGHTING CONTROL PANEL. SEE SHEET E500 FOR SCHEDULE.
9. SPEAKERS. GENERAL CONTRACTOR TO PROVIDE ALL THREAD AND UNISTRUT. GENERAL CONTRACTOR TO INSTALL CONDUIT AS REQUIRED PER LOCAL CODE. INDIVIDUAL MUSIC SYSTEMS MUST HAVE VOLUME CONTROL. ARE RESTRICTED TO THE INTERIOR OF THE PREMISES AND SUBJECT TO OVERRIDE OF THE FIRE ALARM SYSTEM. TENANT RELAY CONNECTION MUST BE COORDINATED WITH LANDLORD FIRE ALARM CONTRACTOR.
10. LOCATION OF SECURITY CAMERA. SEE SHEET A3.1 FOR SCHEDULE AND MOUNTING HEIGHTS.

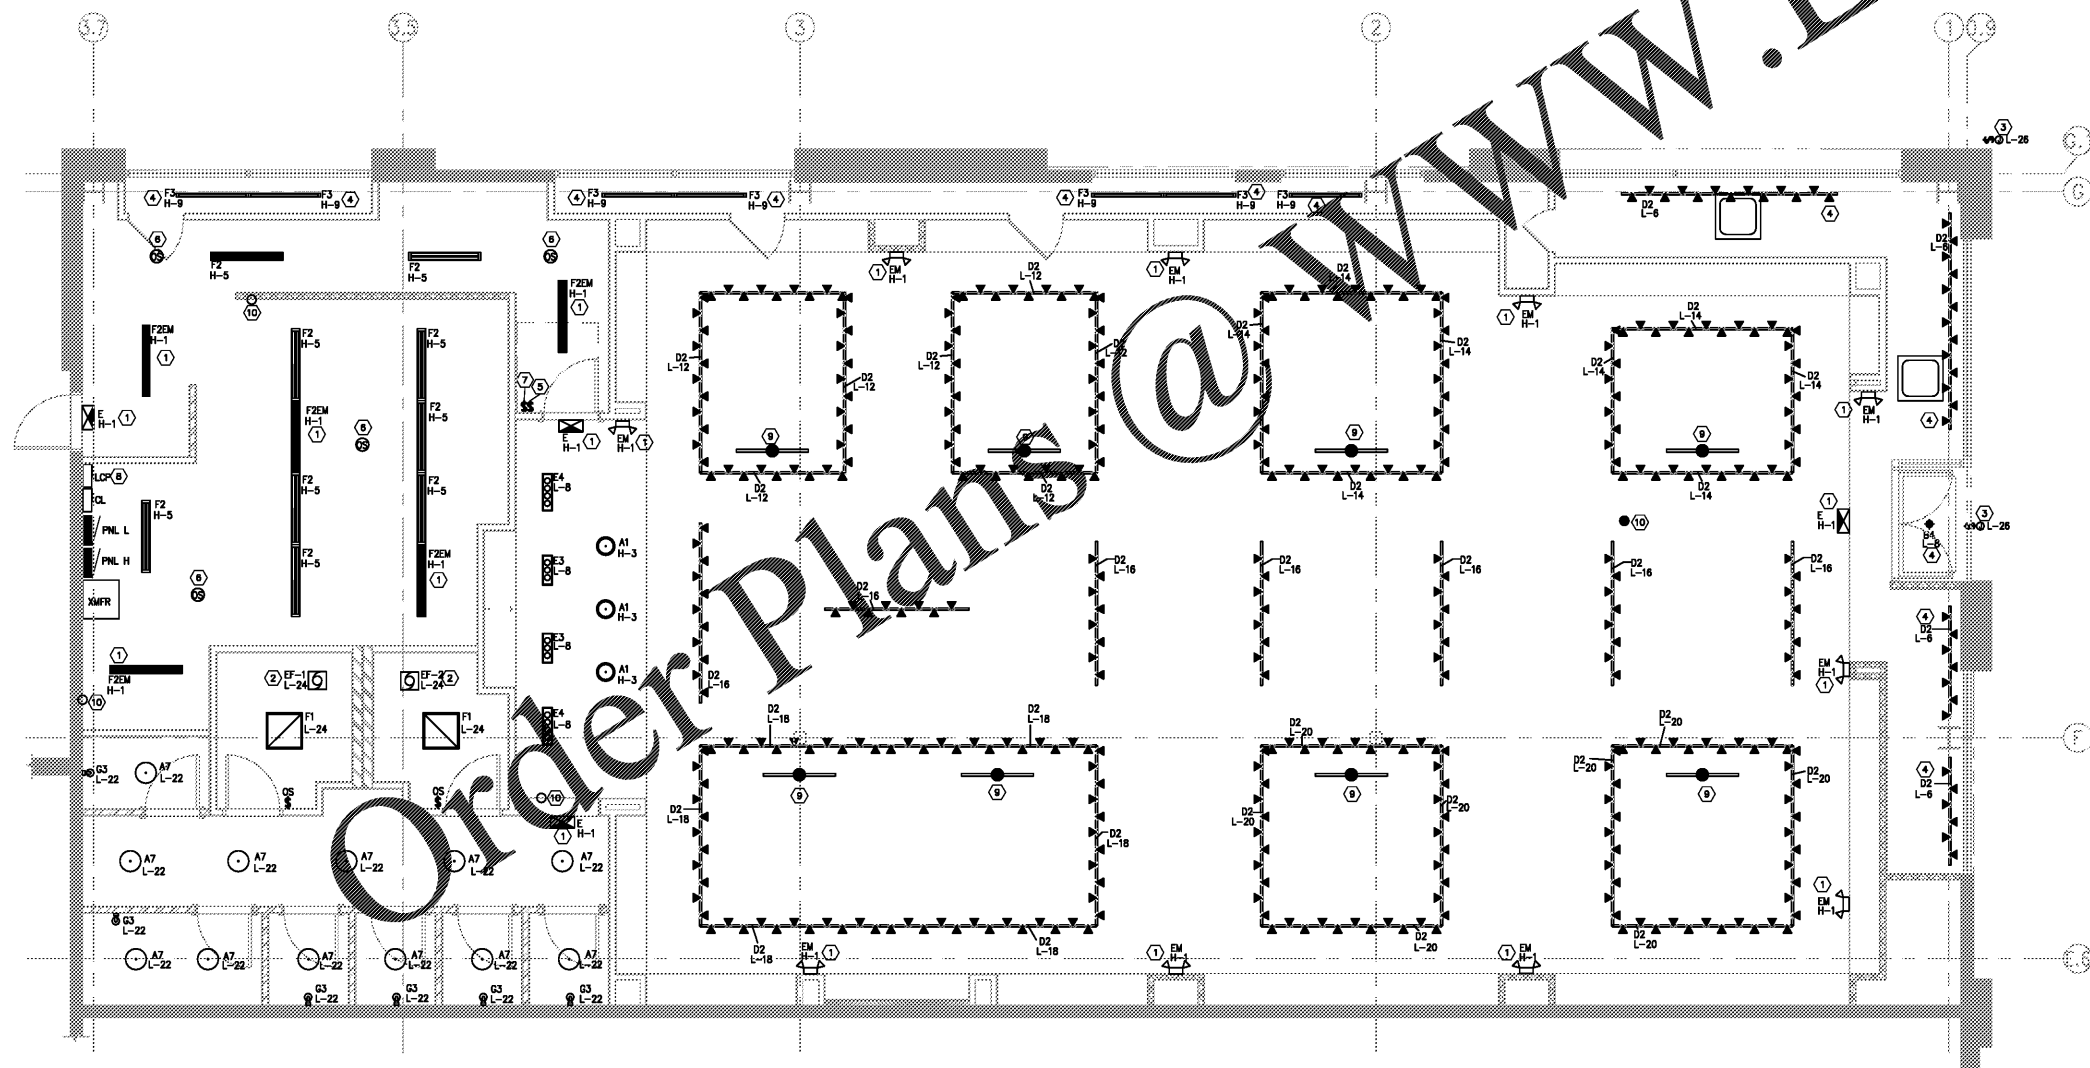

1 LIGHTING PLAN
1/4"=1'-0"

PATRICK G. BLEES
architecture · planning · interior design

PATRICK G. BLEES ARCHITECT, PLLC
800 WASHINGTON AVE. N., SUITE 208
MINNEAPOLIS, MN 55401-1330
PHONE: (612) 547-1300
FAX: (612) 547-1301

CONTACT: KRISTIN MOAN
kmoan@cmarch.com

Gausman & Moore
Mechanical and Electrical Engineers
700 Rosedale Towers
1700 West Highway 36
Saint Paul, Minnesota 55113
(651) 639-9606 FAX 639-9618
Project No. 88596

SEAL:

Edward L. Studer

04/03/2019
DATE ISSUED
65487
REG. NO.

LUCKY BRAND
DANIA POINTE
1763 POINTE BLVD
DANIA BEACH, FL
33004
SPACE #M115
SPECIALTY

SHEET TITLE:
LIGHTING PLAN

REVISIONS:
ORIGINAL ISSUE: 01.17.19
NO. 1 DATE: 04/03/19 BY: BLDG

PROJECT NO: 18028.008
DRAWN BY: ALH

E2
COPYRIGHT PATRICK G. BLEES AIA, PLLC 2018