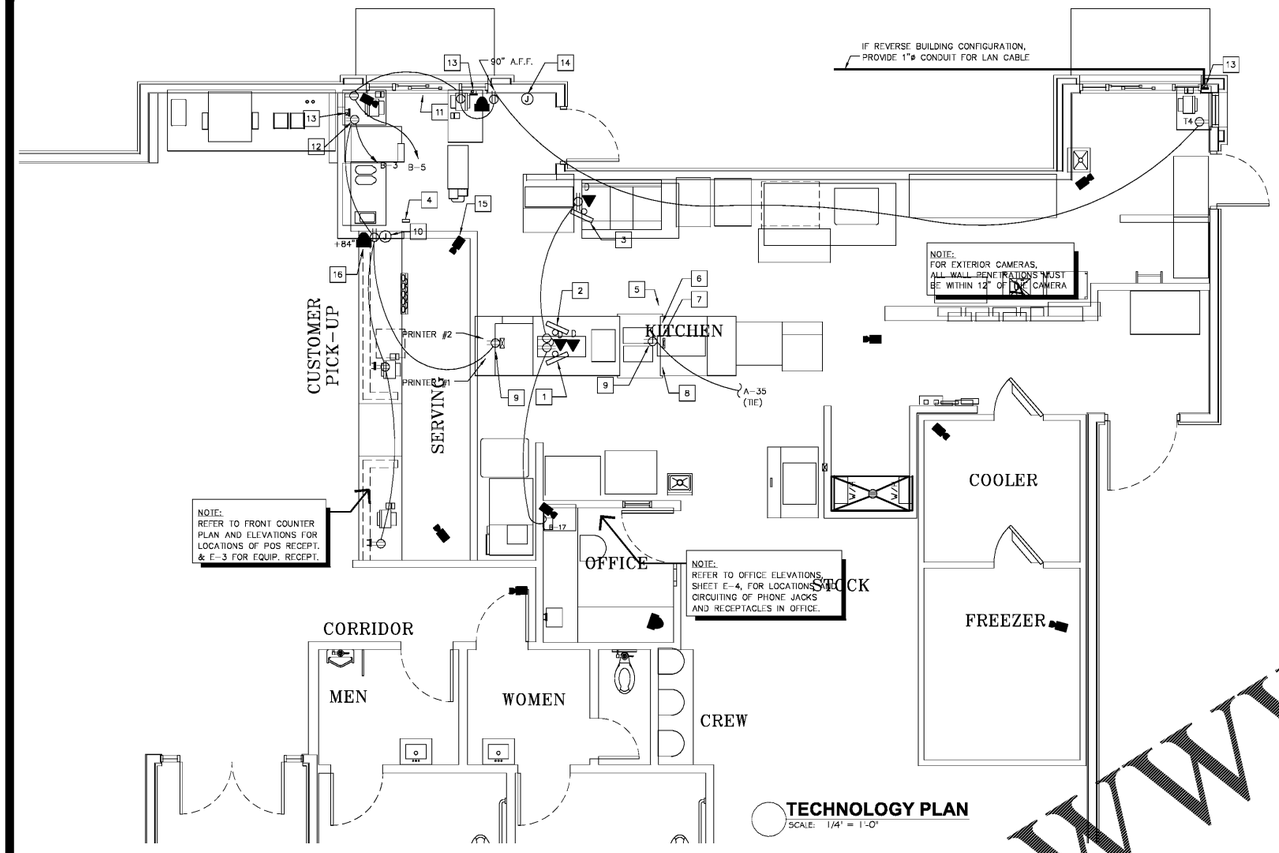

TECHNOLOGY PLAN
SCALE: 1/4" = 1'-0"

GENERAL NOTES:

A. CONTRACTOR TO VERIFY WHICH SYSTEM IS TO BE INSTALLED. REQUIREMENTS CAN VARY DEPENDING ON MANUFACTURER. THE CONTRACTOR IS CAUTIONED TO VERIFY ALL REQUIREMENTS PRIOR TO CONSTRUCTION.

B. CONTRACTOR TO PROVIDE ALL RECEPTACLE OUTLETS, CONDUITS AND J-BOXES AS INDICATED ON PLAN. RECEPTACLES SHALL NOT BE LOCATED ABOVE CEILING AS THIS VIOLATES NEC.

C. CONTRACTOR TO VERIFY AND COORDINATE LOCATION OF VIDEO DISPLAY DEVICES W/ BURGER KING REPRESENTATIVE.

D. MAINTAIN P.O.S. CABLES A MIN. OF 12" AWAY FROM ANY LIGHT SOURCES ABOVE CEILING.

E. ELECTRICAL CONTRACTOR TO IDENTIFY P.O.S. JUNCTION BOXES ABOVE CEILING "GROUND P.O.S. ONLY".

F. PROVIDE PULL STRINGS FOR DATA CONDUITS. PROVIDE BLANK COVER PLATES FOR DATA OUTLET BOXES.

KEYED PLAN NOTES:

1. DISPLAY #1 AND BUMB BAR. PROVIDE 4"ø CONDUIT FOR VIDEO, BUMP BAR AND PRINTERS. PROVIDE CEILING MOUNTED RECEPTACLES. (TYPICAL FOR DISPLAY #1, #2 AND #3)
2. DISPLAY #2 AND BUMP BAR
3. DISPLAY #3 AND BUMP BAR
4. STOCK LEVEL LIGHT CONTROLLER @ 60" A.F.F.
5. TOTAL SERVICE TIME DISPLAY
6. GRADE DISPLAY
7. CLOCK-RECEPT. IN CHASE
8. STOCK LEVEL DISPLAY RECEPT. IN CHASE
9. EQUIPMENT MOUNTED RECEPTACLES BY K.E.S. CIRCUITING RUNS BY E.C.
10. J-BOX W/ 3/4" CONDUIT @ 84" A.F.F.
11. CEILING MOUNTED D/T TIMER [illegible] TIME DISPLAY
12. 90" A.F.F. FOR D/L [illegible] MONITOR.
13. P-RING @ 24" A.F.F. W/ [illegible] CONDUIT TO [illegible] ABOVE CLG.
14. J-BOX W/ 1" CONDUIT TO CEIL. FOR PHU DATA CABLE. (LOCATE NEXT TO PHU RECEPT.)
15. SECURITY CAMERA (TYPICAL)
16. SECURITY MONITOR (TYPICAL)

SYMBOL LEGEND

DETAIL	DESCRIPTION
	DUPLEX 125V-20A-2 POLE-3 WIRE STRAIGHT BLADE RECEPTACLE OUTLET - WALL MTD. (24" A.F.F., - U.O.N.)
	SINGLE 125V-20A-2 POLE-3 WIRE STRAIGHT BLADE RECEPTACLE OUTLET - WALL MTD. (24" A.F.F., - U.O.N.)
	DRYWALL P-RING
B-3 B-5	BUMP-BAR
	TELEPHONE OUTLET FOR P.O.S. MODEM (ALL OUTLETS HOMERUN IN 3/4" CONDUIT TO TELEPHONE BACKBOARD) MOUNT 96" A.F.F.
	P.O.S. PRINTER DEVICE
	P.O.S. REGISTER DEVICE
D	VIDEO DISPLAY DEVICE (CEILING)
	SECURITY CAMERA BY "PRO-EYE" CONTACT: LARRY @ (615) 354-5811 756
	SECURITY MONITOR BY "PRO-EYE" PROVIDE DUPLEX RECEPTACLE @ 84" A.F.F. (VERIFY) CONNECT TO P.O.S. CIRCUIT
D	SCREEN DATA CONNECTION HIGH ON WALL (ABOVE 82") OR ON CEILING

NOTES:
1. (2) DUPLEX RECEPTACLE PER SCREEN
2. (1) P-RING PER SCREEN WITH 1" CONDUIT TO ABOVE CEILING. DATA CABLE TO RUN TO MEDIA PLAYER(S) IN OFFICE
3. VERIFY NUMBER OF SCREENS USED (3 OR 4) PRIOR TO INSTALLATION OF RECEPTACLES AND P-RINGS.
4. DETERMINE SCREEN AND MOUNTING BRACKET MODELS PRIOR TO INSTALLATION OF RECEPTACLES AND P-RINGS.
5. REFER TO SHEET E-2, POWER PLAN FOR CIRCUITING REQUIREMENTS.

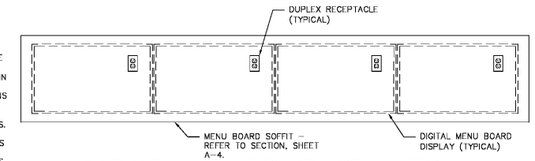

DIGITAL MENU BOARD INSTALLATION
SCALE: 1/2" = 1'-0"

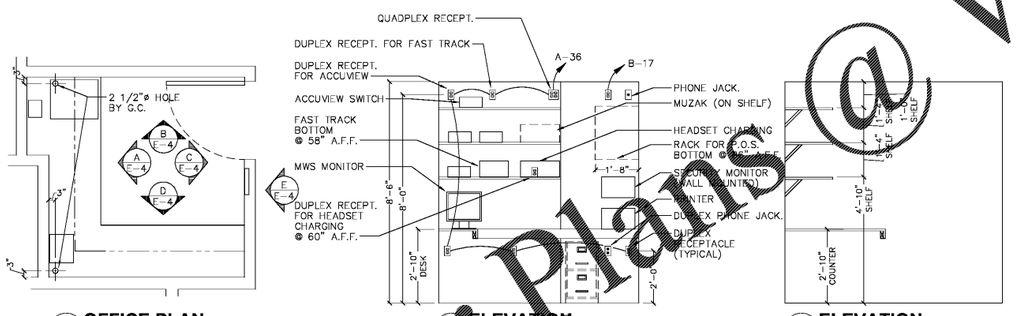

OFFICE PLAN
SCALE: 3/8" = 1'-0"

A ELEVATION
SCALE: 3/8" = 1'-0"

B ELEVATION
SCALE: 3/8" = 1'-0"

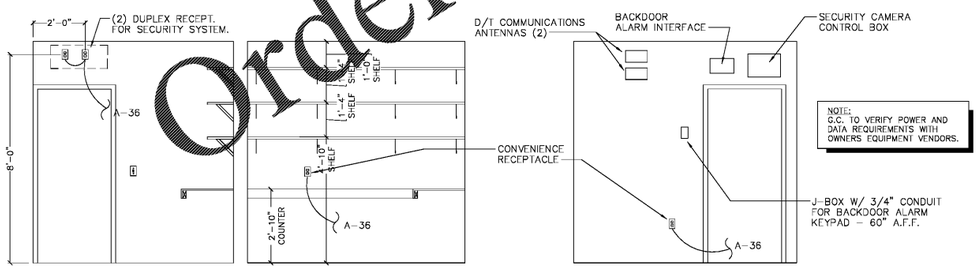

C ELEVATION
SCALE: 3/8" = 1'-0"

D ELEVATION
SCALE: 3/8" = 1'-0"

E ELEVATION
SCALE: 3/8" = 1'-0"

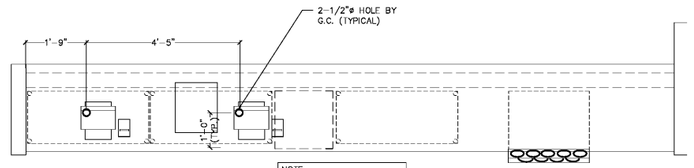

SERVICE COUNTER PLAN
SCALE: 1/2" = 1'-0"

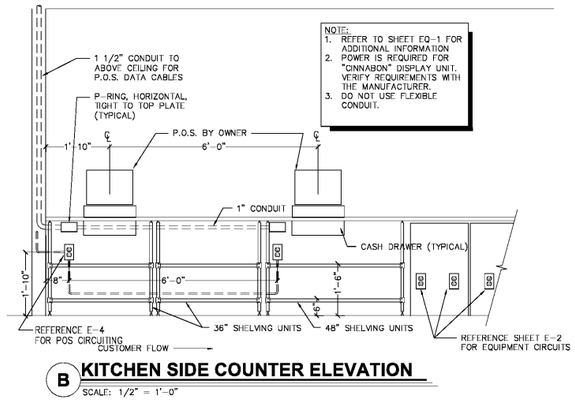

B KITCHEN SIDE COUNTER ELEVATION
SCALE: 1/2" = 1'-0"

Order Plans @ WWW.LDLine.com

NO.	DATE	DRAWN BY: MRW	CHECKED BY: ENH, MRW	DATE: 03.26.19
	03.26.19	REVISION: RELEASED FOR CONSTRUCTION		

PREMIER KINGS, INC.
5529 CARMICHAEL ROAD
MONTGOMERY, ALABAMA 36117
PHONE:
LINDSEY@SKALABAMA.COM

james m. huckestein architect, AIA
architecture . planning . interior design
2126 Morris Avenue
Birmingham, AL 35203
Phone (205) 322-1751
Fax (205) 322-1778
email info@hpluths.com
www.hpluths.com

GEORGE W. ELISABETH HYDE No. 22419 PROFESSIONAL ENGINEER STATE OF ALABAMA
4/4/19

PROJECT #: 18.026.24
ROC-60 TALL 20/20 IMAGE: NOVEMBER 2018 DESIGN RELEASE
BURGER KING RESTAURANT
NEAR CORNER OF HWY 82 & JACKSON ST.
NAHUNTA, GA
TECHNOLOGY PLAN

E-4