


GENERAL NOTES

- SEE SHEET P001 FOR ALL GENERAL NOTES.
- P.C. SHALL TEST ALL EQUIPMENT AND PIPING CONNECTIONS FOR LEAKS AS PART OF FINAL COMPLETION OF CONSTRUCTION PROCESS.

IF ANY DISCREPANCIES ARE FOUND ON THE PLANS, THE PLUMBING CONTRACTOR SHALL BID THE MORE CONSERVATIVE SPECIFICATION AND CALL ENGINEER FOR CLARIFICATION.

WHILE EVERY ATTEMPT HAS BEEN MADE IN THE PREPARATION OF THIS DRAWING TO AVOID MISTAKES, THE DESIGNER AND COMPANY DO NOT GUARANTEE AGAINST ERROR OR OMISSION IN FIELD CONDITIONS. THE CONTRACTOR SHALL CHECK ALL DIMENSIONS, DETAILS AND REPORT ANY DISCREPANCIES.

- CONSTRUCTION NOTES**
- ROUTE 1/2" IN PIPING TO ABOVE CEILING TO SHUT-OFF VALVE AND CAP FOR FUTURE TENANT.
 - DOMESTIC COLD WATER BELOW GRADE. SEE SITE UTILITY PLAN FOR WATER METER AND BACKFLOW PREVENTER LOCATION.
 - P.C. SHALL COORDINATE WITH LOCAL UTILITY FOR GAS METER SIZED FOR 2 PSI NATURAL GAS. OUTLET PIPE SIZE BASED ON 2' AT 150'-0" TOTAL DEVELOPED LENGTH (MIN.) PER TABLE 402.4(2) OF THE NCGC.
 - ROUTE 4" SANITARY PIPING 5'-0" INSIDE OF SPACE AND CAP 1'-0" A.F.F. FOR FUTURE CONNECTION.
 - ROUTE 4" GREASE WASTE PIPING 5'-0" INSIDE OF SPACE AND CAP 1'-0" A.F.F. FOR FUTURE CONNECTION.
 - ROUTE 3" VENT IN WALL AND VENT THROUGH ROOF 2'-0" (MIN.) AWAY FROM PARAPET. ALL PLUMBING VENTS SHALL BE INSTALLED 10" (MIN.) FROM ANY BUILDING FRESH AIR INTAKE AS SHOWN OR 2' ABOVE. SEE DETAIL 4/P501.
 - P.C. SHALL STUB 1/2" COLD WATER COPPER PIPE 1'-0" BELOW ROOF DECK. MUST BE EXPOSED AND VISIBLE FOR TENANT'S CONNECTION.
 - SHALL INSTALL SCH. 40 1" PVC CONDENSATE DRAIN LINE FROM EACH RTU AND ROUTE DOWN TO ROOF DECK. SEE DETAIL 2/P501.
 - P.C. SHALL PROVIDE/INSTALL UNION, GAS COCK AND DRIP LEG EACH GAS CONNECTION.
 - P.C. SHALL RUN COLD WATER TO HOSE BIBB LOCATED INSIDE TRASH ENCLOSURE. SEE CIVIL DRAWINGS FOR CONTINUATION.
 - OFFSET WATER HEATER FLUE PIPING PER MANUFACTURERS RECOMMENDATIONS TO BE 10'-0" AWAY FROM ANY FRESH AIR INTAKE. TENANT TO CONNECT VENT TO WATER HEATER.
 - GAS PIPING ROOF PENETRATION TO TENANT SUPPLIED WATER HEATER. SEE SHEET P501 FOR RISER.

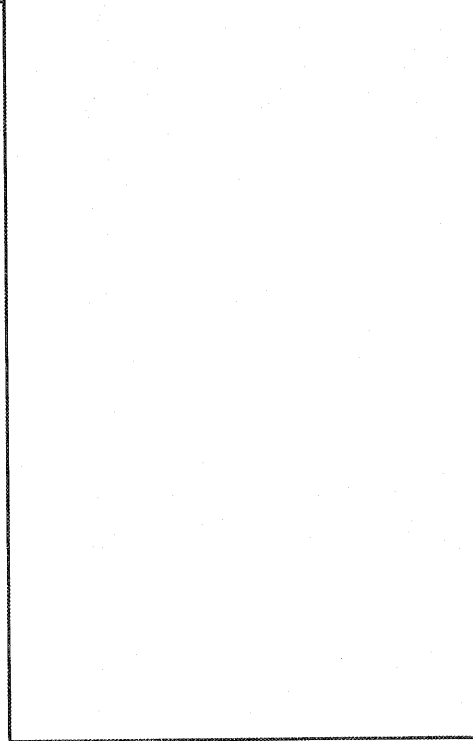

LHMT Project No. 18201

THIS DRAWING IS THE PROPERTY OF THE ARCHITECT AND MAY NOT BE REPRODUCED OR USED WITHOUT HIS WRITTEN PERMISSION.

LHMT ASSOCIATES
ARCHITECTS
3005 CARRINGTON AVE. #100
SUITE 100, NORTHVILLE, NC
28645
PHONE: 919.242.0087 FAX: 919.242.9399

LHMT ENGINEER LICENSE NUMBER - C-1969

PROJECT: **STARBUCKS SHELL BUILDING**
350 BLOWING ROCK BOULEVARD
LENOR, NC 28645
DRAWING: **PLUMBING PLANS**

Revisions	
REVISION	DATE

PROJECT DATE: 03/26/2019
 Drawn By: SCP
 Checked By: SDS
 Sheet No. **P111**

Order Plans @ www.LDILine.com