


VICINITY MAP
NTS

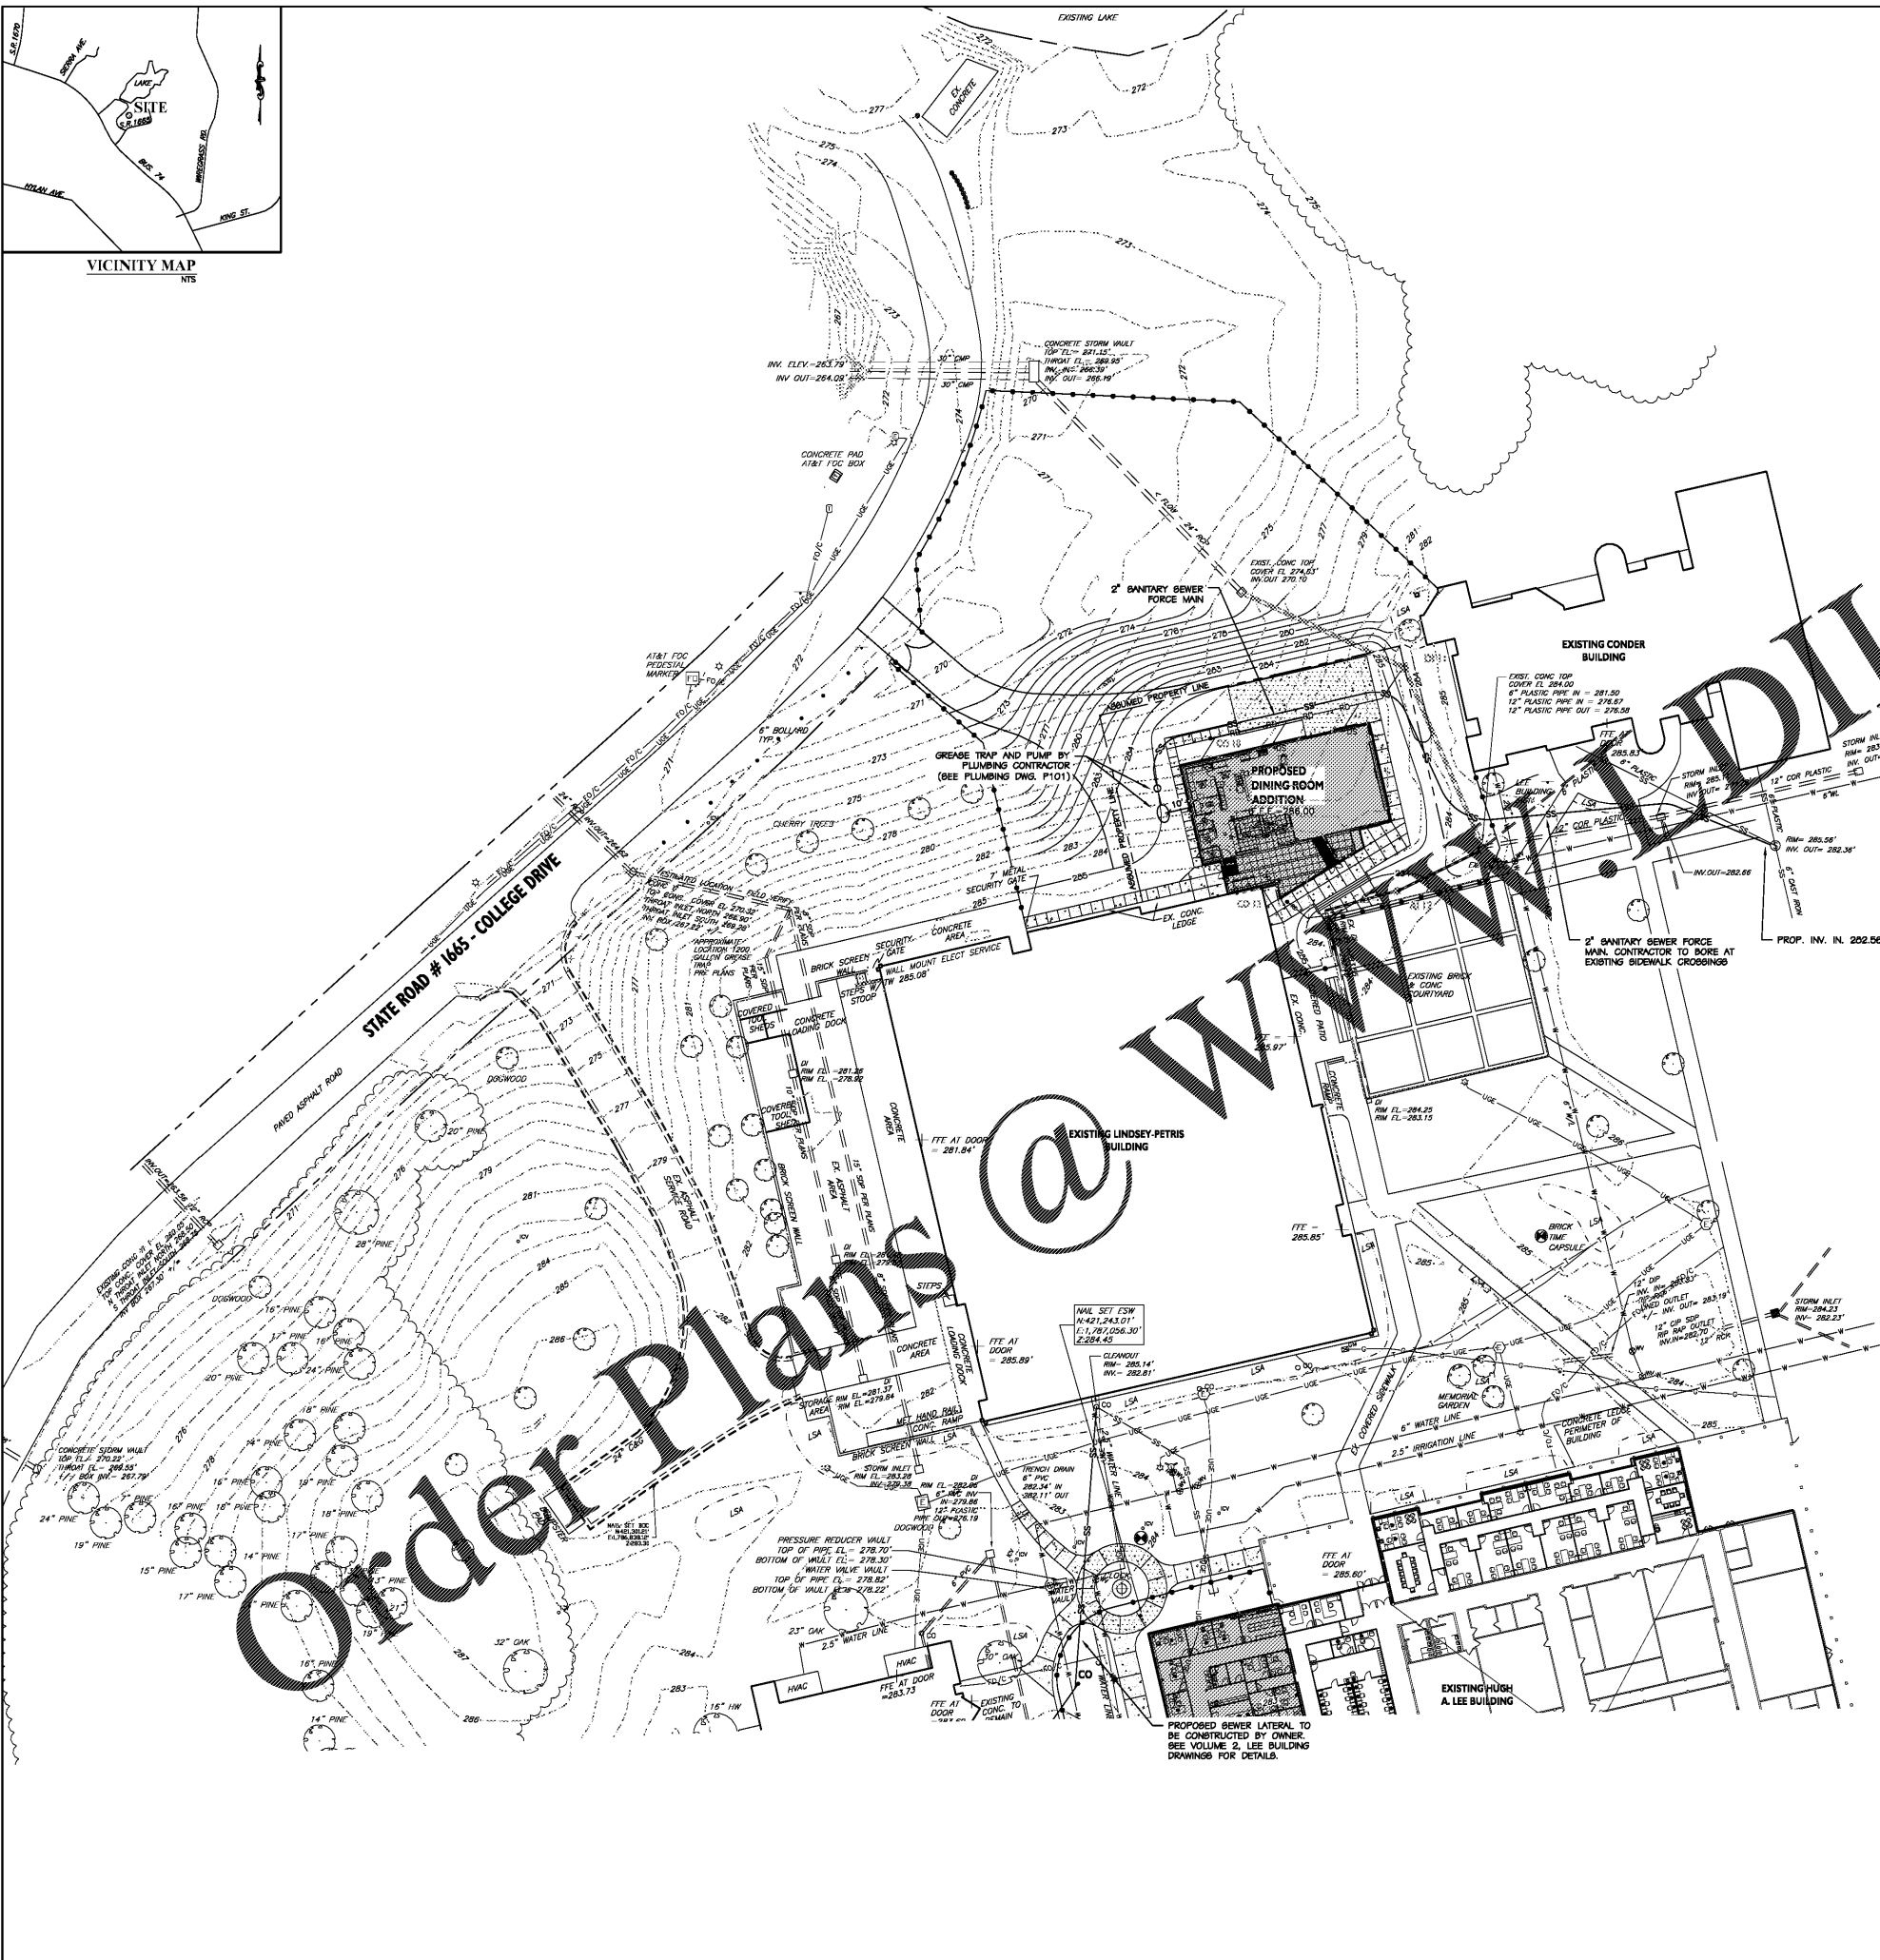

Order Plans @

WWW.DIline.com

UTILITY NOTES

1. ALL UTILITY CONSTRUCTION SHALL BE IN ACCORDANCE WITH ALL APPLICABLE LOCAL AND STATE CODE REQUIREMENTS.
2. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE LOCATION OF ALL EXISTING UTILITIES (STORM DRAINAGE, ELECTRIC, GAS, TELEPHONE, ETC.) PRIOR TO CONSTRUCTION. INFORMATION SHOWN ON THIS PLAN IS FOR REFERENCE ONLY AND SHALL BE VERIFIED BY THE CONTRACTOR.
3. THE CONTRACTOR SHALL NOTIFY THE ARCHITECT/ENGINEER IMMEDIATELY IF ANY DISCREPANCIES BETWEEN THE CONSTRUCTION PLANS AND ACTUAL FIELD CONDITIONS ARE FOUND.
4. MINIMUM COVER FOR ALL SANITARY SEWER MAINS SHALL BE 3'-0" DUCTILE IRON PIPE SHALL BE SUBSTITUTED WHEN MINIMUM COVER CANNOT BE MAINTAINED.
5. THE STANDARD DEPTH OF COVER FOR WATER MAINS SHALL BE 3'-0" MIN. EXCEPT AT VALVE OR HYDRANT LOCATIONS, OR OTHER SPECIAL CONDITIONS.
6. THE CONNECTION TO EXISTING WATER MAINS SHALL BE PERFORMED ONLY AFTER ALL PRESSURE TESTING AND COLORIZATION ARE SUCCESSFULLY COMPLETED AND THE LOCAL REVENUE AUTHORITY HAS APPROVED THE CONNECTION. THE CONTRACTOR SHALL AVOID DISRUPTION OF EXISTING SERVICE.
7. REFER TO PLUMBING DRAWING SERIES FOR THE LOCATION OF WATER AND SANITARY SEWER SERVICE CONNECTIONS AT THE BUILDING.
8. UNLESS OTHERWISE NOTED, THE PHYSICAL CONNECTION BETWEEN THE SITE UTILITY LINES AND THE PIPE INSTALLED BY THE PLUMBING CONTRACTOR SHALL BE MADE BY THE SITE UTILITY CONTRACTOR.
9. PIPE LENGTHS SHOWN ON PLAN ARE THE ENGINEER'S ESTIMATE USED TO COMPUTE PIPE SIZES AND INVERTS AND SHALL NOT BE CONSIDERED BY THE CONTRACTOR TO REPRESENT THE ACTUAL QUANTITY OF PIPE REQUIRED.
10. IF WATER LINE CROSSES OVER SANITARY SEWER WITH LESS THAN 10 INCHES VERTICAL CLEARANCE BOTH PIPES SHALL BE DUCTILE IRON 10" EACH SIDE. IF WATER CROSSES UNDER THE SEWER REGARDLESS OF CLEARANCE BOTH PIPES SHALL BE DUCTILE IRON 10" EACH SIDE. IF WATER LINE RUNS PARALLEL TO SEWER LINE WITH LESS THAN 10" VERTICAL CLEARANCE AND LESS THAN 10' SIDE CLEARANCE BOTH PIPES SHALL BE DUCTILE IRON.
11. IF REQUIRED BY NUMBER 10 ABOVE, REPLACE EXISTING SEWER WITH DUCTILE IRON PIPE, CLASS 350 WORKING PRESSURE WITH GASKETED JOINTS, 10" EACH SIDE OF WATER MAIN.
12. ALL UNDERGROUND LINES OUTSIDE BUILDING FOOTPRINT, EXCEPT LAWN IRRIGATION LINES, SHALL BE REQUIRED TO HAVE A WARNING TAPE INSTALLED IN THE BACKFILL BETWEEN 6 INCHES TO 24 INCHES BELOW FINISHED GRADE DIRECTLY OVER PIPING.
13. METALLIC LINES SHALL BE IDENTIFIED WITH DURABLE PRINTED PLASTIC WARNING TAPES, MINIMUM 3 INCHES WIDE WITH LETTERING TO IDENTIFY BURIED LINE BELOW.
14. NON-METALLIC PIPES, OTHER THAN SAN LINES, SHALL BE IDENTIFIED BY DETECTABLE WARNING TAPE, MINIMUM 2 INCHES WIDE, WITH LETTERING TO IDENTIFY BURIED LINE BELOW.
15. FOR PLASTIC SEWER PIPING, AN INSULATED COPPER TRACER WIRE OR OTHER APPROVED CONDUCTOR SHALL BE INSTALLED ADJACENT TO AND OVER THE FULL LENGTH OF THE PIPING. ACCESS SHALL BE PROVIDED TO THE TRACER WIRE SHALL TERMINATE AT THE CLEANOUT BETWEEN BUILDING DRAIN AND BUILDING SEWER. THE TRACER WIRE SHALL NOT BE LESS THAN 14 AWG AND THE INSULATION TYPE SHALL BE LISTED FOR DIRECT BURIAL.
16. AN INSULATED COPPER TRACER WIRE OR OTHER APPROVED CONDUCTOR SHALL BE ADJACENT TO UNDERGROUND NONMETALLIC PIPING. ACCESS SHALL BE PROVIDED TO THE TRACER WIRE OR THE TRACER WIRE SHALL TERMINATE ABOVEGROUND AT THE END OF THE NONMETALLIC PIPING. THE TRACER WIRE SIZE SHALL NOT BE LESS THAN 14 AWG AND THE INSULATION TYPE SUITABLE FOR DIRECT BURIAL.

LEGEND

—	EXISTING SIGN	— — — —	EXISTING CURB AND GUTTER
⊙	EXISTING IRON PIN	— — — —	PROPOSED CURB AND GUTTER
⊙	EXISTING LIGHT POLE	— — — —	PROPERTY LINE
⊙	PROPOSED LIGHT POLE	— — — —	EXISTING FENCE
⊙	EXISTING UTILITY POLE	— — — —	EXISTING UNDERGROUND ELECTRIC LINE
R/W	RIGHT-OF-WAY	— — — —	EXISTING OVERHEAD ELECTRIC LINE
⊙	EXISTING FIRE HYDRANT	— — — —	EXISTING UNDERGROUND TELEPHONE LINE
⊙	PROPOSED FIRE HYDRANT	— — — —	EXISTING SANITARY SEWER LINE
⊙	PROPOSED FIRE DEPT. CONNECTION	— — — —	PROPOSED SANITARY SEWER LINE
⊙	EXISTING WATER VALVE	— — — —	EXISTING WATER LINE
⊙	PROPOSED WATER VALVE	— — — —	PROPOSED DOMESTIC WATER LINE
⊙	PROPOSED CHECK VALVE	— — — —	EXISTING CONTOUR LINE
⊙	EXISTING POST INDICATOR VALVE	— — — —	PROPOSED CONTOUR LINE
⊙	EXISTING WATER METER	— — — —	EXISTING STORM DRAINAGE PIPE
⊙	PROPOSED WATER METER	— — — —	PROPOSED STORM DRAINAGE PIPE
⊙	PROPOSED BACKFLOW PREVENTER	— — — —	EXISTING GAS LINE
⊙	EXISTING SEWER MANHOLE	— — — —	PROPOSED GAS LINE
⊙	PROPOSED SEWER MANHOLE	— — — —	EXISTING STORM MANHOLE
⊙	EXISTING CLEANOUT	— — — —	PROPOSED STORM MANHOLE
⊙	PROPOSED CLEANOUT	— — — —	EXISTING EASEMENT
⊙	EXISTING DRAINAGE STRUCTURE	— — — —	
⊙	PROPOSED DRAINAGE STRUCTURE	— — — —	
⊙	EXISTING GAS VALVE	— — — —	
⊙	EXISTING GAS METER	— — — —	

adwarchitects
environments for life
architecture planning interiors
2815 COLISEUM CENTRE DRIVE
SUITE 500
CHARLOTTE, NORTH CAROLINA 28217
974.378.1919
F704.378.1920
www.adwarchitects.com

benesch
Alfred Benesch & Company
2559 Perimeter Palmetto Parkway, Suite 350
Charlotte, NC 28209
www.benesch.com
704.521.9889
Corp. NC License: F.1320
Project #17-002228



SCO #16-15889-02A
**RICHMOND
COMMUNITY
COLLEGE**

LINDSEY-PETRIS
CAFETERIA / DINING
ADDITION VOL.1

BID DOCUMENTS

UTILITY PLAN

DATE 04.05.2019
PROJECT NO 16063


REVISIONS

NO	DATE	DESCRIPTION

THIS DRAWING IS THE PROPERTY OF ADW ARCHITECTS, P.A. AND SHALL NOT BE REPRODUCED OR COPIED IN WHOLE OR IN PART. IT SHALL NOT BE USED ON ANY OTHER PROJECT OR GIVEN TO ANY OTHER COMPANY OR AGENCY WITHOUT THE CONSENT OF ADW ARCHITECTS, P.A.



SEAL 4/5/19



SHEET NUMBER **C400**