


ACCESSIBILITY REQUIREMENTS

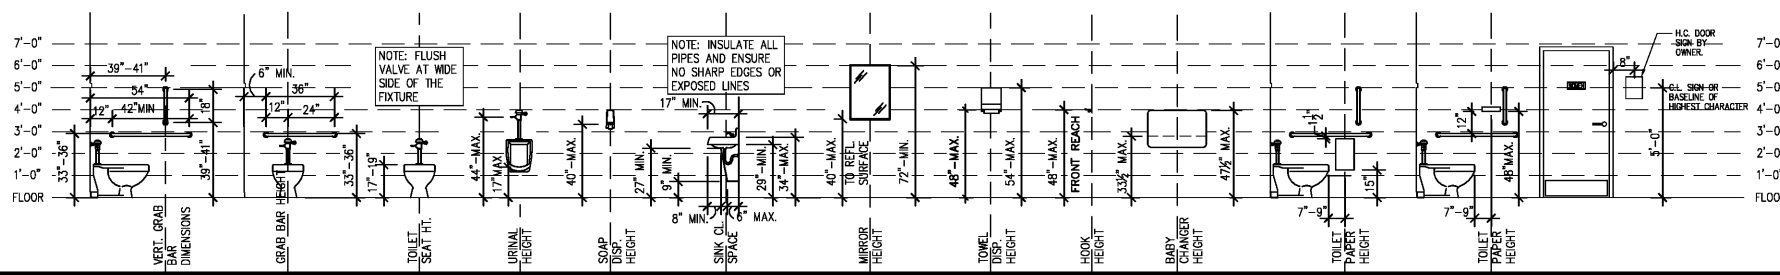

PLUMBING FIXTURE REQUIREMENTS

NO. OF OCCUPANTS SERVED: 67 PERSONS (55 MALE / 36 FEMALE) - 2018 IPC, CH.4, TABLE 403.1 TABULATION

FIXTURES:	MALE		FEMALE	
	REQUIRED	PROVIDED	REQUIRED	PROVIDED
WATER CLOSETS:				
URINALS:	0	0	N/A	N/A
LAVATORIES:				
DRINKING FOUNTAINS:	N/A	N/A	N/A	N/A

GENERAL BUILDING CODE DATA


2015 INTERNATIONAL BUILDING CODE
2015 INTERNATIONAL EXISTING BUILDING CODE
2015 INTERNATIONAL MECHANICAL CODE
2015 INTERNATIONAL PLUMBING CODE
2015 INTERNATIONAL FUEL GAS CODE
2014 INTERNATIONAL ELECTRICAL CODE
2010 AMERICANS WITH DISABILITY ACT ACCESSIBILITY GUIDELINES

USE GROUP OR OCCUPANCY: A-2 ASSEMBLY
CONSTRUCTION TYPE CLASSIFICATION: V-B CONSTRUCTIBLE - UNPROTECTED - NON SPINKLERED
BUILDING SQUARE FOOTAGE & OCCUPANT LOAD (BASED ON AREA - SECTION 1004.1.1)

ENTRY VESTIBULE: 70 S.F.
HOST AREA: 52 S.F. / 100 = 1 OCCUPANT
WAITING / STANDING: 42 S.F. / 15 = 3 OCCUPANTS
DINING - SEATING: 109 L.F. @ 20 PERSONS = 55 OCCUPANTS
DINING - LOOSE SEATING: 12 SEATS = 12 OCCUPANTS
DINING SEATING IN RESTROOMS: 12 SEATS = 12 OCCUPANTS
TOTAL: 67 OCCUPANTS (SIMULTANEOUS USE)


RESTROOMS AND RESTROOM VEST.: 100 S.F. / 200 = 5 OCCUPANTS (SIMULTANEOUS USE)
KITCHEN: 100 S.F. / 100 = 1 OCCUPANT
OFFICE: 100 S.F. / 100 = 1 OCCUPANT (NON HABITABLE)
REMAINING AREAS (WALLS): 18.5 S.F. / 100 = 0 OCCUPANTS

TOTAL GROSS BUILDING AREA (S.I.): 2249 S.F.
TOTAL OCCUPANTS BASED ON CONSTRUCTION OF B.F. & SEATING: 63 OCCUPANTS



JOB NO. LI905

1 HANDICAP HEIGHT REQUIREMENTS


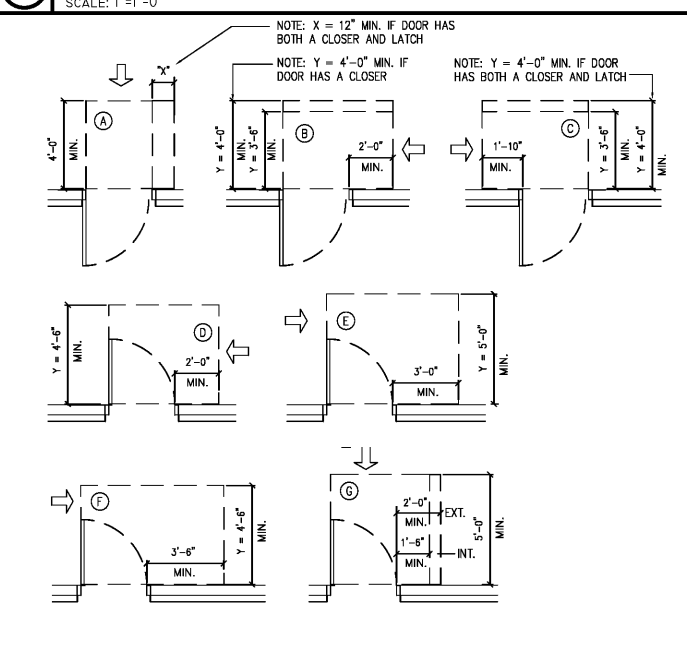


CLEAR FLOOR AREA

A 5' DIA. TURNING RADIUS	F DOOR - 36" x 48"
B LAVATORY - 30" x 48"	G DOOR - 60" x 54"
C TOILET - 60" x 59"	H DOOR - 54" x 48"
D URINAL - 30" x 48"	

ACCESSIBLE SEATING NOTE

BOOTH PACKAGE TO BE FURNISHED & INSTALLED BY THE OWNER. SEATING SUPPLIER SHALL PROVIDE A MINIMUM OF 5% HANDICAP ACCESSIBLE SEATS. PROVIDE KNEE CLEARANCE @ 27" HIGH, 30" WIDE AND 19" DEEP. TABLE HEIGHTS SHALL BE 28" MINIMUM & 34" MAXIMUM.

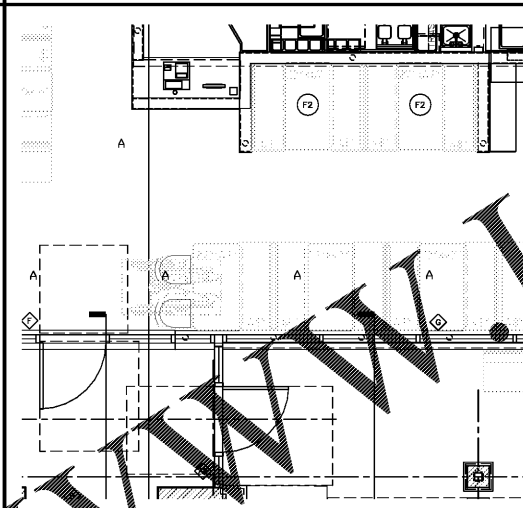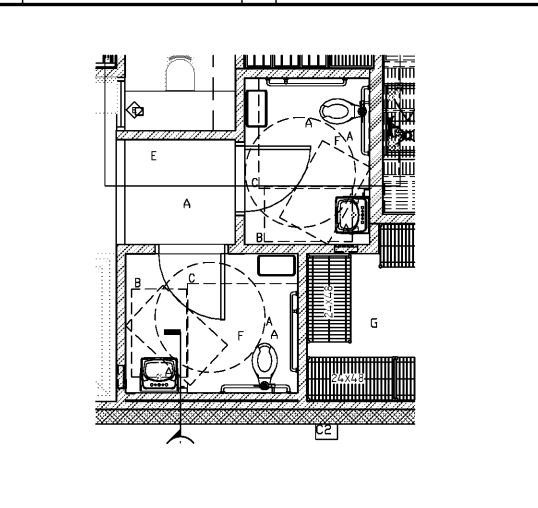

2 DOOR CLEARANCE REQUIREMENTS


SCALE: 1/4"=1'-0"

3 ENLARGED RESTROOM PLAN

SCALE: 1/4"=1'-0"

4 HANDICAP SEATING PLAN

SCALE: 1/4"=1'-0"

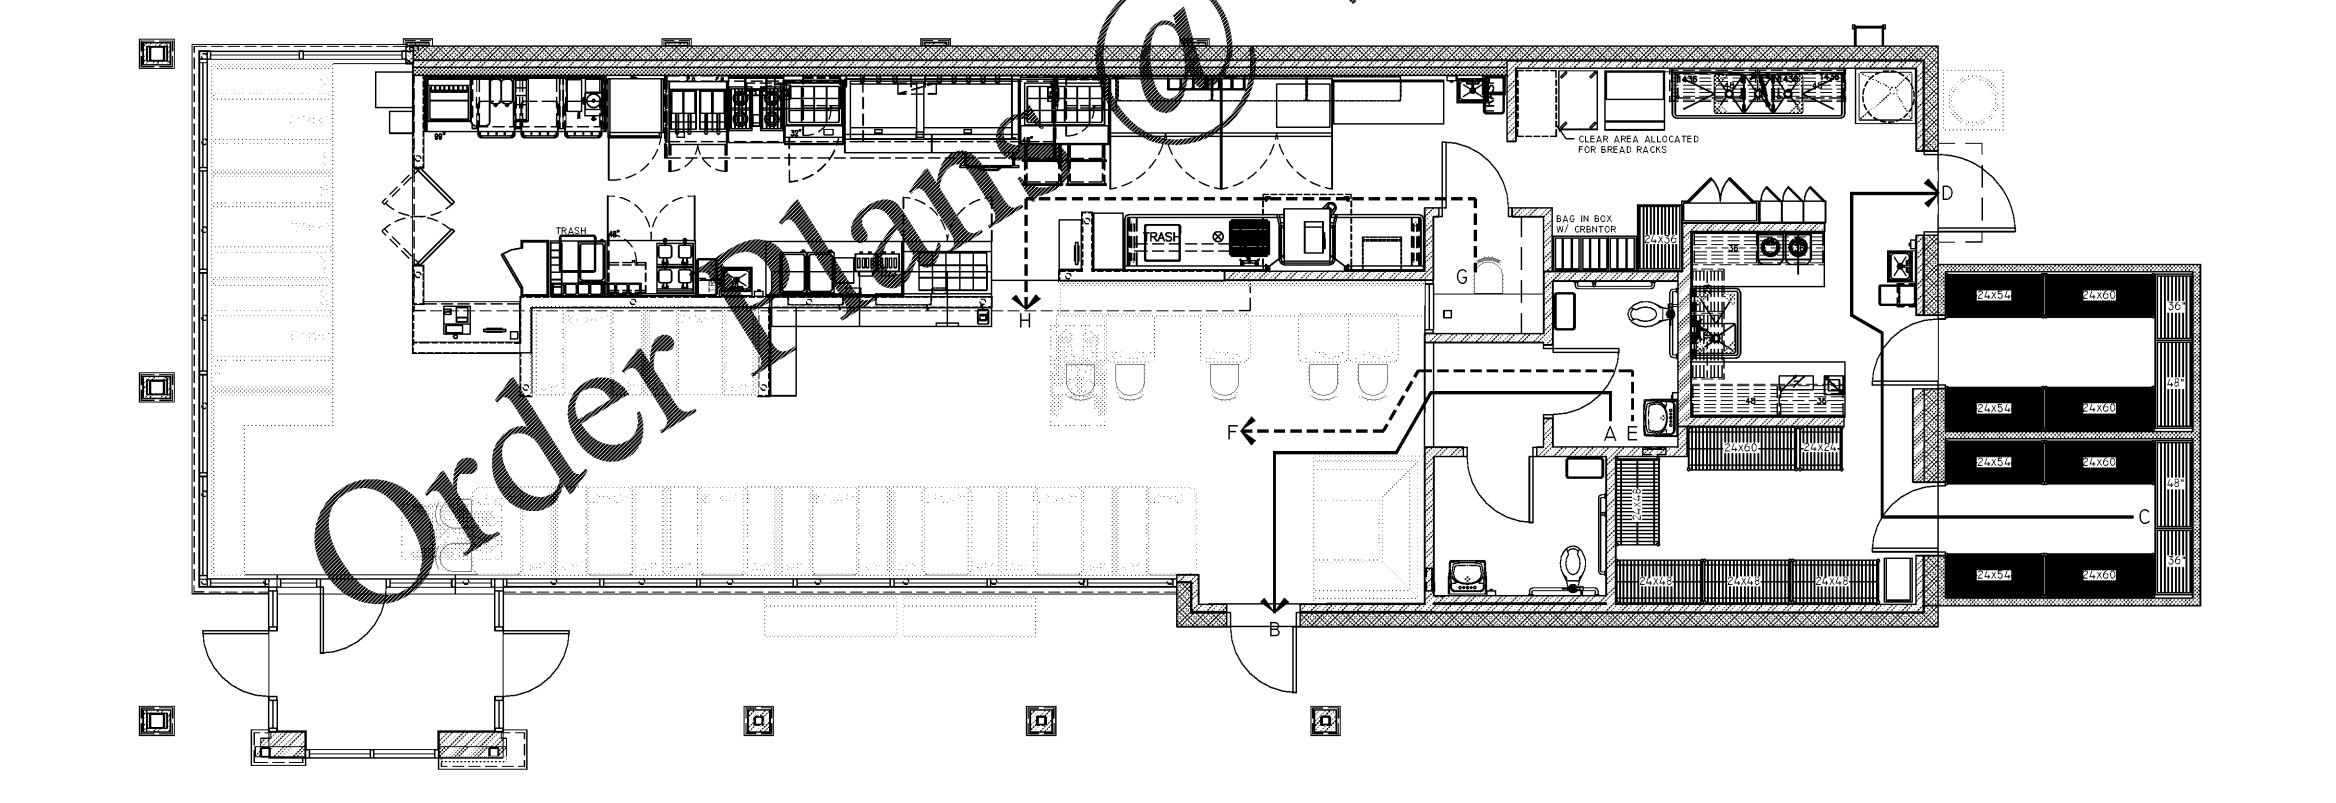

4 SQUARE FOOTAGE EGRESS SUMMARY

SCALE: 1/4"=1'-0"

CODE NOTES

ALL WORK OF THIS PROJECT SHALL BE CONSTRUCTED IN FULL COMPLIANCE WITH ALL FEDERAL, STATE AND LOCAL LAWS, CODES AND ORDINANCES. ALL CONTRACTORS PERFORMING WORK ON THE PROJECT SHALL BE RESPONSIBLE FOR KNOWING THE QUALITY AND PUBLIC SAFETY REGULATIONS GOVERNING THESE PROJECTS AND ALL OTHER APPLICABLE REGULATIONS OF LOCAL AND STATE AGENCIES HAVING JURISDICTION OVER THE WORK OF THIS PROJECT.

2. INTERIOR FINISH & TRIM REQUIREMENTS

A. ALL MATERIAL USED FOR INTERIOR WALL FINISH AND TRIM SHALL BE CLASSIFIED IN ACCORDANCE WITH ASTM D 284.

B. ALL INTERIOR WALL FINISHES IN ROOMS OR ENCLOSED SPACES WITHIN THE BUILDING SHALL BE CLASS C OR C BETTER INCLUDING WOOD TRIM UNLESS NOTED OTHERWISE.

C. INTERIOR FLOOR FINISHES SHALL BE CLASSIFIED IN ACCORDANCE WITH NFPA 253.

CLASS I: 0.45 WATTS/CM
CLASS II: 0.22 WATTS/CM

D. ALL INTERIOR FLOOR FINISHES IN ROOMS OR ENCLOSED SPACES WITHIN THE BUILDING SHALL COMPLY WITH "DOC FF1 PILL TEST" (CPSC 16 CFR 1630)

OWNER WILL SUBMIT TEST RESULTS TO THE LOCAL FIRE PREVENTION BUREAU FOR ANY OR ALL INTERIOR FINISHES AS REQUESTED BY AUTHORITIES HAVING JURISDICTION OVER THE PROJECT.

PROVIDE FIRE RETARDANT TREATMENTS TO INTERIOR FINISHES WHERE REQUIRED TO MEET THE ABOVE LISTED CRITERIA.

3. MAIN EXIT AISLES SERVING 50 OR MORE OCCUPANTS SHALL BE A MINIMUM OF 44" IN WIDTH & SECONDARY AISLES SHALL BE A MINIMUM OF 36" IN WIDTH.

EXIT DOORS TO BE OPENABLE FROM THE INSIDE WITH A SINGLE EFFORT WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE.

5. PROVIDE ILLUMINATED EXIT SIGNS AT ALL EXIT DOORS AS REQUIRED BY LOCAL FIRE DEPARTMENT. EVERY EXIT SIGN AND DIRECTIONAL EXIT SIGN SHALL HAVE PLAINLY LEGIBLE LETTERS NOT LESS THAN 6 INCHES (152 MM) HIGH WITH 1/8" SPACING BETWEEN LETTERS. LETTERS NOT LESS THAN 0.75 INCH (19.1 MM) WIDE. THE WORD "EXIT" SHALL HAVE LETTERS HAVING A WIDTH NOT LESS THAN 2 INCHES (51 MM) WIDE EXCEPT THE LETTER "I", AND THE MINIMUM SPACING BETWEEN LETTERS SHALL NOT BE LESS THAN 0.375 INCH (9.5 MM). SIGNS LARGER THAN THE MINIMUM ESTABLISHED IN THIS SECTION SHALL HAVE LETTER WIDTHS, STROKES AND SPACING IN PROPORTION TO THEIR HEIGHT.

THE WORD "EXIT" SHALL BE IN HIGH CONTRAST WITH THE BACKGROUND AND SHALL BE CLEARLY DISCRETE WHEN THE EXIT SIGN ILLUMINATION MEANS IS OR IS NOT ENERGIZED. IF AN ARROW IS PROVIDED AS PART OF THE EXIT SIGN THE CONSTRUCTION SHALL BE SUCH THAT THE ARROW DIRECTION CANNOT BE EASILY CHANGED.

EXIT SIGNS SHALL BE ILLUMINATED AT ALL TIMES TO ENSURE CONTINUED ILLUMINATION FOR A DURATION OF NOT LESS THAN 90 MINUTES IN CASE OF PRIMARY POWER LOSS. THE EXIT SIGNS SHALL BE CONNECTED TO AN EMERGENCY ELECTRICAL SYSTEM PROVIDED FROM BATTERIES. THE INSTALLATION OF THE EMERGENCY POWER SYSTEM SHALL BE IN ACCORDANCE WITH THE ELECTRICAL CODE.

6. PROVIDE A TACTILE EXIT SIGN ADJACENT TO EGRESS DOORS IN COMPLIANCE WITH A.N.S.I. 117.1. SIGNS SHALL READ "EXIT" AND SHALL BE OF SUFFICIENT SIZE TO ACCOMMODATE 1" TALL LETTERS RAISED 1/32" ABOVE THE SIGN BACKGROUND. SIGNS SHALL BE MOUNTED 48" A.F.F. TO CENTERLINE AT LOCATIONS AS APPROVED BY THE LOCAL BUILDING OFFICIAL.

PROVIDE MAXIMUM OCCUPANCY SIGN AND POST PER LOCAL CODE AT MAIN ENTRANCE VESTIBULE AREA. CONTRACTOR SHALL CLARIFY MAX. OCCUPANCY LOAD AND NUMBER OF SIGNS REQUIRED WITH INSPECTOR.

8. PROVIDE NUMBERS ON BUILDING IN BLOCK LETTERS AT CONSPICUOUS LOCATION AS APPROVED BY LOCAL OFFICIALS HAVING JURISDICTION OVER THE PROJECT.

9. PROVIDE NO LESS THAN (1) 10 LB. A.B.C. MULTI-PURPOSE FIRE EXTINGUISHER IN THE DINING AREA AND (1) 15 LB. "K" TYPE FIRE EXTINGUISHER IN THE KITCHEN AREA W/ 30' OF THE KITCHEN EXHAUST HOOD. FIELD VERIFY & COORDINATE EXACT LOCATIONS W/ LOCAL FIRE PREVENTION BUREAU HAVING JURISDICTION OVER THE PROJECT. REFER ALSO TO EQUIPMENT SCHEDULE.

10. PROVIDE NO LESS THAN (1) 10 LB. A.B.C. MULTI-PURPOSE FIRE EXTINGUISHER IN THE DINING AREA AND (1) 15 LB. "K" TYPE FIRE EXTINGUISHER IN THE KITCHEN AREA W/ 30' OF THE KITCHEN EXHAUST HOOD. FIELD VERIFY & COORDINATE EXACT LOCATIONS W/ LOCAL FIRE PREVENTION BUREAU HAVING JURISDICTION OVER THE PROJECT. REFER ALSO TO EQUIPMENT SCHEDULE.

11. PROVIDE A KNOX-BOX IN ACCORDANCE WITH LOCAL CODE REQUIREMENTS. COORDINATE EXACT TYPE AND LOCATION WITH THE LOCAL OFFICE OF FIRE PREVENTION.

12. PROVIDE TERMITE TREATMENT PER SPECIFICATION SECTION 02282.

HEALTH DEPT NOTES

1. ALL EXTERIOR DOORS SHALL BE SELF CLOSING AND RODENT PROOF. NO OPENING IN OR AROUND ANY DOOR SHALL EXCEED 1/4".

2. ALL LIGHTING SHALL BE SHIELDED WHEN LOCATED OVER OPEN FOOD AND OPEN STORAGE AND UTENSIL WASHING AREAS. ALL LIGHTING IN KITCHEN, FOOD STORAGE & TOILET ROOMS SHALL BE A MINIMUM OF 20 FOOT CANDLES. ALL LIGHTING IN DINING AREAS SHALL BE A MINIMUM OF 10 FOOT CANDLES.

3. ALL PIPING, CONDUIT, BOX CABLE AND SIMILAR CONSTRUCTION SHALL BE EITHER LOCATED IN WALLS OR INSTALLED W/ A MINIMUM 3/4" SPACE FROM WALLS OR SEALED TO THE WALL.

4. ALL EQUIPMENT AND INSTALLATION SHALL MEET NATIONAL SANITATION FOUNDATION (NSF) STANDARDS.

ALL EQUIPMENT AND INSTALLATION SHALL MEET NATIONAL SANITATION FOUNDATION (NSF) STANDARDS.

6. PROVIDE A SPLASH BARRIER AT ALL HAND SINKS WHERE THERE IS LESS THAN 18" HORIZONTAL DISTANCE FROM WORK TABLES OR DRAIN BOARDS.

7. ALL SINKS AND PLUMBING FIXTURES SHALL BE SEALED TO WALL WITH MILDEW RESISTANT WHITE OR CLEAR CAULK. USE WHITE AT PORCELAIN FIXTURES AND CLEAR AT STAINLESS STEEL.

LIFE SAFETY NOTES

1. IN EXISTING BUILDINGS THE EXISTING DOOR LEAF WIDTH SHALL BE NOT LESS THAN (28") IBC 7.2.1.1.4.

TRAVEL DISTANCES

A to B 25'-0"
C to D 30'-0"
COMMON PATH OF TRAVEL
E to F 22'-0"
G to H 28'-0"

SHEET TITLE

CODE DATA & ACCESSIBILITY PLANS

NORWOOD ARCHITECTS
807 FORREST ST. N.W.
ATLANTA, GEORGIA 30318
PH: 678-921-0302 FAX: 678-921-0301 WWW.NORWOODARCHITECT.COM

HUDDLE HOUSE
EVO 2000 RESTAURANT
40 US HWY 84 CAIRO, GA
GRADY CO. 39828

NO. ISSUE DATE
PERMIT SET
04/15/2019

DRAWING NUMBER

A002