
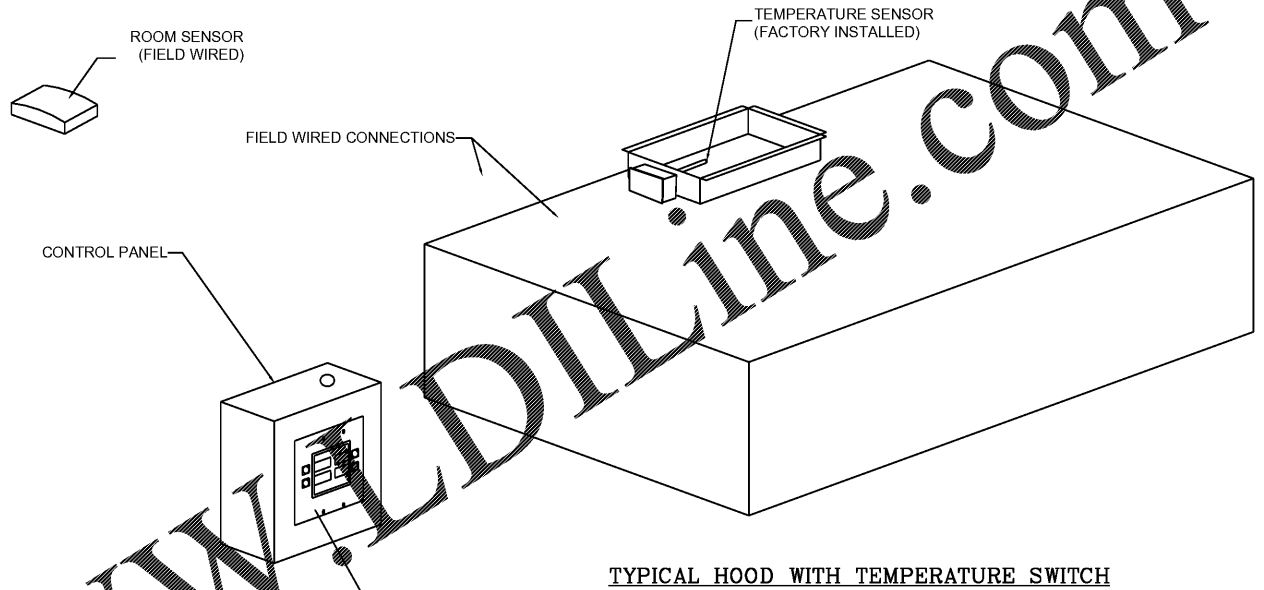


ELECTRICAL PACKAGE -

NO	TAG	PACKAGE #	LOCATION	SWITCHES		OPTION	FANS CONTROLLED					
				LOCATION	QUANTITY		FAN TAG	TYPE	HP	VOLT	FLA	
1		SC-22110FP	Wall Mount In SS Box	05 - SS Wall Mount Box	1 Fan	Smart Controls Thermostatic Control	F-1	Exhaust	1	0.750	208	5.2
					1 Fan		F-2	Exhaust	1	0.750	208	5.2
					1 Fan		SF-1	Supply	1	1.500	208	6.7
2				WV - Face Mount Light Shelf of Hood	1 Fan							

TEMPERATURE SENSOR INTERLOCK

The Temperature Sensor Interlock option complies with IMC 2006 507.2.1.1 and NFPA 96 11.1.1 by interlocking with cooking appliances through means of a heat sensor to automatically activate exhaust fans during cooking operations.

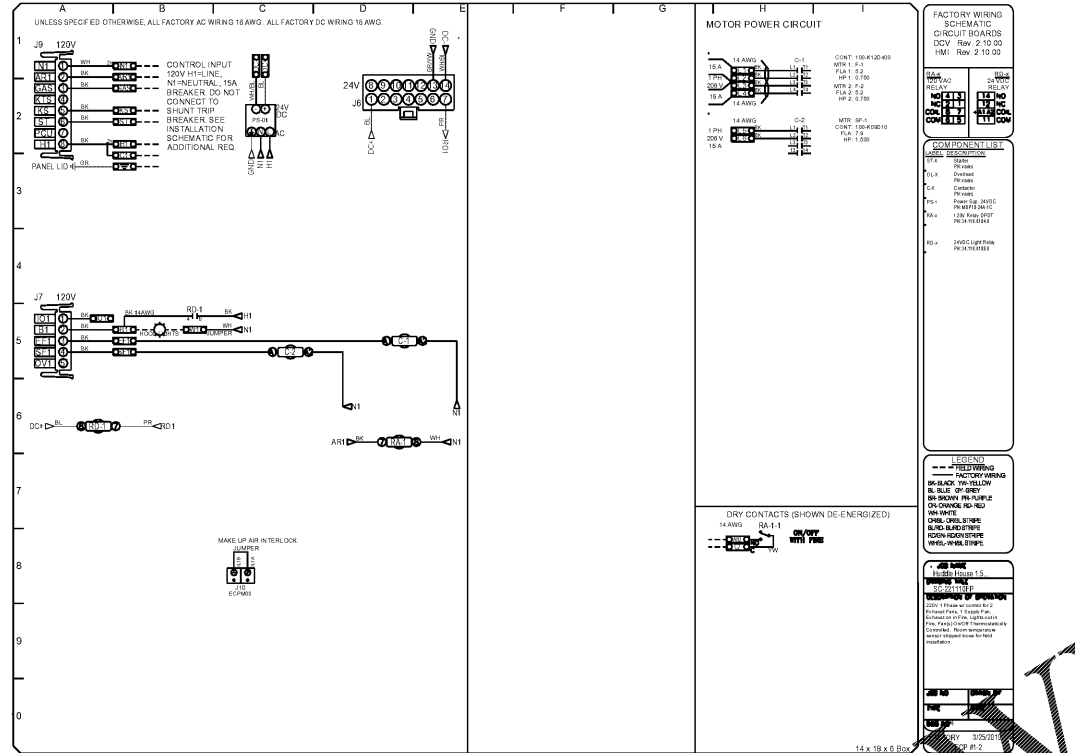


ELECTRICIAN NOTES :

All Hood/Fan/EMS/UDS/PCU electrical connections and interconnections to be provided and installed by Electrician. Electrician to provide, install, and label wiring between hood lights, hood temp sensors, remote Ansul system microswitches, and any other components requiring an electrical connection to the Cooktop-Aire electrical package.

Failure by the Electrician to make ALL required electrical connections and interconnections will result in the electrical controls not working properly. Any loss or failure as a result of electrical controls not working properly is the responsibility of the Electrician.

Light bulbs for kitchen hoods to be provided and installed by electrician.

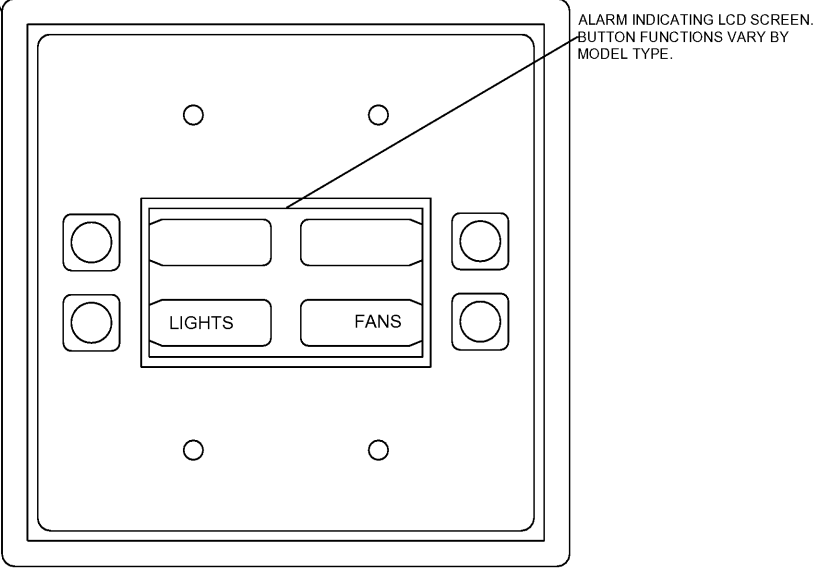

Order Plans @



JOB NO. LI 905

NORWOOD ARCHITECTS
 807 Forester Ln, NW
 Atlanta, Georgia 30318
 ph. 678-921-0302 fax. 678-921-0301
 www.norwoodarchitects.com

HUDDLE HOUSE
 EVO 2000 RESTAURANT
 40 US HWY 84 CAIRO, GA
 GRADY CO. 39828

NO.	ISSUE DATE
	PERMIT SET 04/15/2019

DRAWING NUMBER

MH103