


Order Plans @ www.dline.com

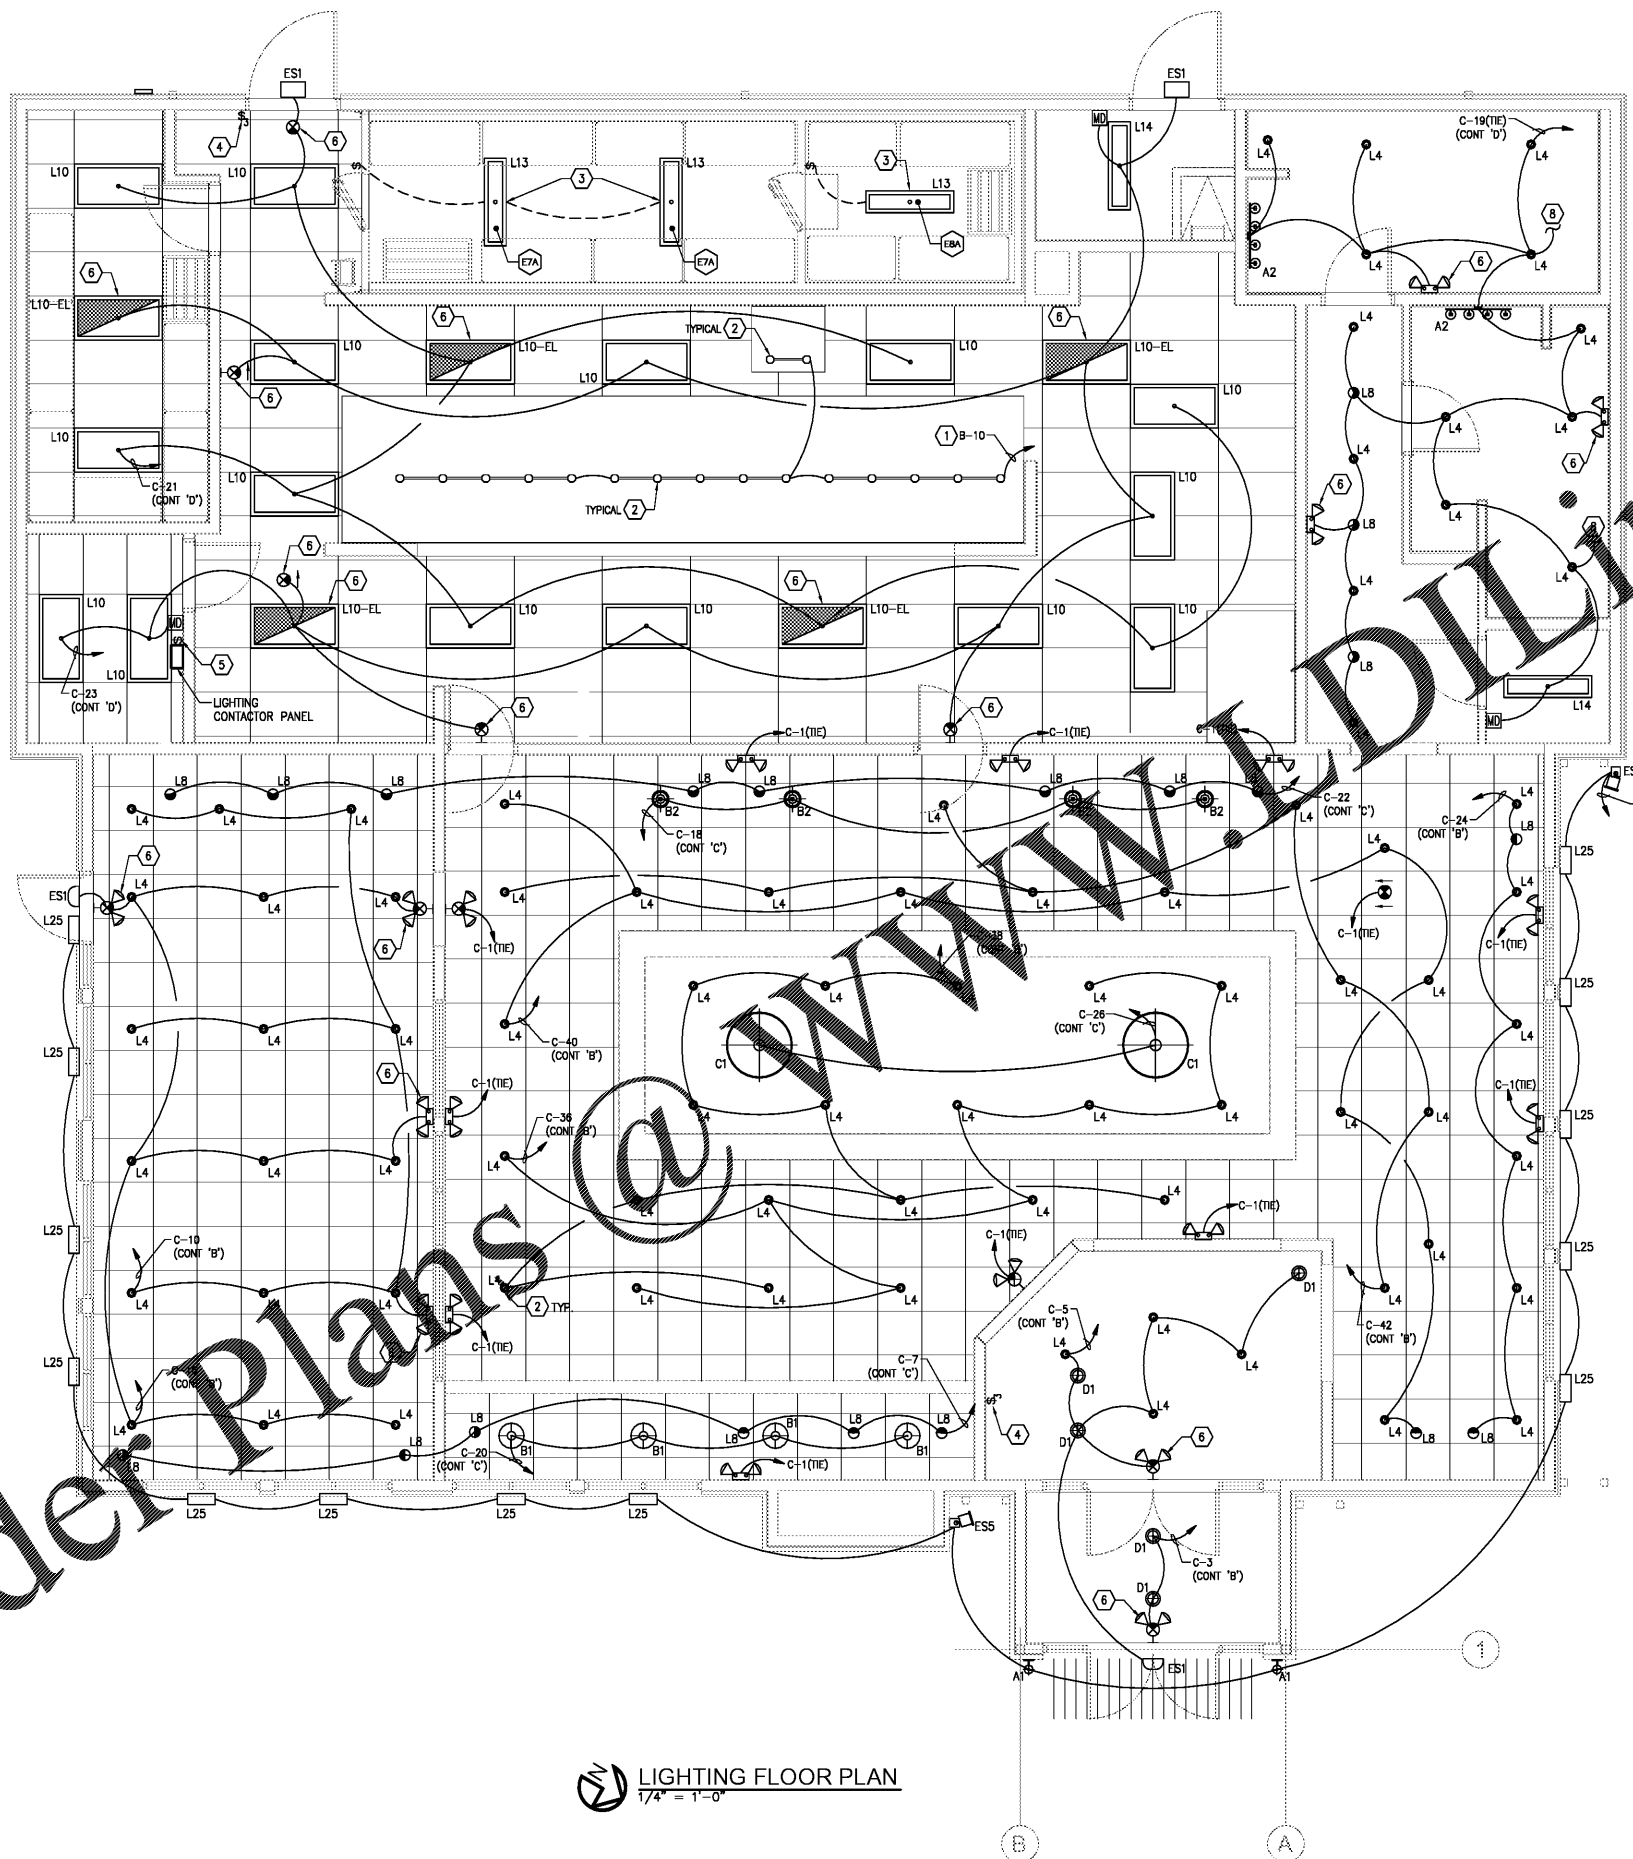

LIGHTING FLOOR PLAN
1/4" = 1'-0"

- ### GENERAL NOTES
- LIGHTING FIXTURES IN AREAS WHERE FOOD IS PREPARED OR OPEN FOOD IS STORED OR WHERE DISHES ARE CLEANED SHALL HAVE A SHATTERPROOF GLASS AND BE READILY CLEANABLE.
 - BATTERY PACKS ARE TO BE SECT ARMED. NO EXPOSED WIRING IS PERMITTED.
 - ELECTRICAL CONTRACTOR TO PROVIDE STEEL ANGLES AND HARDWARE REQUIRED FOR ALL HANGING LIGHT FIXTURES, CEILING FANS ETC. ALL EXPOSED CONDUIT, JUNCTION BOXES, MOUNTING HARDWARE ETC. TO BE RUN AS NEAT AS POSSIBLE AT UNDERSIDE OF ROOF DECK AND IS TO BE PAINTED.
 - ALL WIRING, DEVICES AND FIXTURES INSIDE THE WALK-IN FREEZER AND WALK-IN COOLER ARE TO BE VAPOR PROOF. SEAL ALL CONDUIT PENETRATIONS WITH SILICONE.
 - USE FLEXIBLE METAL CONDUIT (GREENFIELD) FOR CONNECTION OF LAY-IN FIXTURES.
 - PROVIDE GROUND CONDUCTOR IN ALL CONDUIT RUNS (NOT ILLUSTRATED).
 - THROUGH WIRING OF FIXTURES SHALL NOT BE PERMITTED UNLESS SPECIFICALLY ILLUSTRATED.
 - EACH LIGHTING FIXTURE SHALL HAVE ITS OWN BOX UNLESS OTHERWISE ILLUSTRATED.
 - SEE KITCHEN EQUIPMENT DRAWINGS FOR KITCHEN FIXTURES ELECTRICAL SCHEDULE AND ROUGH-IN LOCATIONS.
 - WIRING OF EMERGENCY LIGHT FIXTURES SHALL CONFORM TO THE CITY FIRE MARSHAL'S OFFICE EMERGENCY WIRING CRITERIA.
- ### KEYED NOTES
- INTERLOCK HOOD LIGHT WITH HOOD ON/OFF SWITCH. CIRCUIT TO SHUT OFF THRU SHUNT MAIN BREAKER OF PANEL 'B'.
 - HOOD LIGHTS FURNISHED AND INSTALLED WITH HOOD.
 - SEE SHEET E1.2 FOR POWER CONNECTIONS.
 - E.C. SHALL PROVIDE AND INSTALL MASTER SWITCH TO CONTROL ALL LIGHTING WITH THE EXCEPTION OF THE OFFICE, WALK-IN COOLER AND FREEZER AND EQUIPMENT ROOMS. VERIFY EXACT MOUNTING LOCATION WITH ARCHITECT PRIOR TO ROUGH-IN.
 - E.C. SHALL INSTALL NEW LIGHT SWITCH TO BE USED FOR PHOTOCELL/TIMECLOCK OVERRIDE. VERIFY EXACT MOUNTING LOCATION WITH OWNER AND ARCHITECT PRIOR TO ROUGH-IN.
 - CONNECT TO UNSWITCHED LEG OF CIRCUIT FOR EMERGENCY AND EXIT LIGHTING.
 - VIA PHOTOCELL THROUGH CONTACTOR.
 - CONTINUE CIRCUITING TO LOCAL EXHAUST FAN. REFER TO DRAWING E-1.4 AND MECHANICAL DRAWINGS FOR FURTHER INFORMATION.

- COORDINATE ALL LOCATIONS AND ELEVATIONS WITH ARCHITECTURAL DRAWINGS, ARCHITECTURAL SKETCHES AND EQUIPMENT SUPPLIERS. AVOID CONFLICTS BETWEEN EXIT SIGNS AND TVS, NEON SIGNS, DRAPERIES, ETC.
- VERIFY LOCATION OF WALL MOUNTED EMERGENCY LIGHT FIXTURES TO AVOID CONFLICT WITH WOOD TRIM.
- REFER TO ARCHITECTURAL FOR EXACT LOCATION OF LIGHTING FIXTURES. COORDINATE WITH ARCHITECT FOR LOCATION OF LIGHTING FIXTURES AND DEVICES BEFORE ROUGH-IN.
- VERIFY LOCATION OF PHOTOCELL/TIMECLOCK OVERRIDE SWITCH WITH ARCHITECT AND OWNER PRIOR TO ROUGH-IN.
- VERIFY EXACT ELECTRICAL CIRCUITING AND CONTROLS REQUIREMENTS OF WALK-IN COOLER AND FREEZER LIGHTING WITH MANUFACTURER.
- REFER TO CIVIL DRAWINGS FOR ADDITIONAL ROOF MOUNTED, GROUND MOUNTED AND POLE MOUNTED LIGHT FIXTURES. VERIFY EXACT LOCATION IN FIELD.
- E.C. SHALL CIRCUIT ALL NEW SITE LIGHTING FIXTURES AND SIGNAGE COMPLETE. REFER TO PANEL SCHEDULES ON SHEET E2.1 AND LIGHTING CONTROL DIAGRAM ON SHEET E3.3 FOR CIRCUITING AND CONTROLS. VERIFY ALL FINAL LOCATIONS WITH CIVIL DRAWINGS AND SIGN VENDOR PRIOR TO ROUGH-IN.



PROJECT NO.:
DRAWN BY: TBA
CHECKED BY: TBA
ISSUED DATE: 05.07.19

ISSUED REVISIONS:

Owensboro, KY 42303
Rise and Shine Prototype
LUMINAIRE REFLECTED CEILING PLAN