




**4B** RECESSED LIGHT FIXTURE AT ACOUSTICAL TILE CEILING  
Scale: 1"=1'-0"

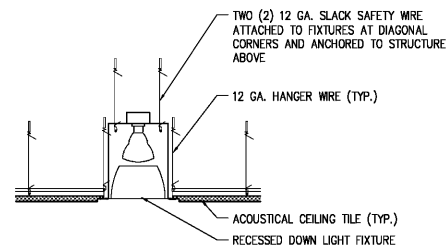

**4D** TYP. DOWNLIGHT FIXTURE AT ACOUSTICAL TILE CEILING  
Scale: 1"=1'-0"

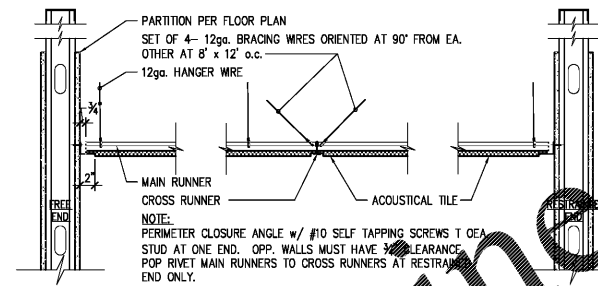

**4E** TYP AC TILE AT EDGE CONDITION  
Scale: 1"=1'-0"

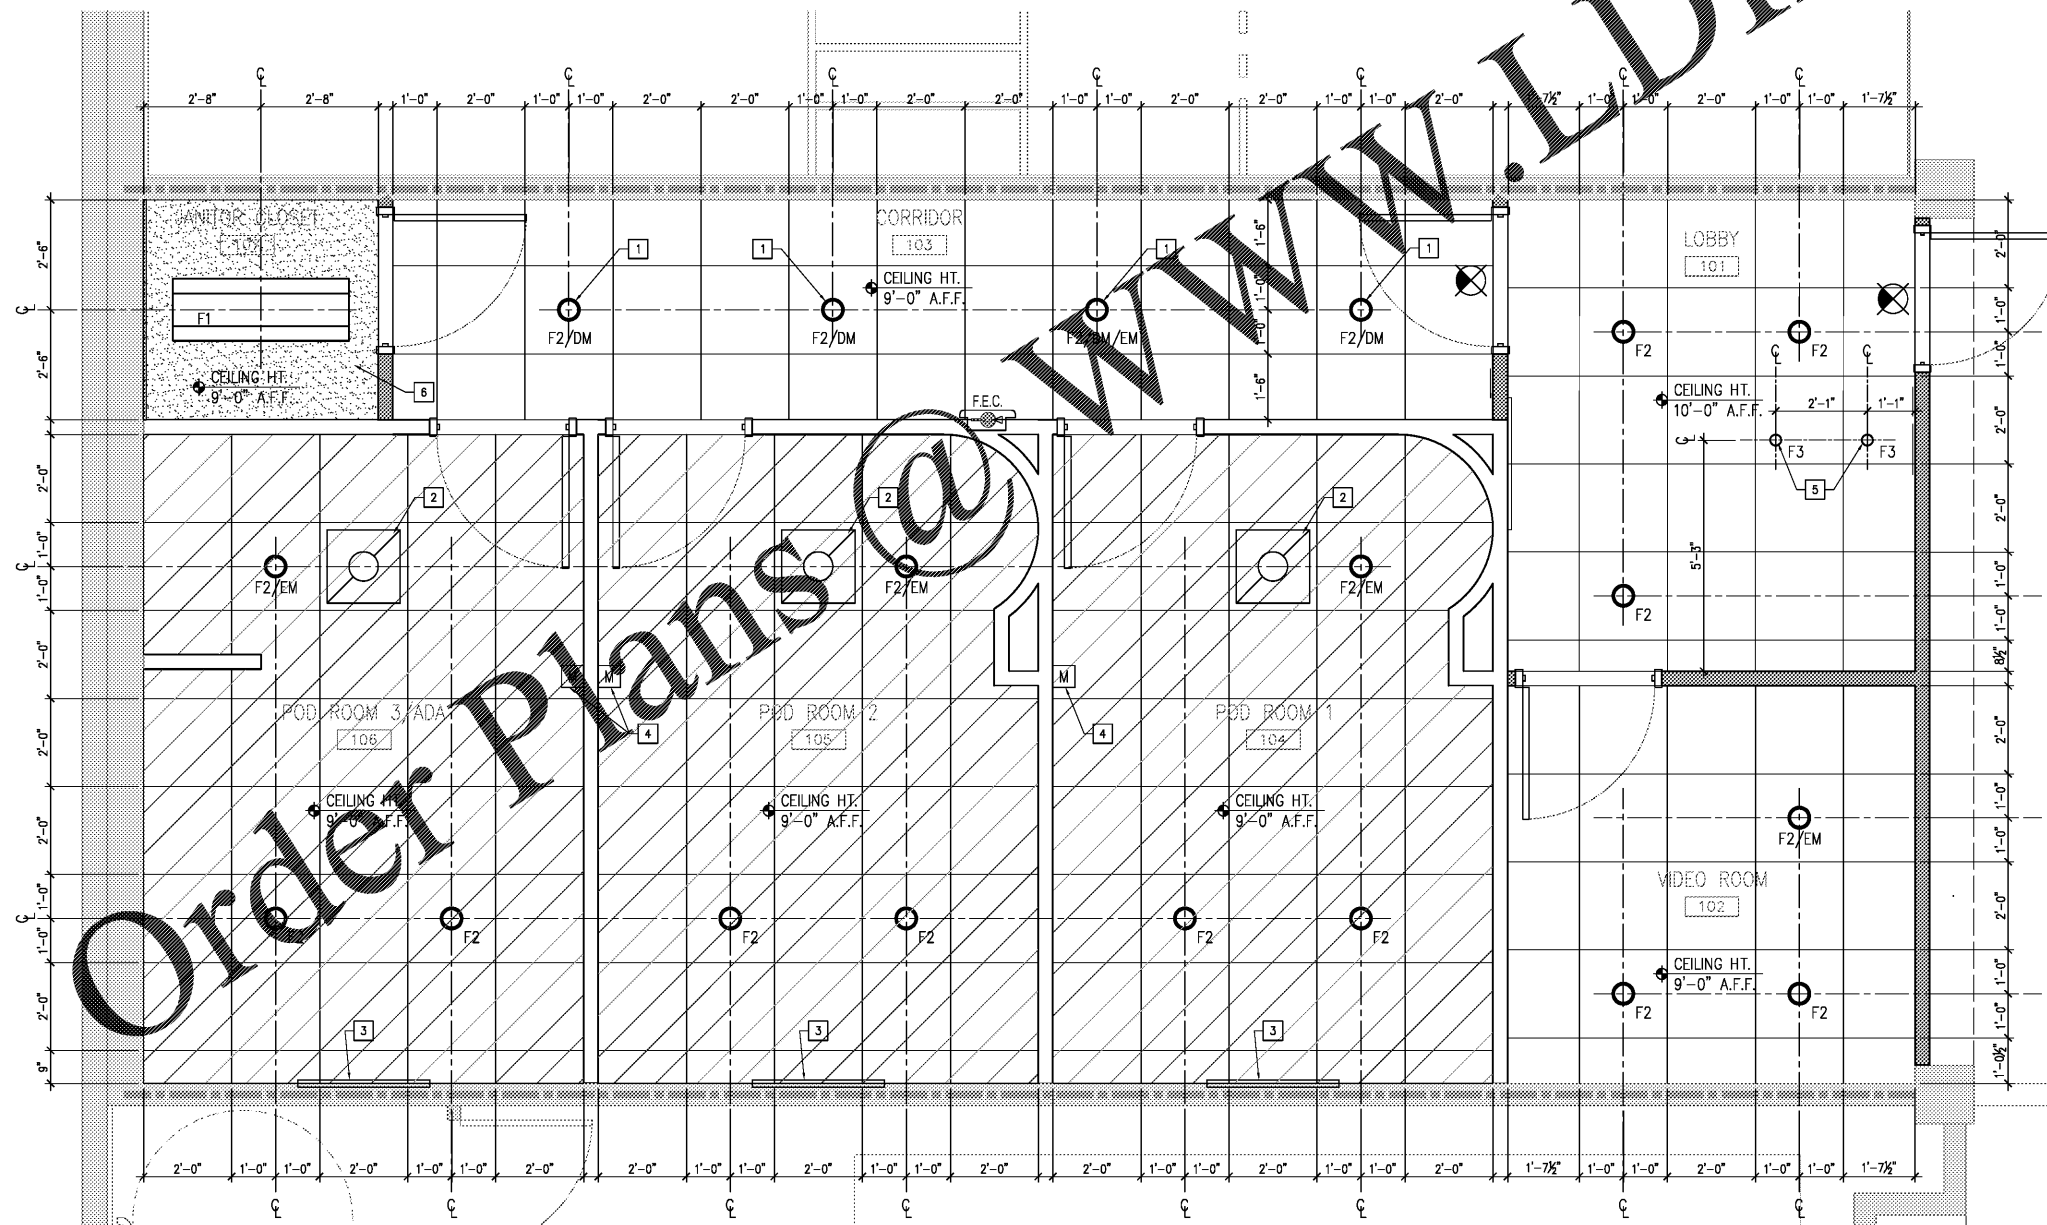

**REFLECTED CEILING PLAN**  
Scale: 1/2" = 1'-0"

**REF. CL'G PLAN LEGEND**

- GENERAL AREAS:  
ACOUSTICAL TILE - 2' X 2' EQUAL TO ARMSTRONG 'DUNE' SECOND LOOK II W/ SQUARE EDGE PROFILE.  
CEILING GRID - EQUAL TO ARMSTRONG PRELUDE 1/4" ALUMINUM GRID.  
GRID AND PANELS TO BE WHITE.
- POD ROOMS:  
ACOUSTICAL TILE - 2' X 2' VINYL FACE TILE CEILING EQUAL TO CLIMA PERFORM VINY WRAPPED GYPSUM BOARD CEILING PANEL W/ SQUARE EDGE PROFILE.  
CEILING GRID - EQUAL TO ARMSTRONG PRELUDE 1/4" ALUMINUM GRID.  
GRID AND PANELS TO BE WHITE.
- ILLUMINATED EXIT SIGN. RE: LIGHTING DRAWINGS.
- [F1] 48"x8", ILP SHALLOW WRAP - 30W LED, SURFACE MOUNTED. RE: LIGHTING DRAWINGS.
- [F2] PHILIPS LIGHTOLIER, 5" LYTCASTER LED DOWNLIGHT, 120 VOLTS. RE: LIGHTING DRAWINGS.
- [F3] PENDANT LIGHTS AT RECEPTIONIST DESK PER TRUE REST SPECS. RE: LIGHTING DRAWINGS.
- CEILING MOUNTED EXTRACTOR EXHAUST FAN. RE: MECHANICAL DRAWINGS.


**REFLECTED CEILING NOTES**

- SPRINKLER HEADS LOCATED IN GYP. BD. CEILINGS SHALL BE FULL RECESSED AND FACTORY PAINTED TO MATCH CEILINGS. DISTRIBUTION OF HEADS MUST MEET COVERING CODES.
- PLANS FOR ALL FIXED FIRE PROTECTION EQUIPMENT SUCH AS STANDPIPES, SPRINKLER SYSTEMS AND FIRE ALARM SYSTEMS MUST BE SUBMITTED AND APPROVED BY THE FIRE DEPARTMENT PRIOR TO INSTALLATION. SUBMIT SPRINKLER LAYOUTS FOR APPROVAL PRIOR TO INSTALLATION. ALL STROBES TO BE WHITE, TYP AND LOCATED IN CEILING WHERE ALLOWABLE BY CODE. FINAL LOCATION TO BE APPROVED BY ARCHITECT.
- THE STANDARD FIRE SPRINKLER HEAD SHALL BE A SEMI-RECESSED ADJUSTABLE HEAD. DISTRIBUTION OF HEADS MUST MEET COVERING CODES. LOCATION SHALL BE IN THE CENTER OF CEILING TILE, U.N.O. (EXCEPT AS CODE REQUIRES NEAR SOFFIT)
- ALL CONDUIT MUST BE A MINIMUM OF 6" CLEAR ABOVE THE CEILING GRID.
- PROVIDE ILLUMINATED EXIT SIGNS CONNECTED TO EMERGENCY POWER OR BATTERY BACKUPS. IN THE EVENT OF POWER FAILURE, ILLUMINATION SHALL BE AUTOMATICALLY PROVIDED.
- LOCATE RECESSED DOWN LIGHTS, WALL WASHERS AND ACCENT LIGHTS IN THE CENTER OF CEILING TILE, U.N.O. (EXCEPT AS CODE REQUIRES NEAR SOFFIT)
- AVERAGE LEVEL OF LIGHTING THROUGHOUT SHALL BE PROVIDED AS REQUIRED TO MEET LOCAL GOVERNING CODES. SEE ELECTRICAL ENGINEERING DRAWINGS FOR MORE INFORMATION.
- PROVIDE EMERGENCY LIGHTING AT A VALUE OF ONE-FOOT CANDLE AT FLOOR LEVEL, OR AS REQUIRED BY LOCAL CODES. SEE ELECTRICAL ENGINEERING DRAWINGS FOR LOCATION.
- ALL CONDUIT, HVAC, DUCTS AND CABLING SHALL BE INDEPENDENTLY SUSPENDED FROM THAT USED TO SUSPEND CEILING SYSTEM.
- ALL NEW CIRCUITS SHALL BE LABELED ON THE PROPER BUILDING ELECTRICAL PANEL DIRECTORIES. SEE ELECTRICAL ENGINEERING DRAWINGS FOR LOCATION.
- ALL FIXTURES TO BE INSTALLED PER LOCAL CODES.
- PROVIDE MULTI-GANG SWITCHES PER LOCAL CODES WHERE INDICATED. USE MULTI-GANG SWITCH PLATES WHENEVER MORE THAN ONE DOUBLE GANG BOX IS USED.
- ALL EQUIPMENT IN PLENUM TO BE LOCATED AWAY FROM GYP. BD. CEILINGS. NO ACCESS HATCHES IN GYPSUM BOARD CEILING WITHOUT PRIOR APPROVAL BY ARCHITECT. APPROVED ACCESS HATCHES SHALL BE A FRAMELESS TYPE. CONTRACTOR TO SUBMIT CUT SHEET FOR APPROVAL.
- PROVIDE HVAC AND ZONING AS REQUIRED BY CODE AND TENANT'S DESIGN CRITERIA.
- VERIFY ALL THERMOSTAT LOCATIONS PRIOR TO INSTALLATION. CONTRACTOR TO SCHEDULE WALK THROUGH PRIOR TO INSTALLATION TO ENSURE THAT LOCATIONS DO NOT CONFLICT WITH TENANT'S FURNITURE.
- LIGHT SENSORS TO BE LOCATED BY ELECTRICAL ENGINEER AND APPROVED BY ARCHITECT.
- ALL CEILING TILES WHICH ARE CUT TO FIT SHALL BE KERFED TO MATCH.

**KEY NOTES: CEILING PLAN**

- HALLWAY LIGHT FIXTURE WITH DIMMERS - SEE ELECTRICAL DRAWINGS.
- CEILING MOUNTED EXHAUST FAN WITH 5 AIR CHANGES PER HOUR, MIN 50 CFM REQUIRED. SIZE PER ASHRAE 62.2, TABLE 7.1. BATHROOM EXHAUST FANS COMPLY WITH THE FOLLOWING: FANS SHALL BE ENERGY START COMPLIANT AND BE DUCTED TO TERMINATE TO THE OUTSIDE OF THE BUILDING - FANS, NOT FUNCTIONING AS A COMPONENT OF A WHOLE VENTILATION SYSTEM, MUST BE CONTROLLED BY A HUMIDITY CONTROL. - SEE MECHANICAL DRAWINGS FOR MORE DETAIL.
- TRUE REST LOGO LIGHT, PROVIDE 4-BOX FOR MILLWORK LIGHT BOX, LIGHT BOX PROVIDED BY MILLWORK SUB-CONTRACTOR.
- EACH ROOM TO HAVE A MOTION SENSOR SET FOR 60-90 MINUTES. MOTION SENSOR TO CONTROL SHOWER LIGHT AND LOGO LIGHT BOX.
- PENDANT LIGHTS TO BE LOCATED ABOVE RECEPTIONIST DESK - FINAL LOCATION MAY VARY - FIELD VERIFY.
- SUSPENDED GYPSUM BOARD CEILING

**GODWIN + ASSOCIATES**  
architects & engineers



Professional Seal  
James A. Godwin  
STATE OF GEORGIA  
REGISTERED ARCHITECT  
NO. 050719

Professional Seal  
Revisions  
1. 05.07.19 OWNER REVIEW COMMENTS

SPECIAL NOTICE:  
In the event the client consents to, allows, authorizes or approves of changes to any plans, specifications or other construction documents, and these changes are not approved in writing by the design professional, the client recognizes that such changes and the results thereof are not the responsibility of the design professional. Therefore, the client agrees to release the design professional from any liability arising from the construction, use or result of such changes. In addition, the client agrees to the fullest extent permitted by law, to indemnify and hold the design professional harmless from any damage, liability or cost (including reasonable attorney's fees and costs of defense) arising from such changes.

Copyright © 2019 by GODWIN + ASSOCIATES. All rights reserved. No part of this drawing may be reproduced by photocopy or by any other means, or stored, processed, or transmitted in or by any computer or other systems without the prior written permission of GODWIN + ASSOCIATES.

Project Number: 49034  
Drawn By: PHM  
Reviewed By: JAG  
Date: 04.10.19

**True Rest Float Spa**

2995 Cobb Parkway Southeast  
Cobb County, GA 30339

**Reflected Ceiling Plan and Notes**

**CONSTRUCTION DOCUMENTS**

Sheet Number

**A4.1**