

SPECIAL SYSTEM AND MOUNTING HEIGHTS
REFER TO ARCHITECTURAL INTERIOR ELEVATIONS FOR EXACT LOCATION AND MOUNTING HEIGHTS

POWER PLAN WIRING LAYOUT

PARTIAL FLOOR PLAN OFFICE - ELECTRICAL
SCALE: 1/2"=1'-0"

OFFICE NOTES:


- DN1 COORDINATE EXACT LOCATION OF VOICE/DATA OUTLET WITH ULTA "I" DEPARTMENT AND ARCHITECT. REFER TO ARCHITECTURAL ELEVATION FOR ALL DEVICE LOCATIONS AND MOUNTING HEIGHTS.
- DN2 REFER TO SHEET # E3-2 FOR LOW VOLTAGE WIRING.
- DN3 PRIOR TO ROUGH IN OF ALL OUTLETS, CONTRACTOR SHALL FIELD VERIFY EXACT EQUIPMENT LOCATIONS WITH OWNER'S REPRESENTATIVE AND EQUIPMENT VENDOR.
- DN4 PROVIDE 3-GANG JUNCTION BOX (FOR SOUND SYSTEM VOLUME CONTROLS) MOUNTED 45" A.F.F. WITH 3/4" CONDUIT STUB TO ACCESSIBLE CEILING SPACE.
- DN5 PROVIDE JUNCTION BOX (FOR SOUND SYSTEM AMP) MOUNTED 76" A.F.F. WITH 3/4" CONDUIT STUB TO ACCESSIBLE CEILING SPACE AND 7/8" ROUND OPENING COVER PLATE.
- DN6 4"x4" JUNCTION BOX FOR TEMPERATURE SENSOR, WITH SINGLE GANG COVER, MOUNTED AT WITHIN 16" OF WALL LIGHT SWITCH AT SAME HEIGHT AND IN SAME STUD ROCKET (SPACE). INSTALL 3/4" CONDUIT FROM JUNCTION BOX INTO ACCESSIBLE CEILING SPACE.

GENERAL NOTES:


- A. EXISTING CONDITIONS SHOWN ARE BASED ON AS-BUILT DRAWINGS PROVIDED BY THE OWNER. CONTRACTOR SHALL ADJUST FOR ACTUAL FIELD CONDITIONS AT NO ADDITIONAL EXPENSE TO THE OWNER.
- B. REFER TO ARCHITECTURAL DRAWINGS FOR EXACT LOCATION OF ALL ELECTRICAL DEVICES. CONTRACTOR SHALL COORDINATE ALL DEVICE LOCATIONS AND MOUNTING HEIGHTS WITH ARCHITECTURAL ELEVATIONS PRIOR TO ANY INSTALLATION.
- C. ALL CONDUIT AND JUNCTION BOXES SHALL BE INDEPENDENTLY SUPPORTED FROM STRUCTURE AND NOT FROM ACCESSIONAL CEILING OR CEILING SUPPORTS.
- D. FLOOR BOXES SHALL HAVE A TAPERED EDGE OR BE RECESSED INTO TILE.
- E. MAINTAIN CONTINUITY OF CIRCUITS SERVING FIXTURES, DEVICES, OR EQUIPMENT NOT BEING REMOVED.
- F. SEE ARCHITECTURAL DRAWINGS FOR TRENCHING DETAIL.
- G. RECEPTACLES SHALL BE GRAY DEVICES WITH STAINLESS STEEL COVERPLATE WHEN LOCATED OVER WC-5. STAINLESS STEEL OR OTHER GRAY WALL FINISHES. SEE ARCHITECTURAL INTERIOR ELEVATIONS FOR ADDITIONAL INFORMATION.
- H. ALL CONDUIT ROUTED IN FLOOR SLAB SHALL BE 3/4" SCHEDULE PVC CONDUIT WITH GROUND WIRE WHERE ALLOWED BY LOCAL CODE AND UNLESS SPECIFICALLY NOTED OTHERWISE.
- I. ALL RECEPTACLES TO BE CONTROLLED BY EMS SYSTEM SHALL BE PROVIDED WITH ENGRAVED NEC "CONTROLLED RECEPTACLE MARKING SYMBOL".

PLAN NOTES:

- 1 ALL MOUNTING HEIGHTS SHALL BE ABOVE FINISHED FLOOR.
- 2 RECEPTACLE TO BE MOUNTED INSIDE ARCH LIGHTING PANEL/MILKWORK ON BACK FACE. COORDINATE EXACT LOCATION WITH ARCHITECTURAL DRAWINGS, SEE DETAIL 4/10-3.
- 3 REFER TO ARCHITECTURAL DETAIL 3/7-1.1C FOR EXACT LOCATION OF RECEPTACLES.
- 4 RECEPTACLES SHALL BE MOUNTED HORIZONTALLY IN BACK PANEL OF MILKWORK AT 28" A.F.F. SEE ARCHITECTURAL INTERIOR ELEVATION FOR EXACT RECEPTACLE LOCATIONS.
- 5 HARDWARE BOX FOR ARCH LIGHTING, MOUNTED ON BACK PANEL OF MILKWORK BEHIND ARCH FACE PANEL IN CONCEALED ACCESSIBLE LOCATION. REFER TO DETAILS ON ARCHITECTURAL SHEET A-6.1 AND SHEET E0-3 FOR EXACT LOCATIONS.
- 6 HARDWARE BOX FOR LIGHT BOX, MOUNTED ON BACK PANEL OF MILKWORK BEHIND LIGHT BOX PANEL IN CONCEALED ACCESSIBLE LOCATION. REFER TO DETAILS ON ARCHITECTURAL SHEET A-6.1 AND SHEET E0-3 FOR EXACT LOCATIONS.
- 7 RECEPTACLES SHALL BE MOUNTED HORIZONTALLY. COORDINATE WITH MILKWORK MANUFACTURER'S PRIOR TO ROUGH-IN. SEE ARCHITECTURAL INTERIOR ELEVATIONS FOR EXACT RECEPTACLE LOCATIONS.
- 8 LAS SECURITY ANTENNA. REFER TO SHEET # E3-1 FOR Riser DIAGRAM.
- 9 CONTRACTOR SHALL VERIFY TIMING OF TELEPHONE COMPANY CONNECTION WITH ULTA. RECEPTACLES NEED TO BE INSTALLED PRIOR TO TELEPHONE COMPANY CONNECTION COMPLETION.
- 10 TYPICAL FOR ALL FLOOR RECEPTACLES. SEE SHEET E0-1 AND E4-1 FOR ELECTRICAL SPECIFICATIONS ON FLOOR RECEPTACLES TO BE USED.
- 11 REFER TO ARCHITECTURAL INTERIOR ELEVATIONS FOR EXACT RECEPTACLE LOCATIONS.
- 12 RECEPTACLES SHALL BE MOUNTED HORIZONTALLY AT 44" A.F.F.
- 13 REFER TO COLUMN DETAIL ON SHEET A-2.0 FOR EXACT MOUNTING REQUIREMENTS.
- 14 COORDINATE WITH MILKWORK MANUFACTURER PRIOR TO ROUGH-IN. SET ARCHITECTURAL INTERIOR ELEVATION FOR EXACT RECEPTACLE LOCATIONS. ROUTING OF CONDUIT IN BASE OF MILKWORK AND ADDITIONAL INFORMATION.
- 15 TELEPHONE BOARD SHALL BE (3) 3/4" (4"x6") FIRE RATED PLUMBOD. REFER TO DETAIL 1/A-8.3.
- 16 COORDINATE EXACT MOUNTING HEIGHT OF RECEPTACLE FOR DRYER BOOSTER WITH MECHANICAL CONTRACTOR. RECEPTACLE SHALL BE BELOW CEILING.
- 17 WIRE REMOTE ON MODULE FOR GFI PROTECTION OF ELECTRIC WATER COOLER OUTLET. GFI MODULE SHALL BE MOUNTED BELOW WATER COOLER. COORDINATE RECEPTACLE LOCATION WITH MANUFACTURER'S INSTRUCTIONS AND ARCHITECT TO BE HIDDEN BY WATER COOLER.
- 18 RECEPTACLES SHALL BE MOUNTED IN MILKWORK. REFER TO ARCHITECTURAL ELEVATIONS FOR EXACT LOCATION.
- 19 RECEPTACLES SHALL BE MOUNTED HORIZONTALLY IN BACK PANEL OF MILKWORK. SET ARCHITECTURAL INTERIOR ELEVATION FOR EXACT RECEPTACLE LOCATIONS.

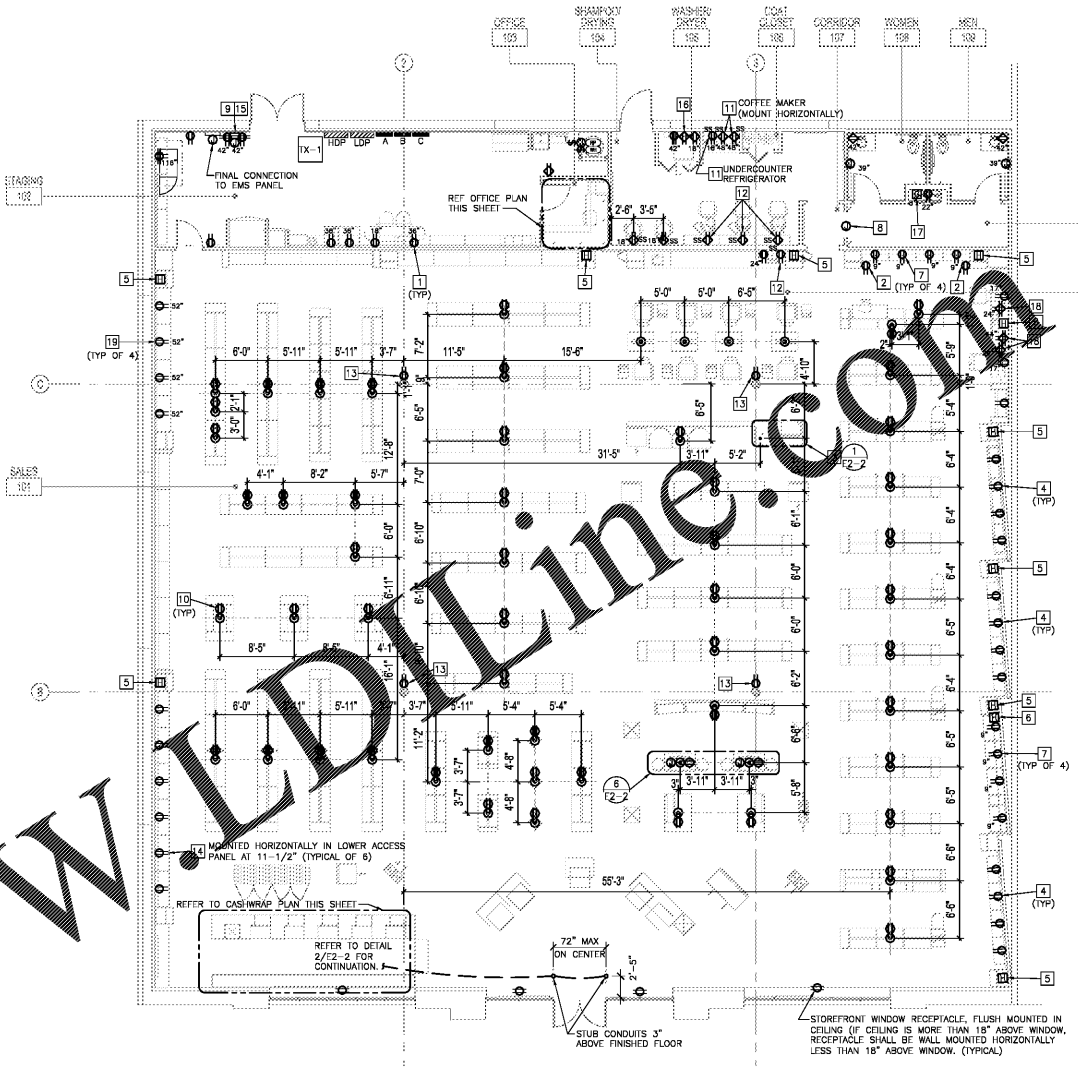

FLOOR PLAN - ELECTRICAL DIMENSIONS
SCALE: 1/8"=1'-0"

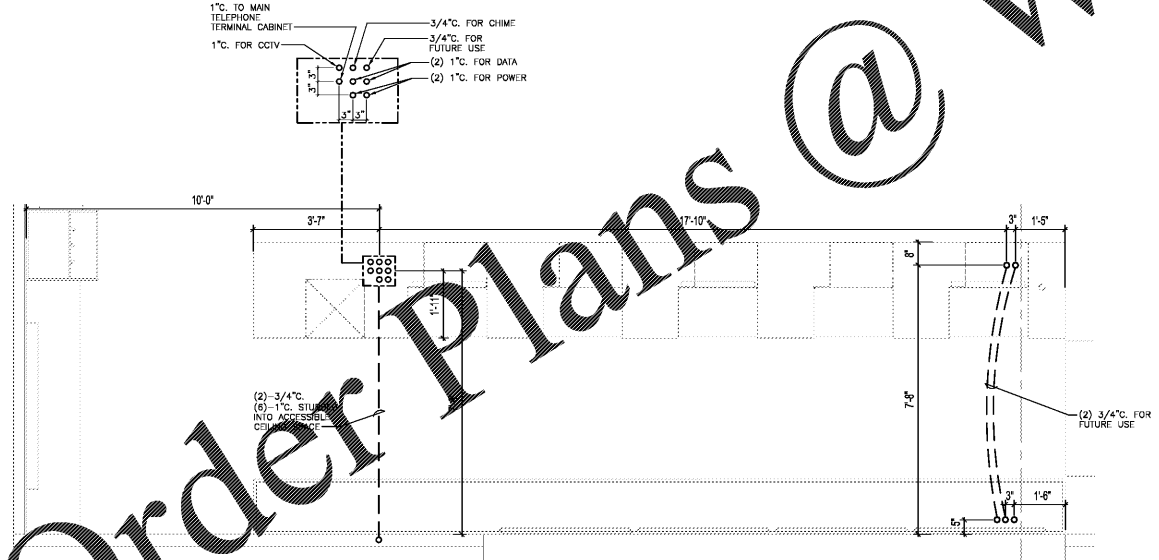

ENLARGED ROUGH-IN PLAN (CASHWRAP) ELECTRICAL DIMENSIONS
SCALE: 1/2"=1'-0"

SERVICE DESK NOTES:

- S1. ELECTRICAL CONTRACTOR SHALL FURNISH, INSTALL AND WIRE ALL DEVICES AND BOXES WITHIN RECEPTION/SALES COUNTER. COORDINATE EXACT LOCATION AND ROUTING IN FIELD WITH MILKWORK AND MILKWORK VENDOR PRIOR TO ROUGH-IN.
- S2. COORDINATE STUB UP LOCATIONS WITH EXACT SAFE LOCATION TO AVOID ALL INTERFERENCES.

RGLA
r gla solutions, inc.
5100 River Road, Ste 125
Schiller Park, IL 60176
P: 847.871.7422
F: 847.871.4200
www.rgla.com

REVISION	DATE
LL & ULTA REVIEW	06/03/19
BO ISSUE	06/03/19
PERMIT ISSUE	06/04/19

robert g. lyon + associates, inc.
114 N. Wacker Drive, Ste 1115
Chicago, IL 60601
5100 River Road, Ste 125
Schiller Park, IL 60176
P: 847.871.4200
www.rgla.com

THE ABOVE DRAWINGS AND SPECIFICATIONS SHALL BE USED BY THE CONTRACTOR AND SHALL REMAIN THE PROPERTY OF THIS OFFICE. NO PART THEREOF SHALL BE COPIED, REPRODUCED, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT THE WRITTEN CONSENT OF THE ENGINEER. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE APPLICABLE AGENCIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE APPLICABLE AGENCIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE APPLICABLE AGENCIES.

ULTA BEAUTY
ULTA #613
SHOPPES OF MADISON
8201 HIGHWAY 72 WEST
SUITE C
MADISON, AL 35758

FLOOR PLAN - ELECTRICAL DIMENSIONS

DESIGNED BY	HE
CHECKED BY	HE
JOB NUMBER	19047
SHEET NAME	E2-1

HENDERSON ENGINEERS
8345 LENOVA DRIVE, SUITE 300
LEVENA, MS 38874
TEL 913.742.5000 FAX 913.742.5001
WWW.HENDERSONENGINEERS.COM
185000789
AL CORPORATE TELENUMBER: CA-2185-E
EXPRES 01/01/20