

CONSTRUCTION SAFETY GENERAL NOTE
 THE STRUCTURAL ENGINEER SHALL NOT BE RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES OR PROCEDURES, OR FOR SAFETY PRECAUTIONS AND PROGRAMS, SINCE THESE ARE SOLELY THE CONTRACTOR'S RESPONSIBILITY.

CONCRETE GENERAL NOTES

- All detailing, fabrication and placing of reinforcing steel shall conform to the ACI standard "Details and Detailing of Concrete Reinforcement" (ACI 315).
- Concrete mix designs shall meet the following requirements:

Location	Minimum Compressive Strength (psi)	Maximum Aggregate Size	Maximum Water/Cement Ratio	Slump (in.)	Air Entrainment Percent (%)
Interior Slabs	4000	3/4"	.50	4 ±1	0
Exterior Slabs	3500	3/4"	.50	4 ±1	6 ±1
Perimeter Foundations	3000	1"	.50	4 ±1	6 ±1
- Reinforcing bars #4 and larger (except ties and stirrups) shall meet ASTM A615 with Supplementary Requirements (S1), Grade 60. Smaller bars shall be grade 40.
- All reinforcing bar splices shall be 44 bar diameters.
- All reinforcing bar hooks shall be ACI standard 90 degree hook, unless noted otherwise.
- All bars are to be supported in forms and spaced with wire bar supports per ACI "Manual of Standard Practice for Detailing Concrete Structures" (latest edition). Bars shall be securely wired per latest edition of CRSI's "Recommended Practice for Placing Reinforcing Bars". Accessories for exposed concrete shall be plastic or have plastic-tipped feet.
- The top of concrete pedestal shall be square, smooth & level to receive the metal building base plates.
- Smooth dowels shall be steel conforming to ASTM A36.
- All slots, sleeves and other embedded items such as strap-tie holdowns shall be set before concrete is placed. See Architectural, Electrical, Mechanical and vendor's drawings for sizes & locations.
- Electrical conduit to be placed below slab shall be located by electrician prior to placement of slab reinforcements. Slab shall be thickened in these areas to accommodate a minimum of 3" top covering and 3" bottom clearance.
- Fly ash shall not be used unless approved in writing by the Engineer. Fly ash, if approved, shall conform to ASTM C618 and shall not exceed 15% of the total cement volume.
- All concrete is reinforced unless specifically called out as unreinforced. Reinforce all concrete not otherwise shown with same steel as in similar sections or areas.
- No aluminum items shall be embedded in any concrete or placed in contact with concrete.
- Concrete coverage of reinforcement shall have the following clear distances unless noted otherwise on the drawings:
 - Cast against earth: 3"
 - Formed concrete exposed to earth or weather: 2"
 - Slabs not exposed to earth or weather: 1"
 - Beams & columns not exposed to weather: 1 1/2"
- Embedded and all reinforcing bars marked continuous shall be embedded to develop the full tension capacity of the bar. Laps shall be Class B tension lap unless specified otherwise on the drawings. Unless shown otherwise, splice top bars near midspan and splice bottom bars over supports.
- Supply corner bars 4'-0" long (min. 2'-0" in each direction) in outside face of wall at corners of all walls and continuous footings. Matching size and spacing of horizontal bars. Where there are no vertical bars in outside face of wall, supply three (3) #4 vertical support bars for corner bars.
- Concrete placed during cold weather shall conform to the requirements of ACI 308R-10. Cold weather is defined as a period when, for more than 3 successive days, the mean daily temperature drops below 40°F.
- Concrete placed during hot weather shall conform to the requirements of ACI 305R-10. Hot weather is defined as that combination of air temperature, relative humidity and wind speed that will cause a rate of evaporation of 0.2 lb/sq.ft/hr. or more as defined by Figure 2.1.5 of ACI 305R-10.
- Do not add water to concrete during delivery, at Project Site, or during placement, unless approved by the Engineer of Record.
- Reinforcing shall have the following lap splice and hook lengths:

Bar Size	Lap Splice	Hook
#4	2'-0"	8"
#5	2'-0"	10"
#6	3'-0"	1'-0"
#7	3'-0"	1'-2"
#8	4'-0"	1'-4"
- Maximum net allowable bearing pressure for footings = 2,000 psf. Bottom of footings shall bear on compacted structural fill as described in the Soils Report Project Number No. 37095043 dated December 10, 2009, by Terracon. Bottom of footings shall bear at or below minimum bearing depth. Minimum bearing depth is 18" below lowest adjacent finished grade.

STRUCTURAL STEEL GENERAL NOTES

- All detailing, fabrication and erection of structural steel shall conform to the requirements of the AISC Specification for the Design, Fabrication and Erection of Structural Steel for Buildings.
- Hollow Structural Section (HSS) shall conform to ASTM A500, Grade B with a yield strength of 46 ksi.
- W-Shapes shall conform to ASTM A992 with a yield strength of 50 ksi. All other structural steel shall conform to the requirements of ASTM A36.
- All anchor rods shall conform to ASTM F1554, Grade 36. Nuts for anchor rods shall conform to ASTM A563, Grade A, heavy hex and anchor rod washers shall conform to FS F-W-92.
- All welding shall conform to the Specifications of the American Welding Society. Welding electrodes shall be E-70 series. Welding shall be done by a certified welder.
- All bolts shall be tightened to a snug-tight condition. A snug tight condition is defined as the tightness attained by a few impacts of an impact wrench or the full effort of a man using an ordinary spud wrench. All connected elements must be brought into snug contact.
- Bearing ends of all columns shall be square cut.
- No openings shall be cut in structural members unless shown on the drawings.
- Anchor rod holes in base plates shall be sized in accordance with AISC "Detailing for Steel Construction".

PRE-ENGINEERED BUILDING DESIGN LOADS

- Building Code: 2017 FBC
- Roof Dead Load: per MBM
- Sprinkler System to Structural System: 250# At All Points Of Attachment
- Roof Collateral Load: 3 psf
- Roof Live Load: (L.L. reduction shall not be allowed) 20 psf
- Ground Snow Load: 0 psf
- Wind Load:
 - Ultimate Design Wind Speed, Vult (3-second gust) 157 mph
 - Nominal Design Wind Speed, Vnd (3-second gust) 122 mph
 - Risk Category II
 - Wind Exposure C
 - Internal Pressure Coefficient (GCP) = ±0.18
- ASD Load Combinations (Based on Ultimate Design Wind Speed):
 - D
 - D + Lr
 - D + 0.75Lr
 - D + 0.6W (or 0.7E)
 - D + 0.75Lr + 0.75 (0.6W or 0.7E)
 - 0.6D + 0.6W
 - 0.6D + 0.7E
- Seismic:
 - Site Coefficient
 - Fa = 1.600
 - Fv = 2.400
 - Sa = 0.057
 - S1 = 0.029
 - Sps = 0.06
 - Sst = 0.047
 - Site Class D
 - Seismic Design Category A
 - Basic Structural System = Per MBM
 - Seismic Resisting System = Per MBM
 - Response Modification Coefficient (R) = Per MBM
 - Deflection Amplification Factor (Cd) = Per MBM
 - Design Base Shear, V = Per MBM
 - Analysis Procedure = Per MBM

REQUIRED SPECIAL INSPECTIONS (BY TESTING AGENCY)


IN ADDITION TO THE REGULAR INSPECTIONS REQUIRED BY SECTION 110, THE FOLLOWING ITEMS REQUIRE SPECIAL INSPECTION IN ACCORDANCE WITH SECTION 1704, 1706 & 1707 OF THE 2017 FBC.

ITEM	SECTION
Inspection of Fabricators - Verify fabrication/quality control procedures	1704.2.1
Concrete Construction - Reinforcing Steel Installation - Cast-in Place Anchor Bolts - Verify Design Mix - Fresh Concrete Sampling - Concrete Placement - Concrete Curing Operations - Evaluation of Concrete Strength	Table 1705.3 Table 1705.3 Table 1705.3 Table 1705.3 Table 1705.3 Table 1705.3
Soils - Verify materials below are adequate to achieve design bearing capacity - Verify excavations are extended to proper depth and have reached proper bearing material - Perform classification and testing of controlled fill materials - Verify site preparation with soils report - Verify use of proper materials, densities and lift thickness during placement and compaction of controlled fill	Table 1705.6 Table 1705.6 Table 1705.6 Table 1705.6 Table 1705.6


REQUIRED SPECIAL INSPECTION NOTES:
 1. General Contractor shall coordinate any additional special inspection requirements with Owner and applicable building authorities.
 2. Special Inspections are the responsibility of the Owner.
 3. The names of persons or firms who are to perform the Special Inspections shall be forwarded to the Building Official for approval.
 4. The Special Inspector(s) shall complete and submit all forms required by the Local Jurisdiction.

TYPICAL STRUCTURAL ABBREVIATIONS


ACI AMERICAN CONCRETE INSTITUTE	EXP. EXPANSION	PED. PEDESTAL
AISC AMERICAN INSTITUTE OF STEEL CONSTRUCTION	FLR. FLOOR	PL. PLATE
A.R. ANCHOR ROD	FDN. FOUNDATION	PLF. POUNDS PER LINEAR FOOT
ARCH. ARCHITECT	FTG. FOOTING	PROJ. PROJECTION
ASTM AMERICAN SOCIETY OF TESTING MATERIALS	F.S. FAR SIDE	PSF. POUNDS PER SQUARE FOOT
BLDG. BUILDING	GAL. GALVANIZED	PSI. POUNDS PER SQUARE INCH
BM. BEAM	HK. HOOK	R. RADIUS
BOTT. BOTTOM	HORIZ. HORIZONTAL	REINF. REINFORCEMENT
BRG. BEARING	H.S.A. HEADED STUD ANCHOR	REQD. REQUIRED
C. CENTERLINE	I.F. INSIDE FACE	RTU. ROOF TOP UNIT
CLR. CLEAR	JBE. JOIST BEARING ELEVATION	SCHED. SCHEDULE
COL. COLUMN	JT. JOIST	SECT. SECTION
CONC. CONCRETE	JT. JOINT	SIM. SIMILAR
CONN. CONNECTION	LG. LONG	SJI. STEEL JOIST INSTITUTE
CONT. CONTINUOUS	LLH. LONG LEG HORIZONTAL	S.O.G. SLAB-ON-GRADE
CTRD. CENTERED	LLV. LONG LEG VERTICAL	SPAC. SPACING
DEG. or ° DEGREE	LONG. LONGITUDINAL	SPECS. SPECIFICATIONS
DIA. or Ø DIAMETER	MAX. MAXIMUM	STD. STANDARD
DM. DIMENSION	METAL BUIL. MANUFACTURER	STIFF. STIFFENER
DN. DOWN	MECH. MECHANICAL	STEEL STEEL
do. DITTO	MFR. MANUFACTURER	TOC. TOP OF CONCRETE
DTL. DETAIL	MIN. MINIMUM	TOF. TOP OF FOOTING
DWG. DRAWING	MISC. MISCELLANEOUS	TOW. TOP OF WALL
DWL. DWEL	MTL. METAL	TRANS. TRANSVERSE
EA. EACH	N.S. NEAR SIDE	TYP. TYPICAL
E. ELEVATION	O.C. ON CENTER	UN.O. UNLESS NOTED OTHERWISE
EQ. EQUAL	O.F. OUTSIDE FACE	VERT. VERTICAL
EW. EQUAL WAY	OPENING	W. WITH
EXIST. EXISTING	PAF. POWDERED ACTUATED FASTENER	WP. WORK POINT
		WWF. WELDED WIRE FABRIC

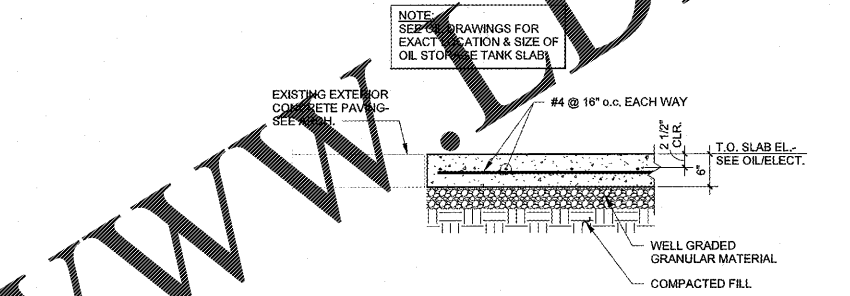


8 OIL STORAGE TANK SLAB SECTION
3/4" = 1'-0"

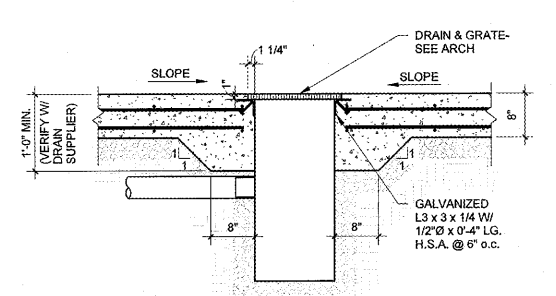


7 DRAIN PIT SECTION
3/4" = 1'-0"




6 TYP. CONCRETE WALL CORNER DETAIL
NOT TO SCALE

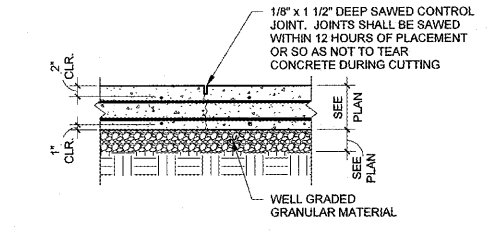


5 TYP. SLAB-ON-GRADE CONTROL JOINT DETAIL
3/4" = 1'-0"

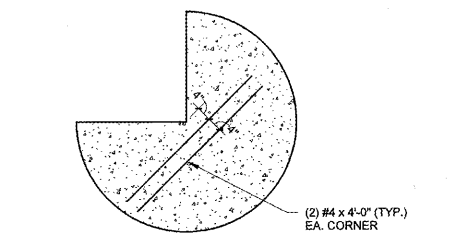


4 SECTION
1/2" = 1'-0"

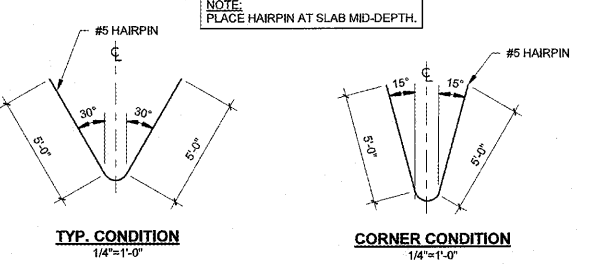

3 TYP. HAIRPIN DETAILS
AS NOTED

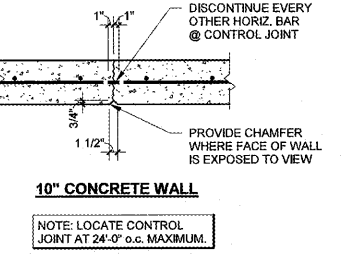

2 TYP. CONCRETE WALL CONTROL JT. DETAIL
NOT TO SCALE

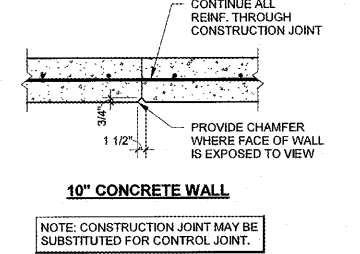

1 TYP. CONCRETE WALL CONSTRUCTION JT. DETAIL
NOT TO SCALE

Order Plans @ WWW.DILLINE.COM

HFA ARCHITECTS ENGINEERS INTERIORS
 HARRISON FRENCH & ASSOCIATES, LTD.
 1705 S. Walton Blvd., Suite 3
 Bentonville, Arkansas 72712
 + 479-273-7788
 f 888-520-9683
 www.hfa-ae.com

STIPULATION FOR REUSE:
 THIS DRAWING WAS PREPARED FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED HEREIN. IT IS NOT TO BE REUSED FOR ANY OTHER PROJECT WITHOUT THE WRITTEN PERMISSION OF HARRISON FRENCH & ASSOCIATES, LTD. ANY REUSE OF THIS DRAWING FOR ANY OTHER PROJECT WITHOUT THE WRITTEN PERMISSION OF HARRISON FRENCH & ASSOCIATES, LTD. IS STRICTLY PROHIBITED.

200 S KINGS HWY
 FORT PIERCE, FL 34945
 SPEEDCO REBRANDING & LIGHT MECHANICAL ADDITION
 PROJECT NUMBER: 03-19-0467

Loves Travel Stop & Country Stores

Lungshen Tsao, P.E.
 License #74800
 Harrison French & Associates, LTD
 COA #28821

ISSUE BLOCK

STORE NO. 467
 DOCUMENT DATE: 05/14/19
 CHECKED BY: LST
 DRAWN BY: JWK
 PRTO CYCLE:

GENERAL NOTES & TYPICAL DETAILS

SHEET: **YS1.0**