



Order Plans @ www.JDILine.com

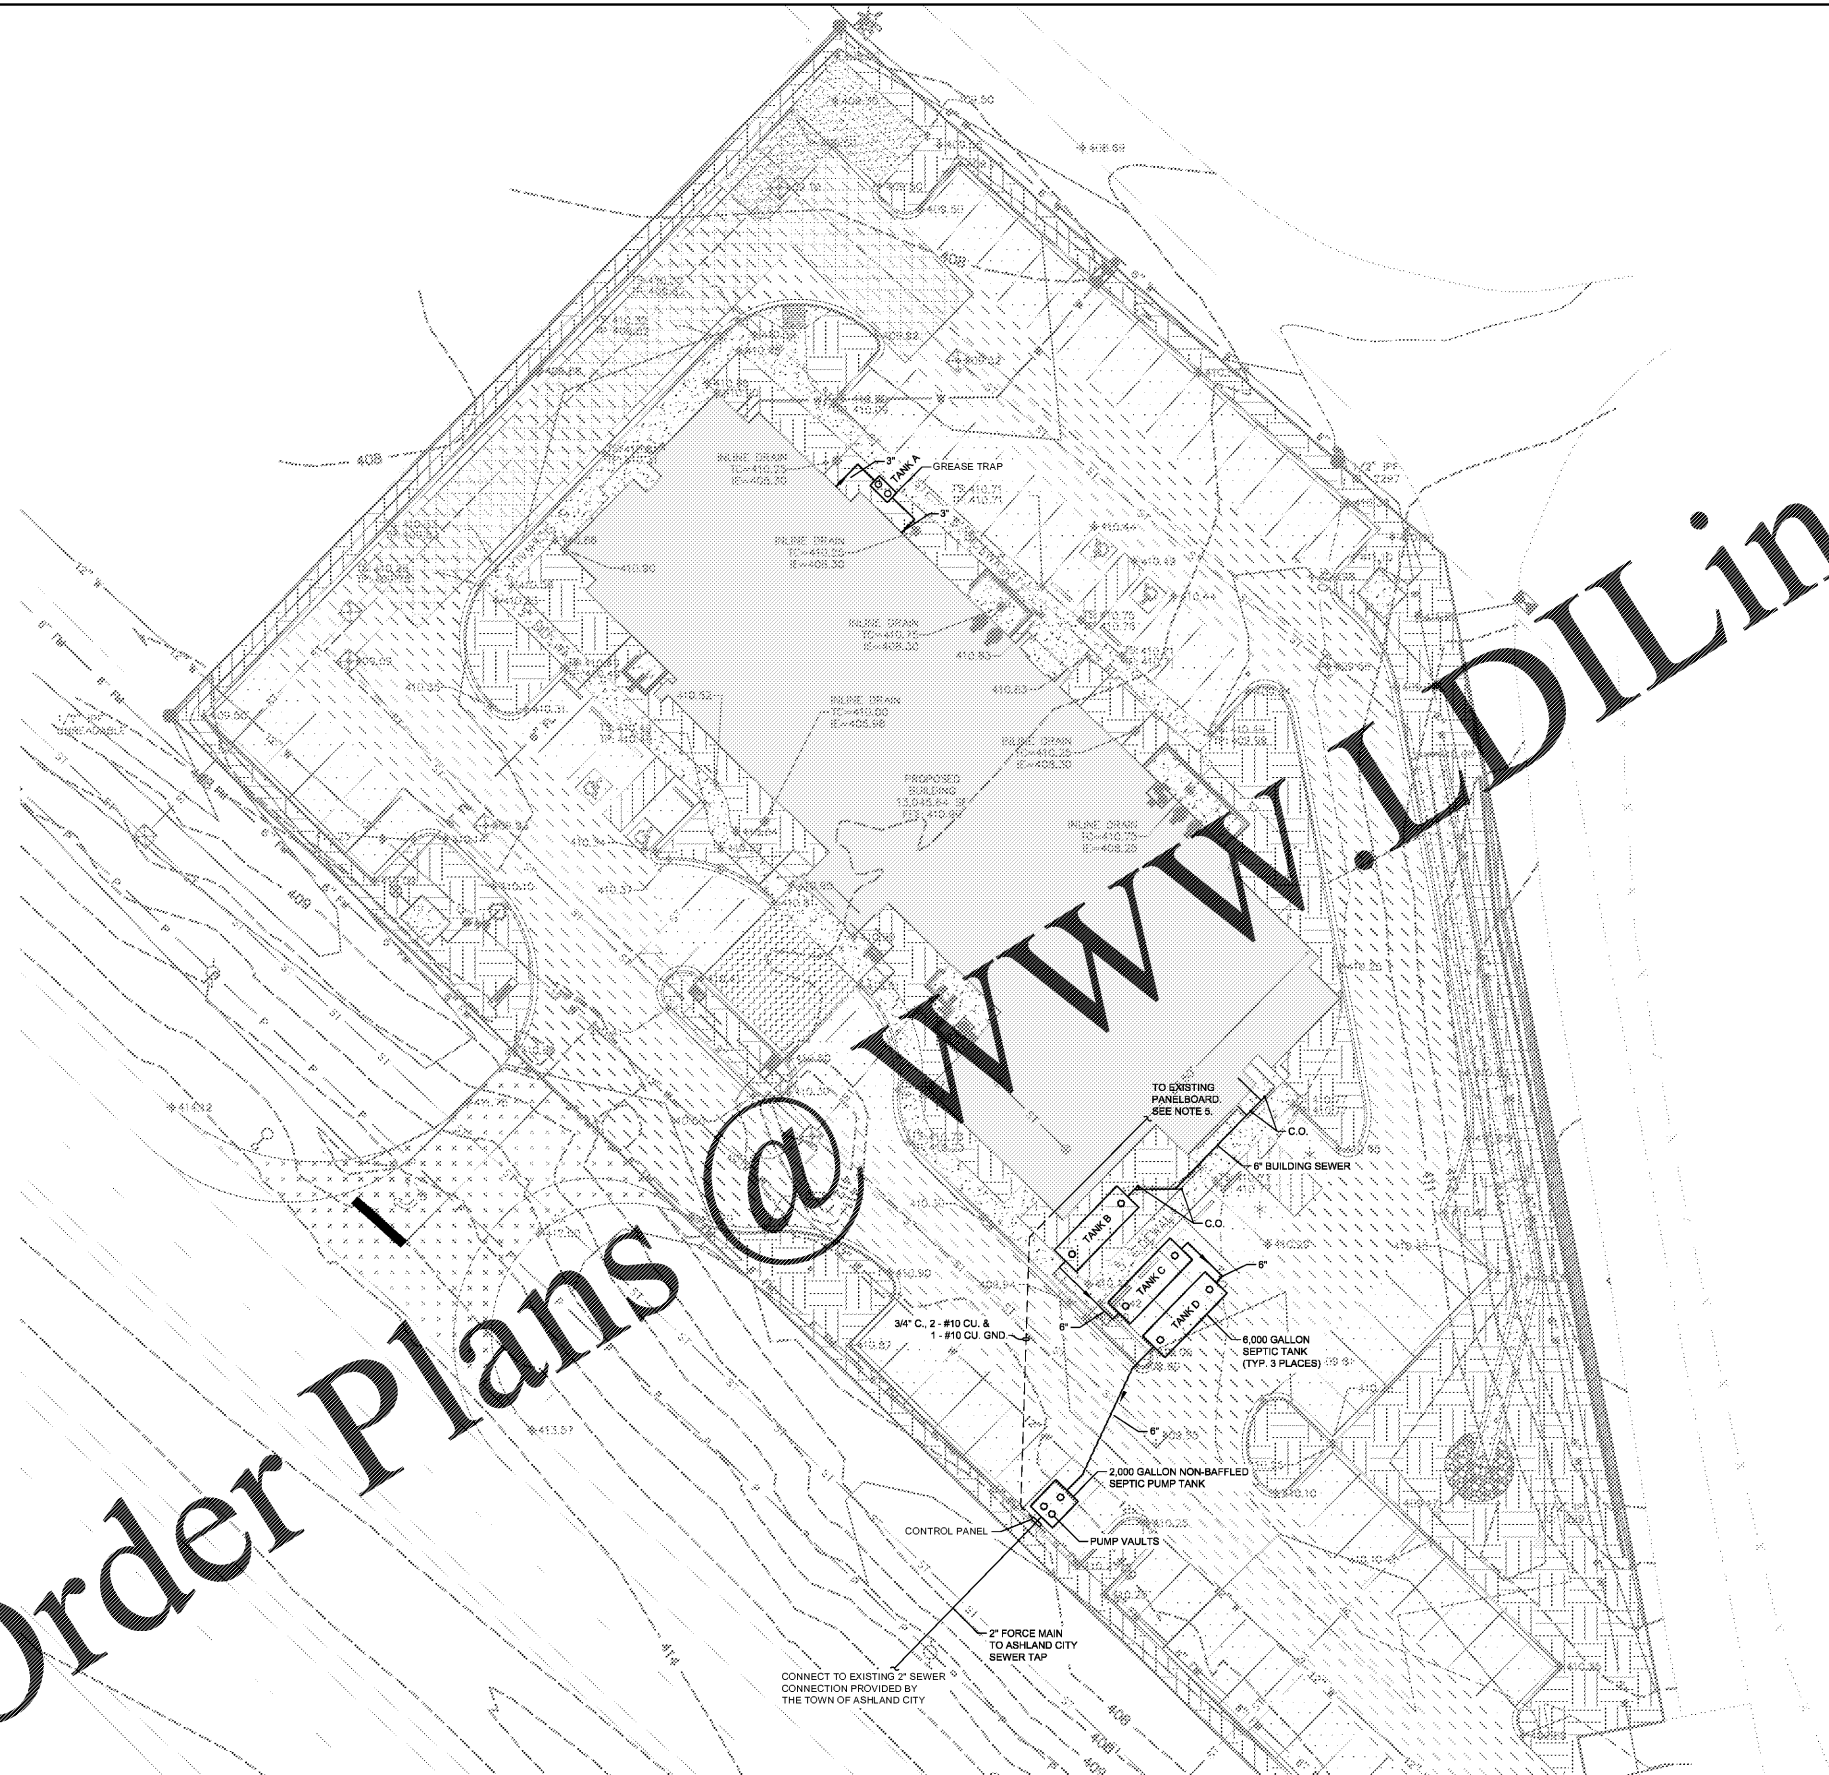

NOTES:

- 1.) ALL TANKS TO BE WATERTIGHT PRECAST CONCRETE AS MANUFACTURED BY JARRETT CONCRETE, ASHLAND CITY, TN. TANKS TO BE H2O LOAD RATED.
- 2.) ALL LINES BETWEEN TANKS TO HAVE MINIMUM 1.0% SLOPE. PIPE TO BE SCHEDULE 40 PVC.
- 3.) ALL TANKS IN PAVEMENT TO BE BACKFILLED WITH COMPACTED CRUSHED STONE.
- 4.) CAST IRON LIDS FOR TANKS TO BE TRAFFIC RATED IN PAVED AREAS.
- 5.) FURNISH AND INSTALL ONE (1) EA. - 20 AMP, 2 POLE CIRCUIT BREAKER IN EXISTING PANELBOARD FOR PUMP TANK CONTROL PANEL.



WESTERMAN ENGINEERING
 Dickson, Tennessee 37055
 PH: 615-375-6054 www.westengr.com

Ashland City Hampton Inn Cheatham County, TN	DESIGN	DRAWN	CHECKED	SHEET 1
	RNW	TWR	RNW	
SEPTIC TANK INSTALLATION	DATE	SCALE	PROJECT NO.	
	NOV. 2018	1" = 20'	18167	