
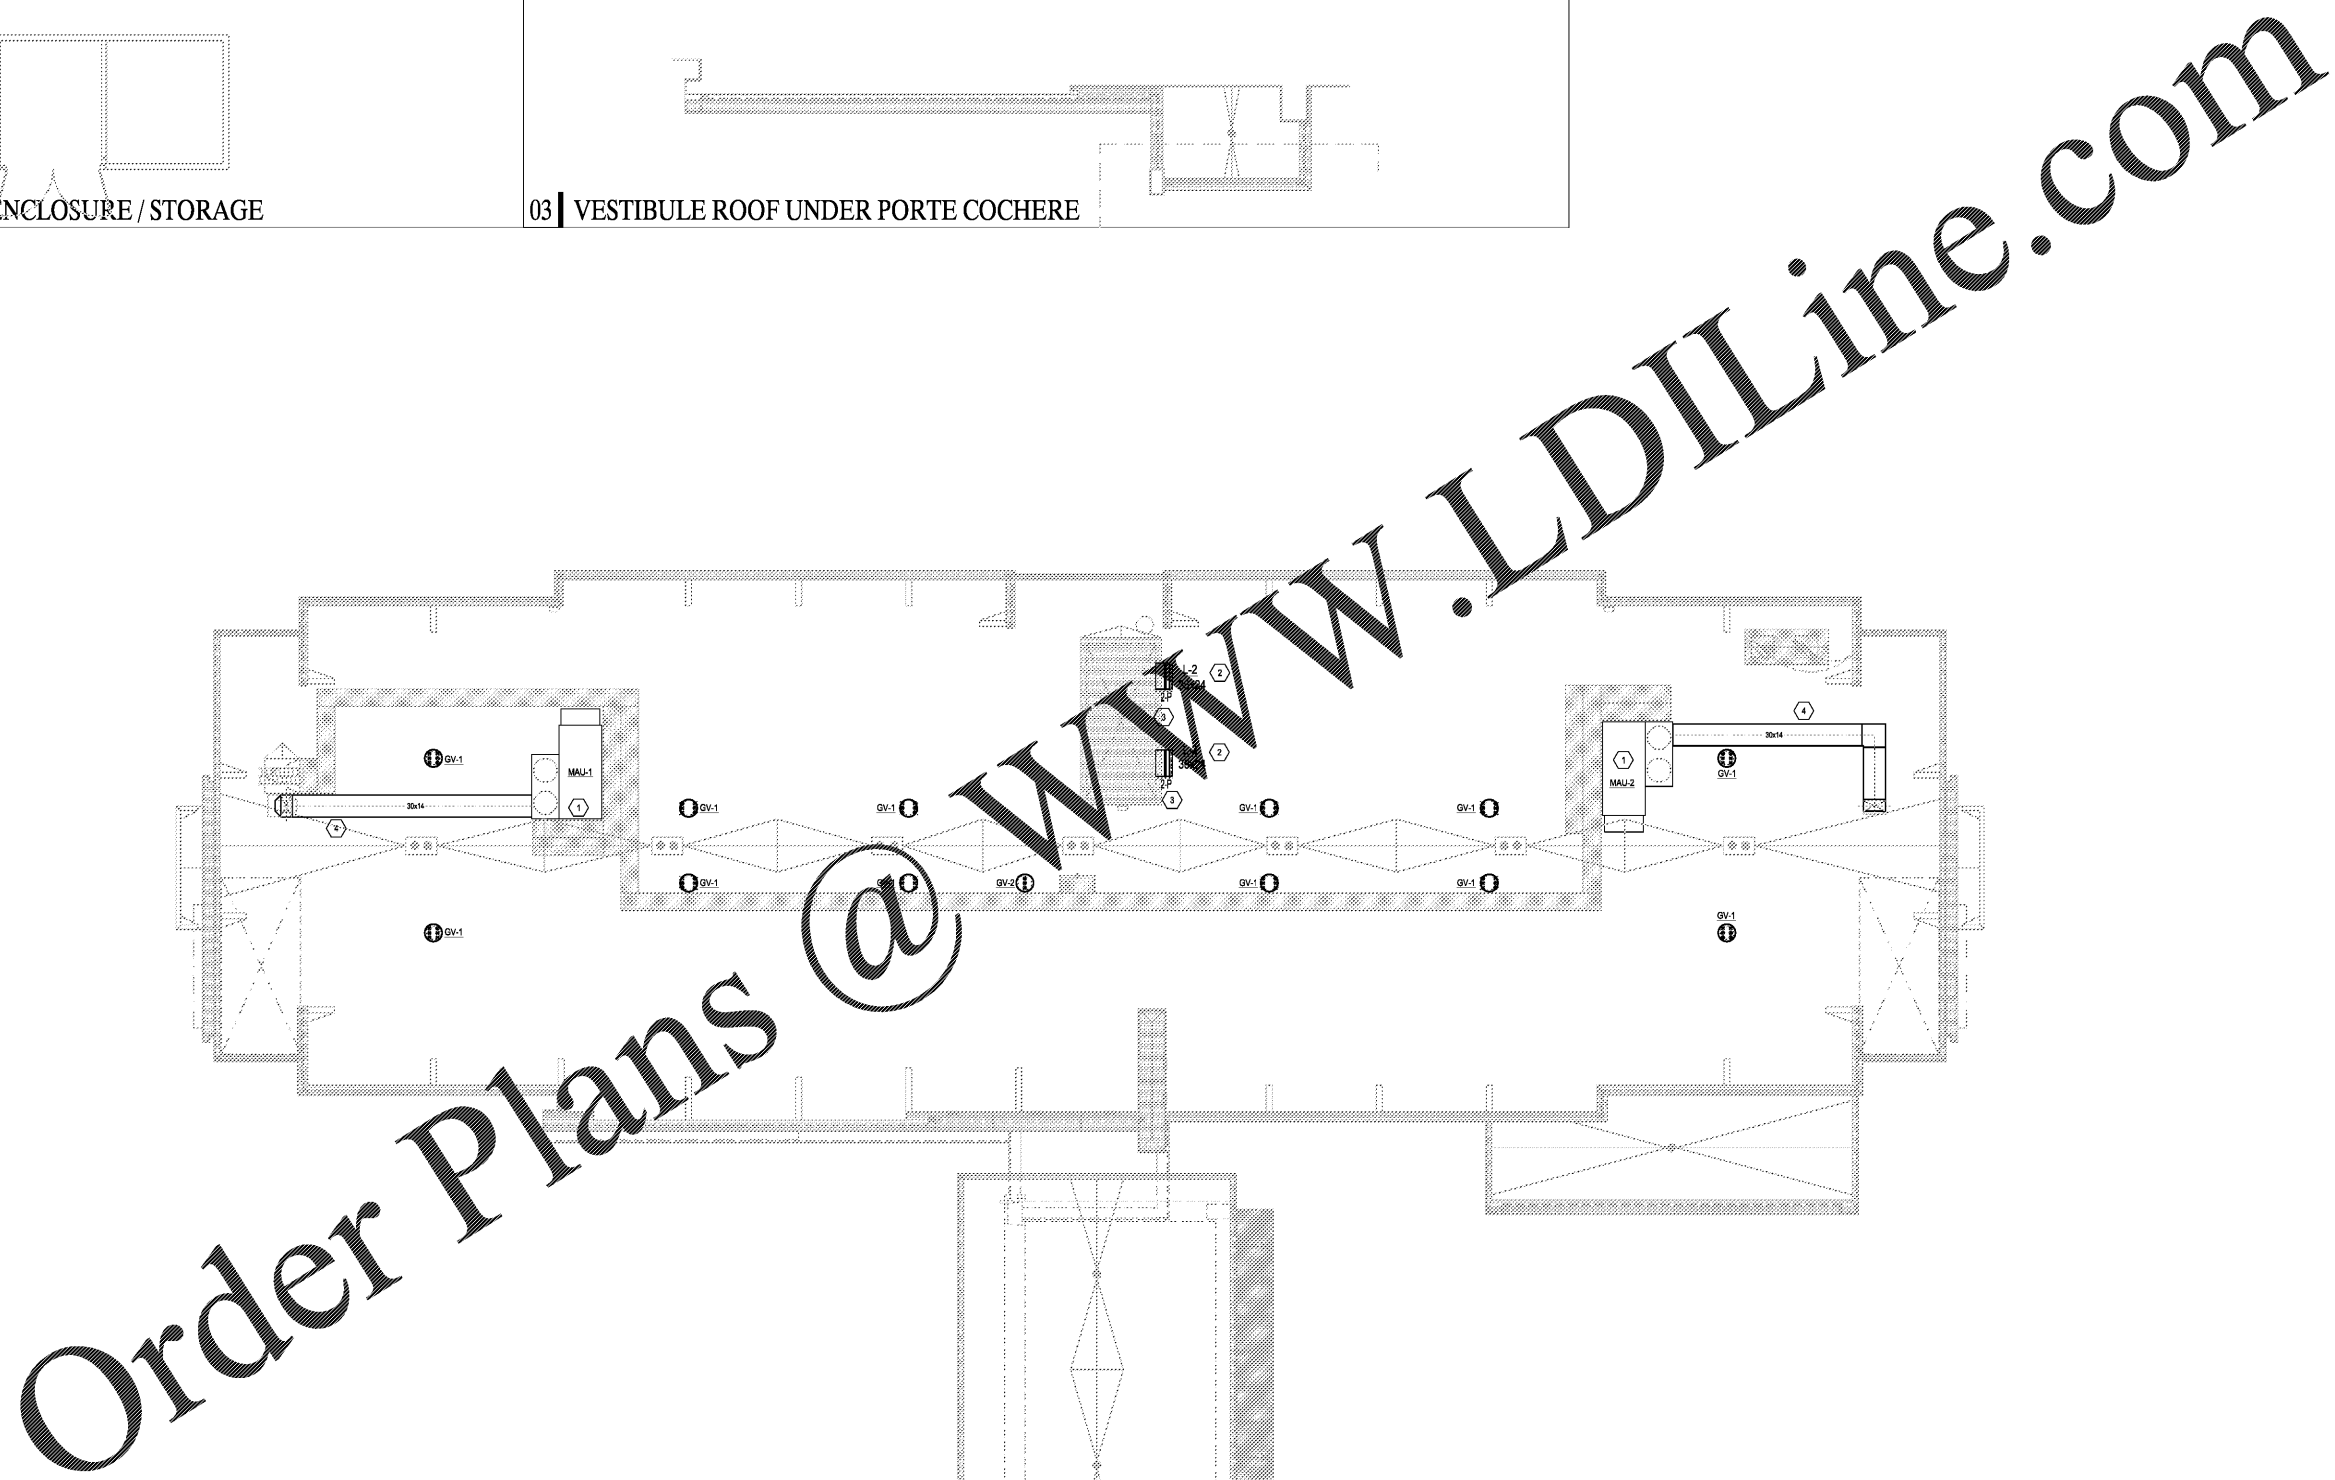
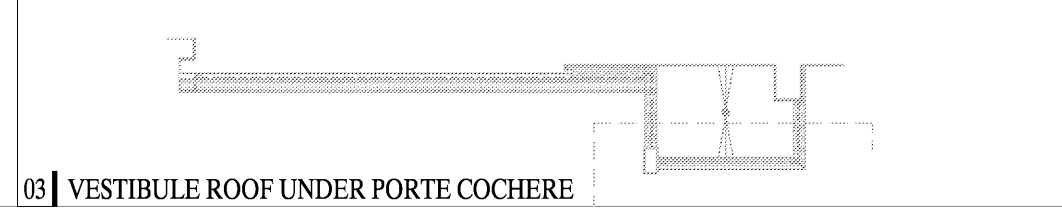


- KEYED NOTES**
- ① ROUTE CONDENSATE, FULL SIZE, TO NEAREST ROOF DRAIN.
 - ② RELIEF LOUVER FOR ELEVATOR HOISTWAY. CONFIRM REQUIREMENTS WITH ELEVATOR MANUFACTURER PRIOR TO ORDERING AND INSTALLATION. FREE AREA 2.80 SF PER LOUVER.
 - ③ PROVIDE 2-POSITION MOTORIZED DAMPER. DAMPER SHALL BE TIED TO FIRE ALARM SYSTEM. DAMPER SHALL BE CLOSED DURING NORMAL OPERATION AND SHALL OPEN UPON FIRE ALARM ACTIVATION (DAMPER SHALL OPEN UPON LOSS OF POWER). DAMPER SHALL BE SUPPLIED AND INSTALLED BY THE MECHANICAL CONTRACTOR AND WIRED BY THE FIRE ALARM CONTRACTOR.
 - ④ DUCTWORK ON ROOF. PROVIDE EXTERIOR INSULATION PER SPECIFICATIONS AND DETAIL. THERMADUCT IS AN ACCEPTABLE ALTERNATE.


1 HOUR FIRE RATED PARTITION
2 HOUR FIRE RATED PARTITION

March Adams & Associates
10 Doodle Ave.
Chattanooga, Tennessee 37404
423.698.4673
www.maa-associates.com

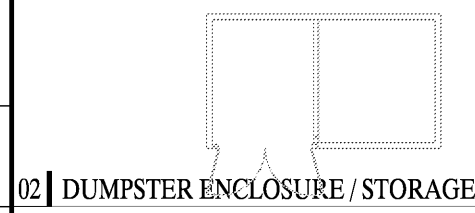

01 | MAIN BUILDING / PORTE COCHERE

MECHANICAL ROOF PLAN M201



HAMPTON INN
NEW HOTEL
ASHLAND CITY, TENNESSEE
WWW.DAVIDRCARTER.NET
DAVID R. CARTER AND ASSOCIATES



ISSUE DATE 05-30-19
▲ REVISION LOG

PROJECT 00755