


Order Plans @

WWW.LDILine.com

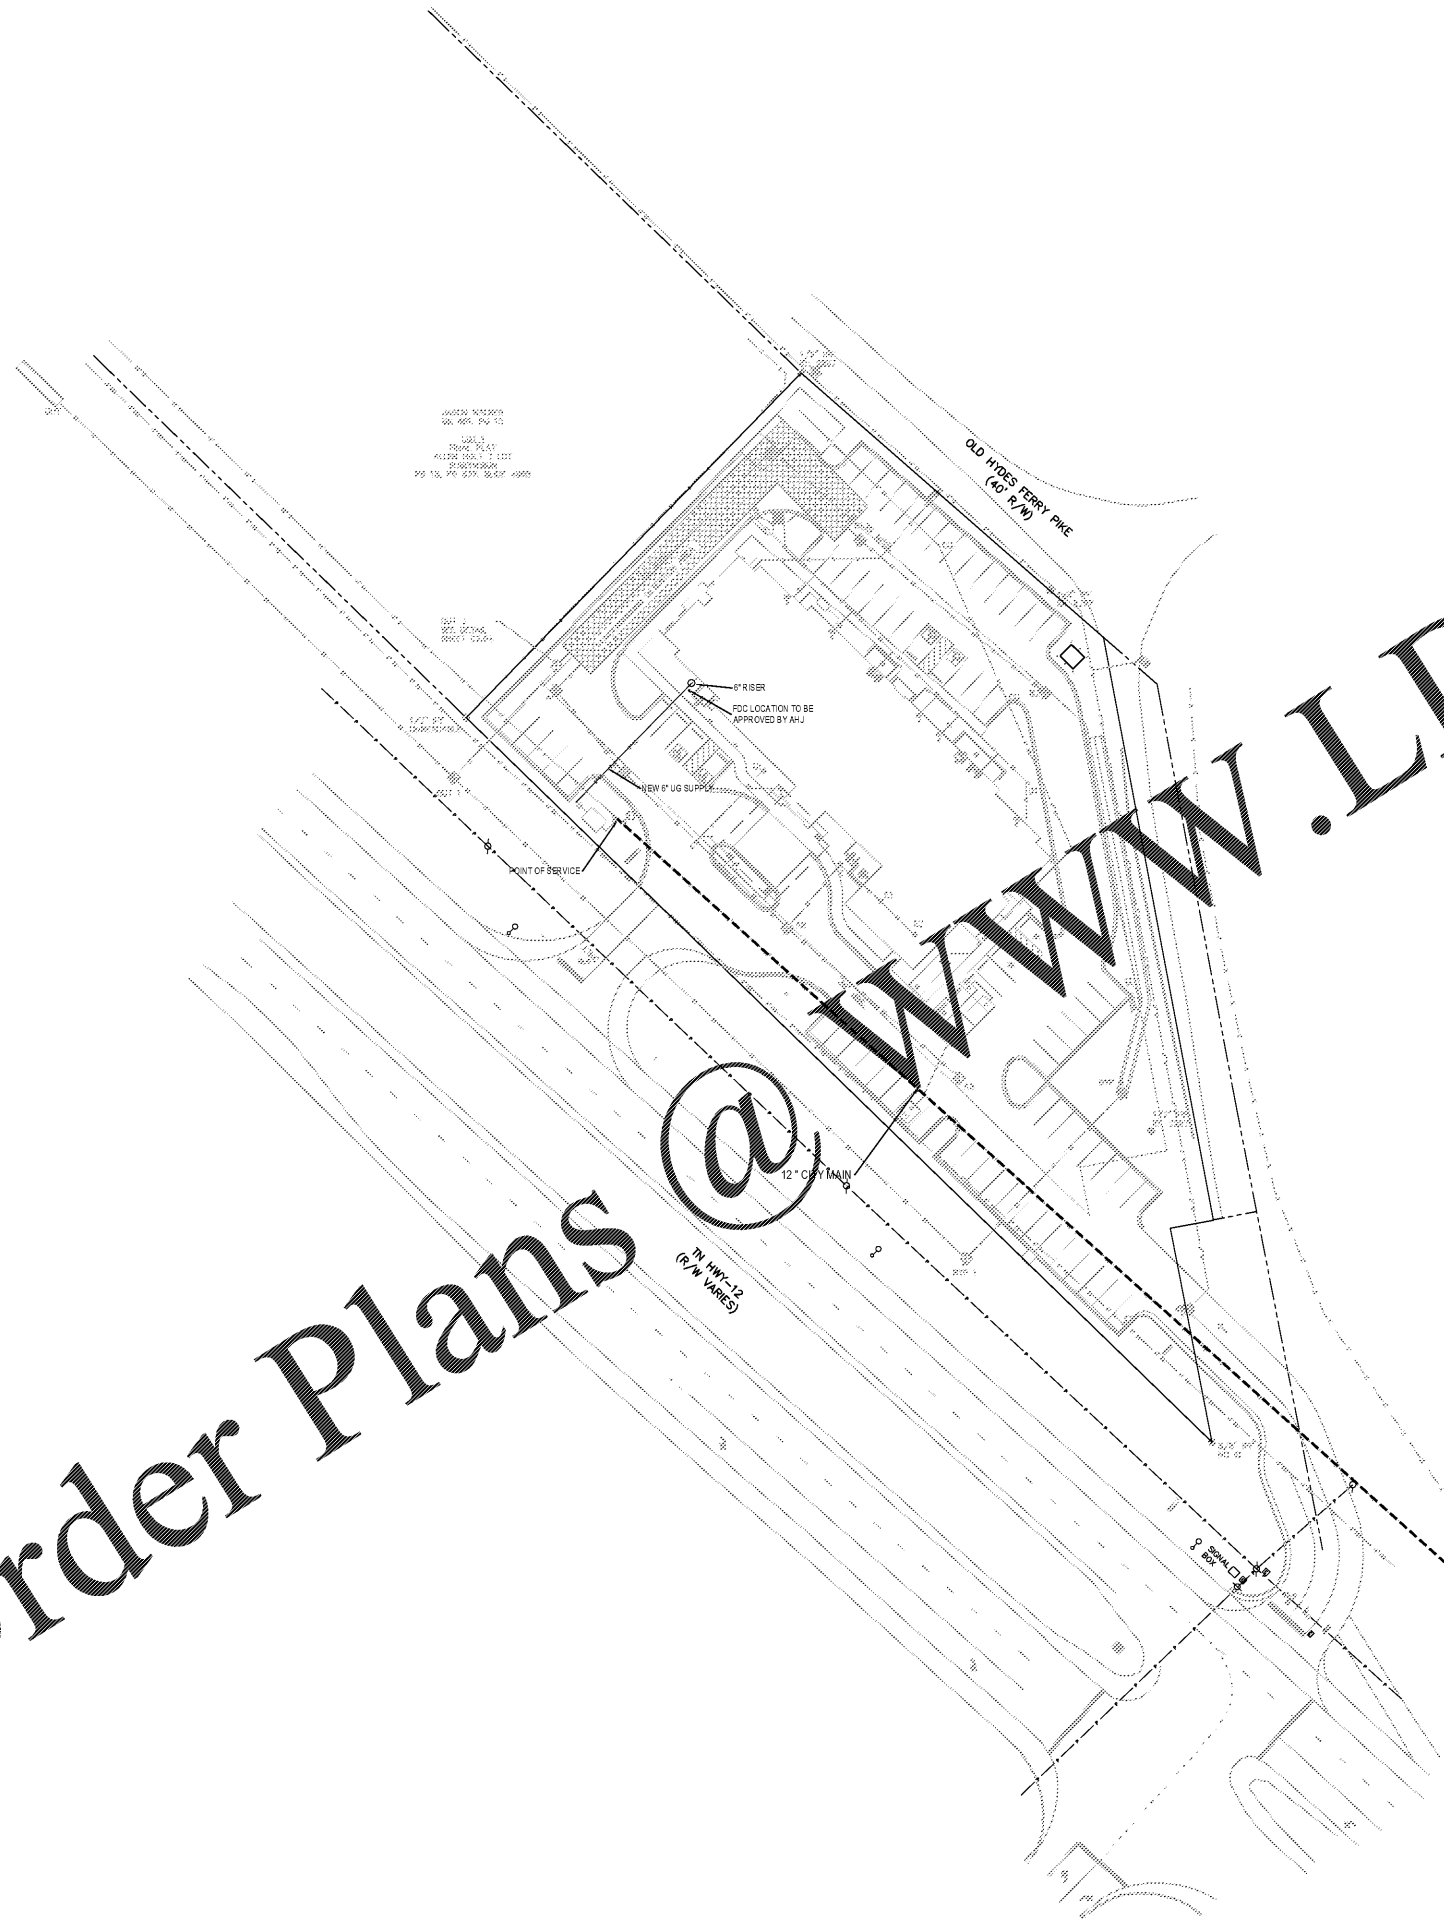

FLOW HYDRANT

HYDRANT DATA:
 STATIC PRESSURE 118PSI
 RESIDUAL PRESSURE 58 PSI
 FLOW RATE 1482 GPM
 DATE 1-11-2019

NOTE

1. PER ASHLAND CITY FIRE DEPARTMENT DIRECTOR FIRE PUMP IS NOT REQUIRED.
2. CONTRACTOR TO PROVIDE A LATEST HYDRO TEST TO BE WITNESSED BY FIRE DEPARTMENT PRIOR TO SUBMITTING SHOP DRAWINGS FOR REVIEW. A FEE MAYBE REQUIRED AND TO BE PAID BY FIRE PROTECTION CONTRACTOR.

1 HOUR FIRE RATED PARTITION
 2 HOUR FIRE RATED PARTITION

March Adams & Associates
 110 Duane Ave.
 Chattanooga, Tennessee 37404
 (423) 686-6673

HAMPTON INN
 NEW HOTEL
 ASHLAND CITY, TENNESSEE
 WWW.DAVIDRCARTER.NET
 DAVID R. CARTER AND ASSOCIATES



ISSUE DATE 05-30-19
 ▲ REVISION LOG

PROJECT 00755

SITE PLAN FP202